

February 19, 2013

Via Overnight Delivery-UPS
Ms. Rosemary Chiavetta, Esquire
Secretary
Pennsylvania Public Utility Commission
Commonwealth Keystone Building
400 North Street
P.O. Box 3265
Harrisburg, PA 17105

RECEIVED

FEB 19 2013

PA PUBLIC UTILITY COMMISSION
SECRETARY'S BUREAU

Re: Docket No. A-2013-_____
Main Street, Darby Borough, Delaware County, at-grade crossing
Application of PECO to cap/install gas facilities

Dear Secretary Chiavetta:


Enclosed for filing is the original Application of PECO Energy Company ("PECO") to cap/install its gas facilities in the at-grade crossing at Main Street, Darby Borough, Delaware County.

As indicated on the Certificate of Service, a copy of PECO's Application has been provided to the Service List in the manner indicated.

If there are any questions, please do not hesitate to contact me.

Very truly yours,

Reger Rizzo & Darnall LLP

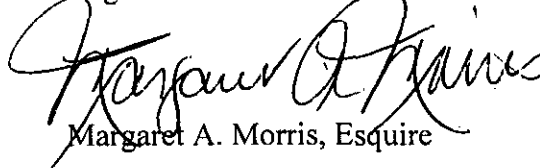

Margaret A. Morris, Esquire

Enclosure

cc: Service List, via 1st Class Mail
Ward Smith, Esq., PECO

RECEIVED

BEFORE THE

PENNSYLVANIA PUBLIC UTILITY COMMISSION

FEB 19 2013

PA PUBLIC UTILITY COMMISSION
SECRETARY'S BUREAU

Application of PECO Energy Company for :
Approval to alter the public at-grade crossing :
So as to cap the current gas main and to install a :
New gas main located on Main Street : Docket No. A-2013- _____
Between 4th Street and 14th Street :
Crossing a single track of CSX Transportation, Inc. :
In Darby Borough, Delaware County. :

**APPLICATION OF PECO ENERGY COMPANY TO ALTER AT-GRADE
CROSSING AT MAIN STREET, DARBY BOROUGH, DELAWARE
COUNTY**

To Pennsylvania Public Utility Commission:

1. The name and address of the Applicant is PECO Energy Company, 2301 Market Street, Philadelphia, PA 19101-8699.
2. The Applicant is a public utility incorporated under Delaware Law and is a subsidiary corporation of the Exelon Corporation. The Applicant, *inter alia*, provides gas service in Pennsylvania as well as other states in the eastern portion of the United States.
3. PECO is represented by the following counsels:

Margaret A. Morris, Esquire (authorized to receive service)
Reger Rizzo & Darnall LLP
Cira Centre, 13th Floor
2929 Arch Street
Philadelphia, PA 19104
(215) 495-6524 (voice)
(215) 495-6600 (fax)
mmorris@regerlaw.com

Ward L. Smith, Esquire
Exelon Business Services Group


2301 Market Street
P.O. Box 8699
Philadelphia, PA 19101-8699
(215) 841-6863 (voice)
(215) 568-3389 (fax)
ward.smith@exeloncorp.com

4. The Applicant desires to cap the existing gas main and to install a new 8 inch gas main in a 12 inch steel sleeve within the public right of way of Main Street which crosses the tracks of CSX Transportation Inc. (“the Railroad”) in Darby Borough, Delaware County Pennsylvania as shown on plan and profile attached hereto as Exhibit A.
5. The other agencies and public utilities with an interest in the proposed project are set forth on Exhibit B.
6. Applicant agrees to bear all the costs incurred in furnishing material and performing the work necessary to cap the existing gas main and to install a new gas main to serve its customers.
7. Applicant avers it is necessary and proper for the accommodation, convenience and service of the public that Applicant be authorized by the Commission to construct and maintain its facilities as proposed.
8. Applicant requests that a field conference be held as soon as practicable in this matter.
9. Applicant does not request a hearing prior to issuance of an order approving the application. Any hearing required to determine the final allocation of costs can be held after issuance of an order approving the project at the parties’ initial cost and after completion of the work.

WHEREFORE, PECO Energy Company, requests that its Application to alter the public at-grade crossing so as to cap the existing gas main and to install a new gas main located on Main Street between 4th and 14th Streets in Darby Borough, Delaware County which crosses the tracks of CSX Transportation Inc. be granted.

Respectfully submitted,

Dated: February 19, 2013

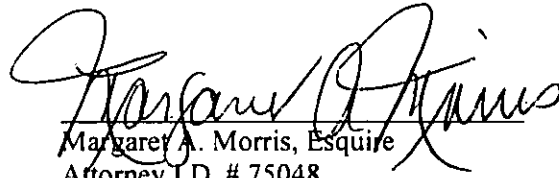

Margaret A. Morris, Esquire
Attorney I.D. # 75048
Cira Centre, 13th Floor
2929 Arch Street
Philadelphia, PA 19104
(215) 495-6524 (voice)
(215) 495-6600 (fax)
mmorris@regerlaw.com

Ward L. Smith, Esquire
Attorney I.D. # 47670
Exelon Business Services Group
2301 Market Street
P.O. Box 8699
Philadelphia, PA 19101-8699
(215) 841-6863 (voice)
(215) 568-3389 (fax)
ward.smith@exeloncorp.com

Counsel for PECO Energy Company

VERIFICATION

I, Rodney Stark, of PECO Energy Company, hereby state that the facts in the foregoing document(s) are true and correct to the best of my knowledge, information and belief. I understand that false statements therein are made subject to the penalties of 18 Pa. C.S. § 4904, relating to unsworn falsifications to authorities.

Dated: 2/14/13

Rodney Stark
Rodney Stark,
Manager
Real Estate Department,
PECO Energy Company

Exhibit A

PECO Energy Company's Plan and Profile


Gas Main Installation at Main Street Darby Borough, Delaware County

PROPOSED 8 INCH STEEL GAS MAIN IN 12 INCH STEEL SLEEVE BORE AND JACKING UNDER TRACKS ON MAIN ST AT 6TH ST ALL EXCAVATION WILL BE OUTSIDE OF THE 30 FT R.O.W. OF THE CENTER LINE OF BOTH RAILS


CONSTRUCTION NOTES

ENTIRE PROJECT IS BTWN 4TH ST & 14TH ST
REPLACE CAST IRON GAS MAIN ON MAIN ST
APPROX 6000 FT OF 8IN M.P. PLASTIC MAIN

RAIL ROAD CROSSING WILL BE 8IN COATED STEEL MAIN IN A 12IN STEEL CASING WITH VENTS AND CATHODIC PROTECTION



PIPE MUST BE CONVENTIONAL BORED UNDER TRACKS
ABANDONED PIPE MUST BE FILLED WITH GROUT

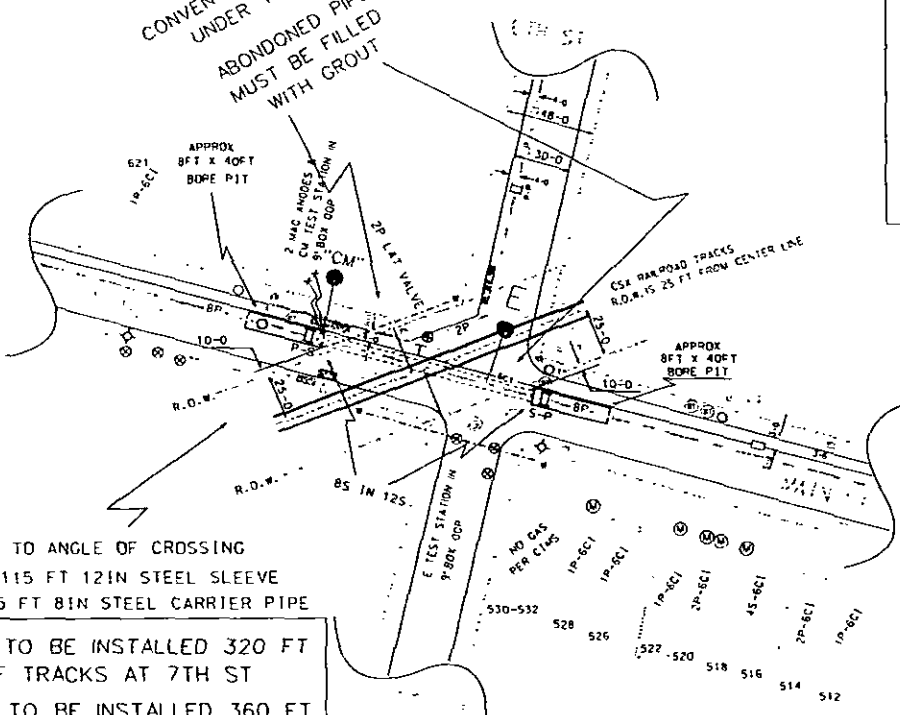


CSXT CONSTRUCTION NOTES

THE FRONT OF THE PIPE SHALL BE PROVIDED WITH MECHANICAL ARRANGEMENTS OR DEVICES THAT WILL POSITIVELY PREVENT THE AUGER FROM LEADING THE PIPE SO THAT NO UNSUPPORTED EXCAVATION IS AHEAD OF THE PIPE.

ALL CONSTRUCTION ACTIVITIES MUST COMPLY WITH 'CSXT' SPECIFICATIONS

THE INSTALLATION WILL BE REVIEWED AND MONITORED BY 'CSXT' FLAGMEN AND APPOINTED INSPECTOR AS REQUIRED

THE PROJECT MUST COMPLY WITH ALL CONDITIONS, OBLIGATIONS, AND ADDITIONAL SAFETY PRECAUTIONS REQUIRED BY THE 'CSXT' BALTIMORE DIVISION

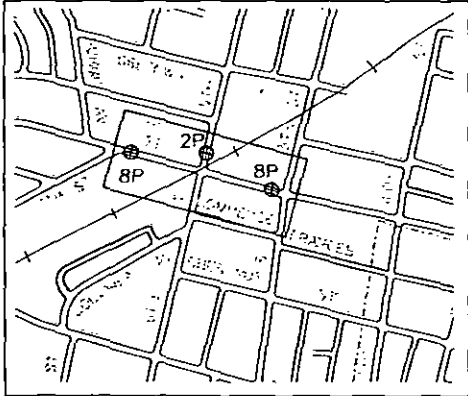

MAP NUMBER 39904
EC NUMBER 163741
PROJECT NUMBER 874
ELECTRIC DIAD: 57499
KEY MAP: 574
GAS DIAD: 2450-574978
POCS: RECD.
PEPWT: STATE & LOCAL
W.A.P. STATE POLICE: PAT-104 & 108
REGO SIGN: PD-G-1032
PROJECT ENGINEER: FRANK D'AMATO
610-632-4528

POCS 1-800-242-1174
PRESSURE-20# M.P.
SCALE: N.T.S.

DUE TO ANGLE OF CROSSING
APPROX 115 FT 12IN STEEL SLEEVE
APPROX 125 FT 8IN STEEL CARRIER PIPE

8P VALVE TO BE INSTALLED 320 FT WEST OF TRACKS AT 7TH ST
8P VALVE TO BE INSTALLED 360 FT EAST OF TRACKS AT 5TH ST
2P VALVE TO BE INSTALLED AT N. 6TH ST

SEE PROCEDURE GO-PE-315
STANDARDS G-1005 & 2405

CROSSING NUMBER: 140641S

RAILROAD CROSSING
SHEET 2 OF 2

CONSTRUCTION DETAIL

PECO ENERGY
CAST IRON REPLACEMENT
MAIN ST
BTWN
4TH ST & 14TH ST
DARBY BORO 313

ESTIMATOR-DESIGNED	DATE 2/20/12
INCH 80STEP	ELECTRIC NO. 874
G-10-832-6541	GAS 802 07492556

Exhibit B

Main Street Project, Darby Borough

Delaware County

Steve Altobelli
AT&T Local Services
c/o TREC Group, Inc
536 Baltimore Pike
Springfield PA 19064

Jason Marques, Esq.
CSX Transportation, Inc.
Law Dept.
500 Water Street, J-150
Jacksonville, FL 32202

Michael Stocker, Project Mgr
Comcast Cable Communications
190 Shoemaker Road
Pottstown PA 19464

Thomas C. Stortz
Vice President & General Counsel
Level 3 Communications, Inc.
1025 Eldorado Blvd.
Broomfield, CO 80021

EXHIBIT "B"

The public utilities, municipalities, counties, corporations, and property owners concerned in, or affected by, the proposed crossing alterations are:

William Zahn, Highway Liasion
Aqua Pennsylvania Inc.
762 Lancaster Ave.
Bryn Mawr, PA 19010

Lee McGarrity, Construction Manager
Comcast Cable Communications
1004 Cornerstone Blvd.
Downington, PA 19335-5366

Mark Possenti, Manager
Borough of Darby
821 Summit
Darby, PA 19023

Bill Hensil, Program Manager
PECO Energy Company
050 West Swedesford Road
Berwyn, PA 19312

Deirdre A. Johns, Specialist
Verizon Pennsylvania Inc.
180 Sheree Blvd., Suite 2100
Kennett Square, PA 19348

John E. Pickett
Delaware Co. Planning Commission
Court House/Government Center
201 W. Front Street
Media PA 19063

Sonny Bocchinfuso
District 6-0 Grade Crossing Coordinator
7000 Geerdes Blvd.
King of Prussia, PA 19406

Janice Davis, Council Pres.
Borough of Darby
48 N. 10th Street
Darby, PA 19023

Gina D'Alfonso, Assistant Counsel-in-Charge
PennDOT Office of Chief Counsel
Keystone Bldg. – 9th floor
P.O. Box 8212
Harrisburg, PA 17105-8212

Mark Chappel, Chief
PennDOT Bureau of DesignUtilities Section
Keystone Bldg. – 7th floor
P.O. Box 3362
Harrisburg, PA 17105-3362

Melanie Perea
CSX Transportation, Inc.
6737 Southpoint Dr. South, J-180
Jacksonville, FL 32216

Dean Boyers
Verizon Business: Investigations
Office of General Counsel
2400 North Glenville Drive
Richardson TX 75082

Frances P Orth, Esq.
Aqua Pennsylvania Inc.
762 West Lancaster Avenue
Bryn Mawr PA 19010-3489


Benjamin Dunlap, Esq.
Nauman Smith
200 N. 3rd Street, 18th Floor
Harrisburg, PA 17101

Re: Docket No. A-2013-_____
Main Street, Darby Borough, Delaware County, at-grade crossing
Application of PECO to cap/install gas facilities

CERTIFICATE OF SERVICE

I hereby certify that a true and correct copy of the foregoing document has been served upon the following person on the attached service list, in the manner indicated, in accordance with the requirements of §1.54 (relating to service by a participant).

Dated: February 19, 2013

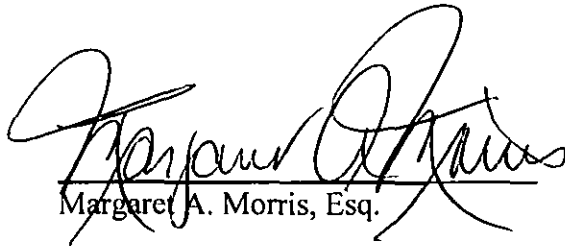
Margaret A. Morris, Esq.

RECEIVED

FEB 19 2013

**PA PUBLIC UTILITY COMMISSION
SECRETARY'S BUREAU**

Re: Docket No. A-2013-_____
Main Street, Darby Borough, Delaware County, at-grade crossing
Application of PECO to cap/install gas facilities
Service List-US Mail Delivery

Mark Chappell PE Chief
Row & Utility Division
PennDOT Bureau Of Design
PO Box 3362
Harrisburg PA 17105-3362

Gina M. D'Alfonso Attorney
Department Of Transportation
Office Of Chief Counsel 9th Floor
PO Box 8212
Harrisburg PA 17105-8212

Lester C Toaso
PennDOT District 6-0
Attn: Sonny Bocchinfuso
7000 Geerdes Boulevard
King Of Prussia PA 19406

Mark Possenti, Manger
Borough of Darby
821 Summit
Darby, PA 19023

Janice Davis, Council Pres.
Borough of Darby
48 N. 10th Street
Darby, PA 19023

John E. Pickett
Delaware Co Planning Commission
Court House/Government Center
201 W. Front Street
Media PA 19063

Melanie Perea
CSX Transportation, Inc.
6737 Southpoint Dr. South, J-180
Jacksonville, FL 32216

Dean Boyers
Verizon Business Attn: Investigations
2400 North Glenville Drive
Richardson TX 75082

Frances P Orth, Esquire
Aqua Pennsylvania Inc
762 West Lancaster Avenue
Bryn Mawr PA 19010-3489

Steve Altobelli
At&T Local Services
C/O Trec Group, Inc
536 Baltimore Pike
Springfield PA 19064

Michael Stocker, Project Mgr
Comcast Cable Communications
190 Shoemaker Road
Pottstown PA 19464

Deirdre Johns
Verizon Pennsylvania Inc
180 Sheree Boulevard, Suite 2100
Exton PA 19341

Thomas C. Stortz
Vice President & General Counsel
Level 3 Communications, Inc.
1025 Eldorado Blvd.
Broomfield, CO 80021


Benjamin Dunlap, Esq.
Nauman Smith
200 N. 3rd Street, 18th Floor
Harrisburg, PA 17101

Jason Marques, Esq.
CSX Transportation, Inc.
Law Dept.
500 Water Street, J-150
Jacksonville, FL 32202

UPS CampusShip: View/Print Label

1. Ensure there are no other shipping or tracking labels attached to your package. Select the Print button on the print dialog box that appears. Note: If your browser does not support this function select Print from the File menu to print the label.
2. Fold the printed sheet containing the label at the line so that the entire shipping label is visible. Place the label on a single side of the package and cover it completely with clear plastic shipping tape. Do not cover any seams or closures on the package with the label. Place the label in a UPS Shipping Pouch. If you do not have a pouch, affix the folded label using clear plastic shipping tape over the entire label.
3. **GETTING YOUR SHIPMENT TO UPS**
UPS locations include the UPS Store®, UPS drop boxes, UPS customer centers, authorized retail outlets and UPS drivers.
 Schedule a same day or future day Pickup to have a UPS driver pickup all your CampusShip packages. Hand the package to any UPS driver in your area. Take your package to any location of The UPS Store®, UPS Drop Box, UPS Customer Center, UPS Alliances (Office Depot® or Staples®) or Authorized Shipping Outlet near you. Items sent via UPS Return Services(SM) (including via Ground) are also accepted at Drop Boxes. To find the location nearest you, please visit the Resources area of CampusShip and select UPS Locations.
Customers with a Daily Pickup
 Your driver will pickup your shipment(s) as usual.

FOLD HERE

MARGARET A. MORRIS, ESQUIRE 2154956524 REGER RIZZO & DARNALL 2929 ARCH STREET PHILADELPHIA PA 19104		1 LBS	1 OF 1
SHIP TO: ROSEMARY CHIAVETTA, ESQ. 7177878009 PA PUC 400 NORTH STREET 2 NORTH COMMONWEALTH KEYSTONE BUILDING HARRISBURG PA 17120-0200			
	PA 171 9-20 		
UPS GROUND TRACKING #: 1Z 4XF 624 03 9188 2264			
			
BILLING: P/P Reference # 1: 071271011			

RECEIVED

FEB 19 2013

PA PUBLIC UTILITY COMMISSION
 SECRETARY'S BUREAU