



17 North Second Street
12th Floor
Harrisburg, PA 17101-1601
717-731-1970 Main
717-731-1985 Main Fax
www.postschell.com

Christopher T. Wright

cwright@postschell.com
717-612-6013 Direct
717-731-1985 Direct Fax
File #: 166392

January 22, 2018

VIA ELECTRONIC FILING

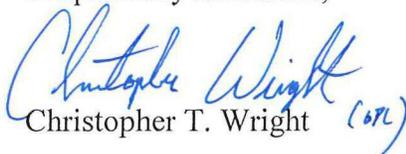
Rosemary Chiavetta, Secretary
Pennsylvania Public Utility Commission
Commonwealth Keystone Building
400 North Street, 2nd Floor North
P.O. Box 3265
Harrisburg, PA 17105-3265

**Re: Letter of Notification of PPL Electric Utilities Corporation, Filed Pursuant to 52 Pa. Code Chapter 57 Subchapter G, for Approval to Rebuild the Existing Breinigsville-Alburtis 500 kV Transmission Line in Lehigh County, Pennsylvania
Docket No. A-2017-2635709**

Dear Secretary Chiavetta:

Enclosed for filing are the Responses of PPL Electric Utilities Corporation to the Bureau of Technical Utility Services Data Requests in the above-referenced proceeding.

Respectfully submitted,


Christopher T. Wright (crl)

CTW/jl
Enclosures

cc: Jordan Van Order (*Via E-mail*)

Letter of Notification of PPL Electric Utilities Corporation,
Filed Pursuant to 52 Pa. Code Chapter 57 Subchapter G, for Approval to
Rebuild the Existing Breinigsville-Alburtis 500 kV Transmission Line in Lehigh County, Pennsylvania
Docket No. A-2017-2635709

Bureau of Technical Utility Services Data Requests
(Response dated 01/22/18)

A-1 Please provide a certificate of service for Jeffrey B Ehrets.

Response:

See the Certificate of Service provided as Attachment A-1.



17 North Second Street
12th Floor
Harrisburg, PA 17101-1601
717-731-1970 Main
717-731-1985 Main Fax
www.postschell.com

Christopher T. Wright

cwright@postschell.com
717-612-6013 Direct
717-731-1985 Direct Fax
File #: 166392

January 22, 2018

VIA ELECTRONIC FILING

Rosemary Chiavetta, Secretary
Pennsylvania Public Utility Commission
Commonwealth Keystone Building
400 North Street, 2nd Floor North
P.O. Box 3265
Harrisburg, PA 17105-3265

**Re: Letter of Notification of PPL Electric Utilities Corporation, Filed Pursuant to 52 Pa. Code Chapter 57 Subchapter G, for Approval to Rebuild the Existing Breinigsville-Alburtis 500 kV Transmission Line in Lehigh County, Pennsylvania
Docket No. A-2017-2635709**

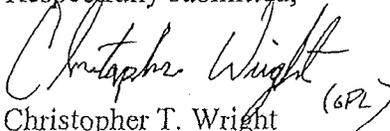
Dear Secretary Chiavetta:

On November 27, 2017, PPL Electric Utilities Corporation filed the Letter of Notification in the above-referenced proceeding. The following landowner was inadvertently omitted from the original certificate of service.

Jeffrey B. Ehrets
1511 Buck Hill Lane
Brenigsville, PA 19031

A copy of the Letter of Notification will be provided as indicated on the Supplemental Certificate of Service.

Respectfully submitted,


Christopher T. Wright (6PL)

CTW/jl
Enclosures

Rosemary Chiavetta, Secretary
January 22, 2018
Page 2

cc: Kimberly Hafner
Supplemental Certificate of Service


SUPPLEMENTAL CERTIFICATE OF SERVICE

I hereby certify that a true and correct copy of the foregoing **Letter of Notification** filed **November 27, 2017**, has been served upon the following persons, in the manner indicated, in accordance with the requirements of 52 Pa. Code § 1.54 (relating to service by a participant).

**VIA CERTIFIED MAIL
RETURN RECEIPT REQUESTED**

Jeffrey B. Ehrets
1511 Buck Hill Lane
Breinigsville, PA 19031

Date: January 22, 2018


Christopher T. Wright

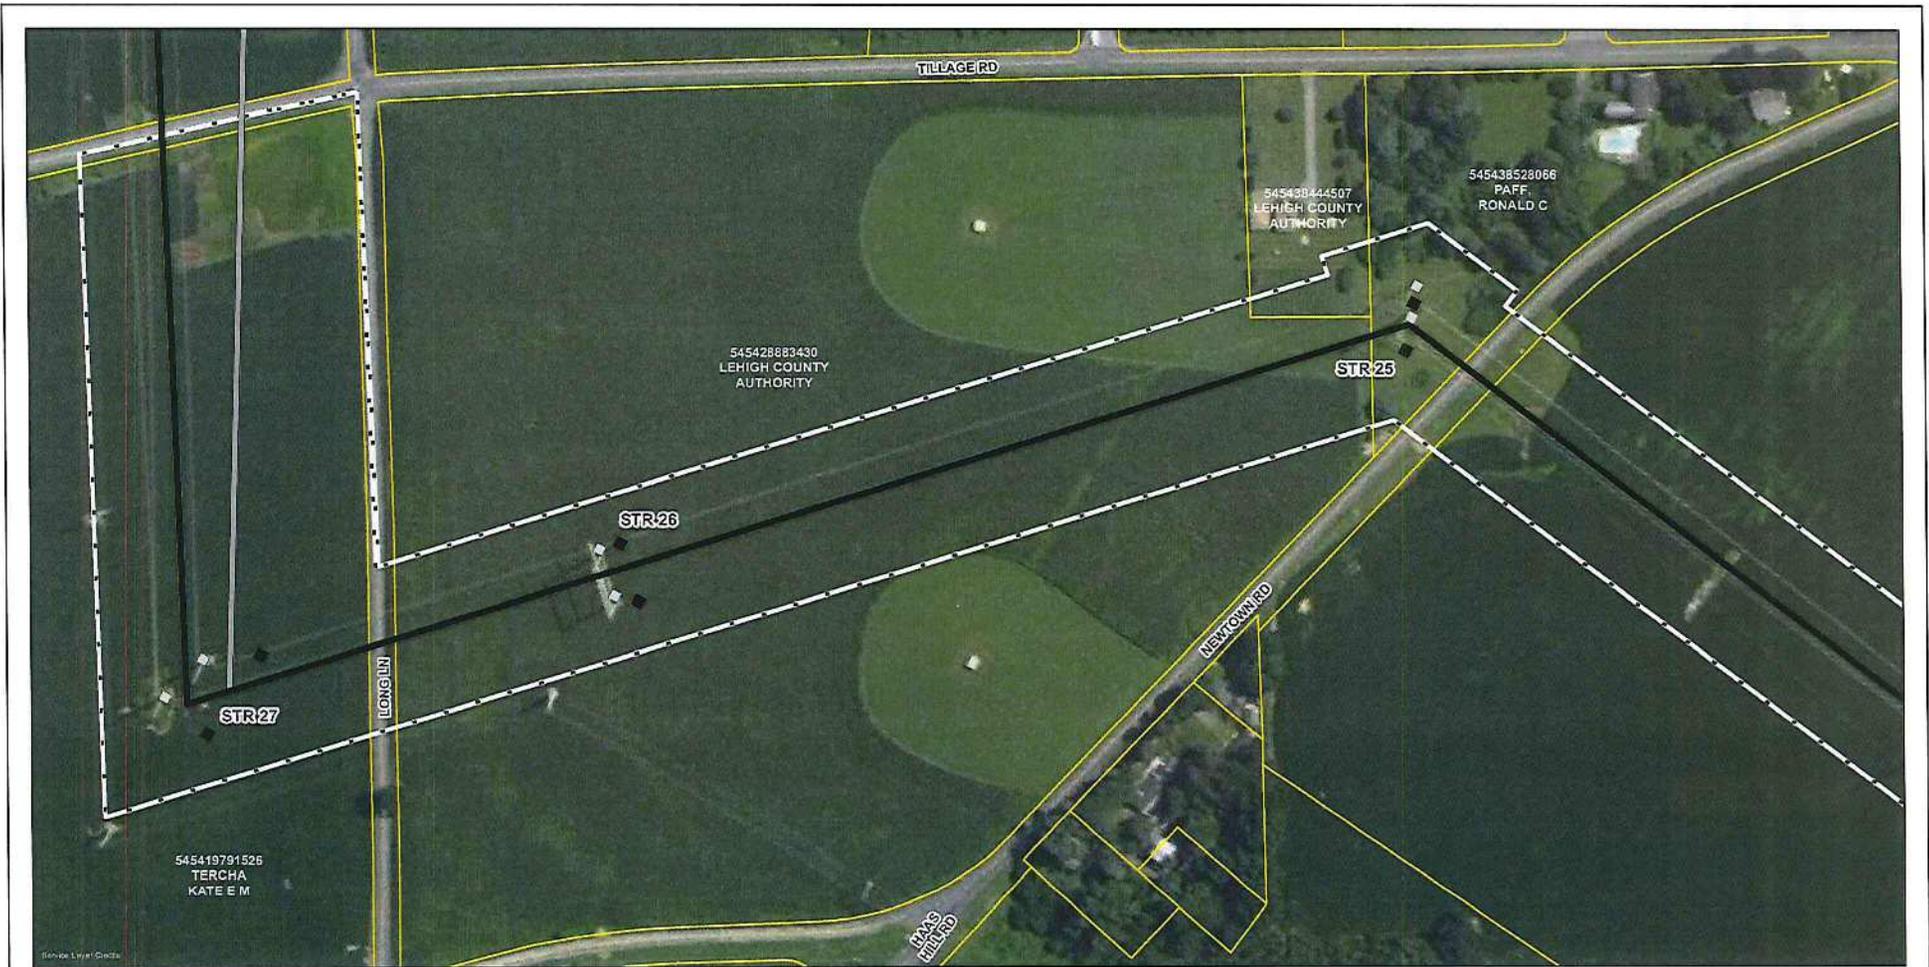
Letter of Notification of PPL Electric Utilities Corporation,
Filed Pursuant to 52 Pa. Code Chapter 57 Subchapter G, for Approval to
Rebuild the Existing Breinigsville-Alburtis 500 kV Transmission Line in Lehigh County, Pennsylvania
Docket No. A-2017-2635709

Bureau of Technical Utility Services Data Requests
(Response dated 01/22/18)

A-2 Reference the LON, Attachment 3, Figure 3-1 showing the proposed Breinigsville-Alburtis 500 kV rebuild project between structure 26 and structure 27. Please explain how this section of the proposed line will remain within the existing 200 feet right-of-way. In particular, on the Tillage Rd side of the ROW near Long Ln.

Response:

Attachment A-2 is an updated Figure 3-1 that shows how the alignment of the existing centerline coincides with the existing structures. The proposed lines will follow parallel alignments through this area and remain within the existing 200 feet right-of-way.



Legend

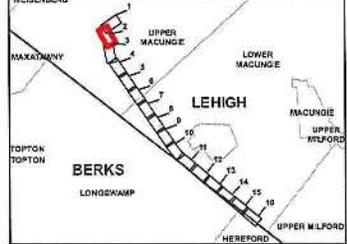
- Proposed Structure Locations
- Existing Structure Locations
- - - Existing PPL ROW
- - - Existing Transmission Line Centerline
- - - Minor Centerline Adjustment
- ▭ Parcel Boundary

Notes

- Existing Project Centerline and Existing Poles digitized from files received from PPL in June 2014.
- Proposed Pole locations digitized from files received from PPL in August 2017

NAD 1983 State Plane
 Pennsylvania North FIPS 3701
 Projection: Lambert Conformal Conic
 Linear Unit: US Foot

References:
 NAIP Imagery Basemap (2015)
 Lehigh Parcel Data (2017)



AECOM

**Figure 3-1: Aerial Overview Map
 Breinigsville-Alburtis
 500 kV Rebuild Project**

Extent Map 2 of 16
 Lehigh County, Pennsylvania

PPL Electric Utilities
 Allentown, Pennsylvania

Prepared by: MB	Checked by: JCV
Date: 11/15/2016	

Letter of Notification of PPL Electric Utilities Corporation,
Filed Pursuant to 52 Pa. Code Chapter 57 Subchapter G, for Approval to
Rebuild the Existing Breinigsville-Alburtis 500 kV Transmission Line in Lehigh County, Pennsylvania
Docket No. A-2017-2635709

Bureau of Technical Utility Services Data Requests
(Response dated 01/22/18)

- A-3 Reference the LON, Section II (B) describing the proposed project. Please state whether there are any previously approved cases associated with the Breinigsville-Alburtis 500 kV Transmission Line rebuild. If so, please provide their respective docket numbers and a brief description of the case.**

Response:

See Letter of Notification of PPL Electric Utilities Corporation, Filed Pursuant to 52 Pa. Code Chapter 57 Subchapter G, for Approval to Replace and Re-terminate Approximately 200 feet of the Existing Breinigsville-Alburtis 500 kV Transmission Line in Lower Macungie Township, Lehigh County, Pennsylvania, Docket No. A-2017-2618099 (Order entered Aug. 31, 2017) (approving the re-termination of the first span (approximately 200 feet) of the existing Breinigsville-Alburtis 500 kV Transmission Line at the Alburtis 500-230 kV Substation during previously scheduled outages at the the Alburtis 500-230 kV Substation).

See Letter of Notification of PPL Electric Utilities Corporation, Filed Pursuant to 52 Pa. Code Chapter 57 Subchapter G, for Approval to Construct and Relocate Transmission Line Connections Associated with the Proposed Breinigsville 500-138-69 kV Substation in Upper Macungie Township, Lehigh County, Pennsylvania, Docket No. A-2012-2312665 (Order entered Sept. 13, 2012) (approving (1) the re-routing of a segment of the existing AT&T Tap Line around the new Breinigsville Substation; (2) the splitting and re-terminating the existing Alburtis-Wescosville 500 kV Transmission Line into the new Breinigsville Substation; and (3) the constructing the new double-circuit Breinigsville-Wescosville Transmission Line to connect the relocated AT&T Tap Line with the new Breinigsville Substation).

See Petition of PPL Electric Utilities Corporation for a Finding that a Building to Shelter Control Equipment at the Breinigsville 500-138-69 kV Substation to be Constructed in Upper Macungie Township, Lehigh County, Pennsylvania is Reasonably Necessary for the Convenience or Welfare of the Public, Docket No. P-2012-2328001 (Order entered Dec. 20, 2012) (finding that a building to shelter control equipment at the proposed Breinigsville Substation is reasonably necessary for the convenience or welfare of the public and, therefore, exempt from any local zoning ordinance).

Letter of Notification of PPL Electric Utilities Corporation,
Filed Pursuant to 52 Pa. Code Chapter 57 Subchapter G, for Approval to
Rebuild the Existing Breinigsville-Alburtis 500 kV Transmission Line in Lehigh County, Pennsylvania
Docket No. A-2017-2635709

Bureau of Technical Utility Services Data Requests
(Response dated 01/22/18)

See Siting Application for certification of a route between Alburtis and Wescosville 500 kV Substations, Submitted 12/8/1978, Docket Number unknown, (Order entered 11/29/1979). The Alburtis – Wescosville Transmission Line was subsequently split into the Breinigsville – Alburtis and Breinigsville-Wescosville 500 kV Transmission Lines (see Docket No. A-2012-2312665 above).

VERIFICATION

I, DAVID J. BONENBERGER, being the VICE PRESIDENT-TRANSMISSION AND SUBSTATIONS at PPL Electric Utilities Corporation, hereby state that the facts above set forth are true and correct to the best of my knowledge, information and belief and that I expect PPL Electric Utilities Corporation to be able to prove the same at a hearing held in this matter. I understand that the statements herein are made subject to the penalties of 18 Pa.C.S. § 4904 relating to unsworn falsification to authorities.

Date: 1/18/18

