



Tishekia E. Williams
Assistant General Counsel, Regulatory

411 Seventh Avenue
Mail drop 15-7
Pittsburgh, PA 15219

Tel: 412-393-1541
Fax: 412-393-5757
twilliams@duqlight.com

August 15, 2018

VIA ELECTRONIC FILING

Rosemary Chiavetta, Secretary
Pennsylvania Public Utility Commission
Commonwealth Keystone Building, 2nd Floor
400 North Street
Harrisburg, PA 17120

Re: Municipal Contract - Right of Way Agreement between Duquesne Light Company and
the Allegheny County Airport Authority
Docket No. U-2018-_____

Dear Secretary Chiavetta:

Enclosed for review and approval in accordance with Section 507 of the Public Utility Code, 66 Pa.C.S. § 507 and 52 Pa. Code § 3.101, is a Right of Way agreement dated July 30, 2018 between Duquesne Light Company and the Allegheny County Airport Authority. The Allegheny County Airport Authority granted to Duquesne Light Company a right of way on its property situated in Moon Township, Allegheny County. Duquesne Light Company is not providing monetary compensation for the right of way.

Should you have any questions regarding the enclosed right of way, please contact Mary Matthew at 412-393-8629.

Respectfully Submitted,

A handwritten signature in blue ink that reads "Tishekia E. Williams/exp".

Tishekia E. Williams
Attorney ID#208997

Enclosures
cc: Mary Matthew

LICENSE AGREEMENT

THIS LICENSE AGREEMENT (this "License") is made and entered into this 30th day of July, 2018, by and between THE ALLEGHENY COUNTY AIRPORT AUTHORITY, a municipal authority organized pursuant to the laws of the Commonwealth of Pennsylvania, having a mailing address P.O. Box 12370, Pittsburgh, PA 15231 (hereinafter called "ACAA") AND Duquesne Light Company, a Pennsylvania corporation with its principal office at 411 Seventh Avenue, Pittsburgh, PA 15230 (hereinafter called "DUQUESNE").

Witnesseth:

WHEREAS, pursuant to Paragraph 4.01, Authority's Right to Operate and Control, of the Airport Operation, Management and Transfer Agreement and Lease between Allegheny County, Pennsylvania (the "County") and the ACAA dated September 16, 1999 (the "Transfer Agreement"), ACAA has the right to grant licenses to third parties, and

WHEREAS, an overhead and underground electrical service system is being constructed in Moon Township, Pennsylvania for the 911th Airlift Wing, which is located on the Allegheny County Airport site; and

WHEREAS, in order to accommodate said overhead and underground electric service system construction project, ACAA requested DUQUESNE install and/or reinstall the "System", as such term is defined in Section 1 of this License. "); and

Whereas, ACAA desires to grant DUQUESNE a license to install the System; and

WHEREAS, DUQUESNE desires to accommodate ACAA's request,

NOW, THEREFORE, in consideration of good and valuable consideration, the receipt and adequacy the parties hereto acknowledge, and in consideration of the mutual covenants and agreements of the parties hereto, it is hereby agreed as follows:

1. ACAA does hereby grant to DUQUESNE, its successors and assigns, for as long as electrical power is needed at the location or locations to be served by the System, a license and right of way, upon, over, under, along, across and through ACAA land situate in Moon Township, Allegheny County, Pennsylvania, said license and right of way granted being for providing, transmitting and/or distributing electric and/or internal communications services for any and all purposes, along with the right, privilege and authority to erect, install, use, own, operate, maintain, repair, renew and finally remove an electric line, consisting of seven (7) poles (#371987, 371988, 371989, 371990, 371993, 372230 & 372231), six (6) anchors (attached to poles #371987, 371989, 371993 & 372231), 3-1/C 500AL wire, 1-DLM-5 pad mounted switchgear and 1-2000kva pad mounted transformer, facilities and apparatus relating thereto (the "System") belonging, upon, over, under, along, across and through Airport Property fronting on Cliff Mine Road, situate in Moon

Township, Allegheny County, Pennsylvania, and shown on DUQUESNE Drawing No. 432288-T1, attached hereto as Exhibit A (the "Property"). DUQUESNE shall also have the following rights: to trim or remove any trees or shrubbery which, at any time or times, may interfere or threaten to interfere with the erection, installation, use, operation, maintenance, repair, renewal or removal of the System; to enter upon the land at any time for such purposes; to permit others to attach crossarms, cables, wires and related apparatus, and to use the poles and apparatus erected hereunder; and to sell, assign, lease or otherwise transfer any or all of the rights hereunder.

2. The System shall be installed and maintained in compliance with all rules and regulations governing such installation and maintenance.

3. The final design and construction of the System that DUQUESNE plans for this License shall be subject to the review and approval of the Federal Aviation Administration in regard to the Airport runway system existing at the time of the execution of this Agreement.

4. A. This License is at all times subject to and in accordance with ACAA's reasonable security procedures and requirements with respect to the Property, and to ACAA's construction schedule for its own improvements on or to the Property, and provided that ACAA shall have the right to reasonably restrict DUQUESNE's exercise of rights hereunder in the event of changes to ACAA's safety or security rules or applicable federal or state law.

B. In addition, DUQUESNE shall provide forty-eight (48) hours prior notice to ACAA before entering the Property for the purposes of erecting the System or otherwise exercising the rights described herein. Notice shall be provided to ACAA Operations at (412) 472-5630. DUQUESNE shall also provide ACAA Operations with notice prior to performing routine maintenance or construction at the site. In the event of an emergency, notice should be given as soon as possible.

C. However, DUQUESNE's obligations (i) to provide notice before entering the Property and (ii) to abide by ACAA's reasonable security procedures, requirements and construction schedule shall terminate upon the sale, transfer, assignment, and/or conveyance of the Property to a private party for any reason.

5. DUQUESNE will perform all work under this agreement in a manner that will not affect the daily operation of the Airport.

6. All costs for installation of the System shall be paid for by the 911th Airlift Wing.

7. DUQUESNE agrees to indemnify ACAA to the extent of DUQUESNE's negligent acts or omissions and save harmless ACAA from all loss (including reasonable attorney's fees) resulting from injury, including death, and damage to ACAA employees, ACAA property, or to any person or property on or near the 911th Airlift Wing construction project, that arises out of, results from, or is directly caused by DUQUESNE or to the extent of the negligent acts or omissions of DUQUESNE's contractors, agents, employees or persons engaged by the DUQUESNE in placing, maintaining, operating, altering or removing the System.

8. DUQUESNE shall, at its own cost and expense, maintain in effect the insurance

required by ACAA as set forth on the Insurance Exhibit B attached hereto and made a part hereof. Prior to the execution of this License, and not less than fifteen (15) days prior to the expiration date of any policy of insurance required hereunder, DUQUESNE shall deliver to the Executive Director a Certificate or Certificates of Insurance issued by an insurance company or companies authorized to do business in Pennsylvania evidencing the insurance coverage required pursuant to this License, which Certificates shall recite such conditions that the policies cannot be canceled or changed in any manner without thirty (30) days prior written notice to the Executive Director.

9. Any prior right of way or similar agreement between ACAA and DUQUESNE relating to existing facilities or systems to be relocated as part of this project shall be deemed superseded by this Agreement to the extent of any conflict herewith.

10. This License may be terminated only if electric service has not been provided by DUQUESNE at the location or locations depicted on Exhibit A for one (1) year or more. Upon termination, all property rights shall revert to the ACAA (or to the County in the event the Transfer Agreement has expired).

11. In the event that the System installed pursuant to this License should require relocation, ACAA shall provide a new location for the System. All costs to relocate the System shall be the responsibility of DUQUESNE. DUQUESNE reserves the right to refuse to re-install any System if the new location provided by ACAA for the System is not reasonably calculated to minimize DUQUESNE's relocation costs.

12. ACAA hereby represents and warrants to DUQUESNE that in accordance with the terms of the Transfer Agreement, the ACAA has the right to enter into this Agreement and to grant the property rights granted to DUQUESNE hereunder and that the County will be bound by the terms hereof. In the event DUQUESNE should be required to remove or relocate its System because ACAA did not or does not have authority to grant the property rights hereunder, ACAA agrees to reimburse DUQUESNE for any and all costs associated with relocating and/or acquiring adequate property rights for the System.

13. ACAA hereby acknowledges that, notwithstanding DUQUESNE's presence therein, ACAA alone is responsible for the care and maintenance of any and all duct systems or transformer pads on or in the Property and, except as expressly provided in Section 7 hereof, nothing herein shall vest in DUQUESNE responsibility therefor.

14. This Agreement shall bind the parties hereto, their successors and assigns.

15. This Agreement and its performance shall be governed by the laws of the Commonwealth of Pennsylvania, except for its conflict of law provisions.

16. This Agreement shall not be interpreted to interfere with the statutory powers of the Pennsylvania Public Utility Commission.

17. DUQUESNE shall file an executed copy of this Agreement with the Pennsylvania

Public Utility Commission as required by Title 66, Section 507 of the Public Utility Code, and this Agreement shall become effective in accordance therewith.

IN WITNESS WHEREOF, the parties hereto have caused this instrument to be duly executed and Duquesne Light Company corporate seal hereunto affixed, duly attested, the day and year first above written.

ATTEST



ALLEGHENY COUNTY AIRPORT AUTHORITY
"ACAA"



Christina A. Cassotis,
Chief Executive Officer

APPROVED



Eric Sprys,
Chief Commercial Officer

This agreement between Allegheny County Airport Authority and Duquesne Light Company was duly authorized on 07/20/2018 at Approval No. 449-18

ATTEST:

DUQUESNE LIGHT COMPANY
"DUQUESNE"


Assistant Secretary

By: 


COMMONWEALTH OF PENNSYLVANIA)
) SS:
COUNTY OF ALLEGHENY)

On this 23rd day of July, 2018, before me, the Undersigned officer, a Notary Public in and for the Commonwealth and County, Personally appeared Christina A. Cassotis, Chief Executive Officer of Allegheny County Airport Authority, a municipal authority, and as such Chief Executive Officer, being authorized to do so, executed the foregoing Agreement for the purposes therein contained.

IN WITNESS WHEREOF I have set my hand and official seal.

[Handwritten signature of Edward D. Moeller]

Notary Public

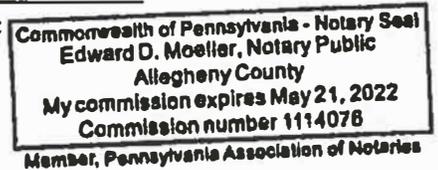

CERTIFICATE OF RESIDENCE

I, Mary Matthew, ROW Agent of Duquesne Light Company, do hereby certify that Duquesne Light Company's business address is 411 Seventh Avenue, Pittsburgh, PA 15219.

Witness my hand this 30th day of July, 2018.

[Handwritten signature of Mary Matthew]

UPON FILING, PLEASE MAIL TO:

Duquesne Light Company
Attention: Right of Way Department
2841 New Beaver Avenue
Mail Drop N3-AM
Pittsburgh, PA 15233

EXHIBIT B

INSURANCE

A. DUQUESNE shall, at its own cost and expense, maintain in effect the following insurance at all times during the period commencing as of the date of execution of this License, as shown on page 1 hereof, to the date of the cessation of this License, including any extension or renewal hereof. The Authority and its Board of Directors shall be named as additional insureds with the right of notice in the policy.

(1) Comprehensive General Liability insurance with ACAA and its Executive Director, officers and employees as a named additional insured with a combined single limit of not less than FIVE MILLION DOLLARS (\$5,000,000) for injury to persons or damage to property.

(2) Automobile Liability insurance covering any owned or non-owned automobiles, trucks, and vans used, parked, or to be used or parked in, on or about the field areas of the airport or used or to be used in connection with any matter pertaining to this License, with a combined single limit of not less than FIVE MILLION DOLLARS (\$5,000,000) for personal injury or damage to property.

(3) Workmen's Compensation Insurance as required by law. If the DUQUESNE/Tenant is not required by law to provide coverage, the reasons should be stated in a letter to ACAA.

(4) Such other insurance, with such provisions, and in such amounts as the Executive Director, from time to time, in his discretion may require.

B. The Executive Director may, in his discretion, waive or modify any of the foregoing insurance requirements or portions thereof at his discretion.

C. Neither party hereto shall be liable to the other party or to the insurer of such other party claiming by way of subrogation through or under such other party with respect to any loss or damage to the extent that such other party shall be reimbursed or has the right to be reimbursed out of the party's property insurance coverage carried for such other party's protection with respect to such loss or damage. The provisions of this Exhibit B shall apply only to the extent permitted by provisions of the insurance policy in question.



D. Notwithstanding any other provision of this License, DUQUESNE shall not do or permit to be done anything, either by act or omission, which shall cause cancellation of any ACAA policy of property insurance for the premises or any other part of the Airport. Further, if DUQUESNE or any employee, agent, licensee, invitee, contractor, subcontractor, or approved or unapproved subcontractor of DUQUESNE shall do or permit to be done anything, whether by act or failure to act which shall cause an increase in the premiums for ACAA property insurance for the premises or any part thereof, then DUQUESNE shall pay the amount of such increase, pursuant to invoices from ACAA, or purchase additional insurance for ACAA with terms satisfactory to ACAA.



DESIGN PA ONECALL SERIAL NUMBER ALONG CLIFF MINE RD.: 2017-243-3450 ALONG LONGBERCH DR.: 2017-243-3442 MATERIAL MEMOS MATERIAL ORDER ON HOLD PER MGR. ACCOUNT REP.

CONDUIT AND ELBOW NOTES

1. DUKESITE LIGHT CO. REPRESENTATIVE TO INSPECT CONDUIT PRIOR TO BACKFILLING.
2. CONDUIT TO BE 5" PVC AND 5" RIGID STEEL, NOT DIPPED GALVANIZED (WHERE SPECIFIED) INSTALLED IN ACCORDANCE WITH DUKESITE LIGHT SPECIFICATION 7500002 REV. C
3. ALL FIELD SPACERS LIMITED TO A MAXIMUM OF 25' SPACES.
4. ALL VERTICAL ELBOWS, UNLESS OTHERWISE STATED, (H) TRANSFORMER SWITCH, A TERMINAL POLES TO BE RIGID STEEL, 30" HEIGHT, 3/4" THICK, NOT DIPPED GALVANIZED (EXCLUDING SURFACES W/ROOFED AT BOTH ENDS WITHIN, COMPLIANCE WITH A 40 MIL PVC COATING APPLIED INTERNALLY. DRILL FOUR 1/2" DIAMETER HOLES ON 2" CENTERS AT THE LOW POINT OF EACH ELBOW AND REMOVE ALL INTERNAL BURRS. INSTALL AN 18" X 18" X 1/2" DEEP FRENCH DRAIN EXTENDING ALL VERTICAL ELBOWS WITH 5" 40 MIL PVC COATED RIGID STEEL, EXTENDING UP TERMINAL POLES TO THE LOCATION ON THE POLE 6" ABOVE FINAL GRADE AND WITHIN THE SWITCH AND TRANSFORMER PADS AS DETAILLED IN THEIR RESPECTIVE DRAWINGS. CAP ALL DRAIN CONDUITS.
5. INSTALL AN 18" GALV. WELON COUS HAVING A MINIMUM BREAKING STRENGTH OF 170 LBS. IN EACH CONDUIT RUN.
6. MAINTAIN MINIMUM 3"-6" (MIN) COVER TO TOP OF DUCT BANK.
7. ALL CONDUITS AND PADS ARE TO BE PURCHASED, INSTALLED AND MAINTAINED BY THE CUSTOMER.

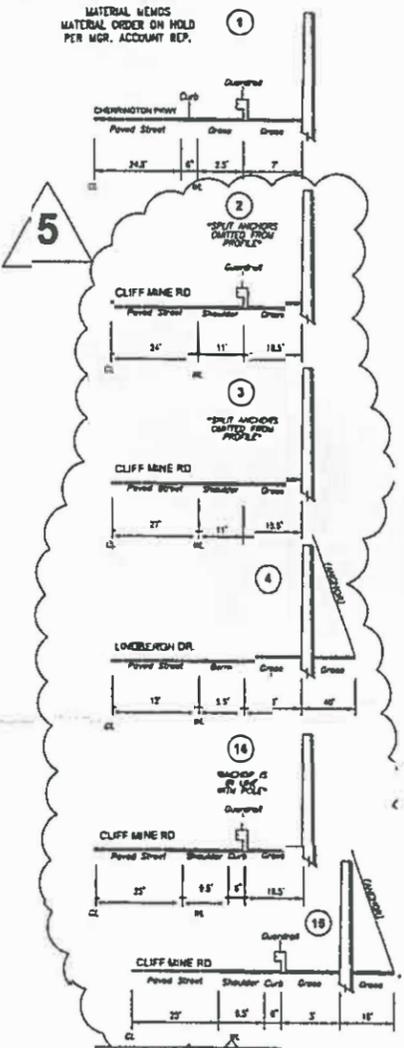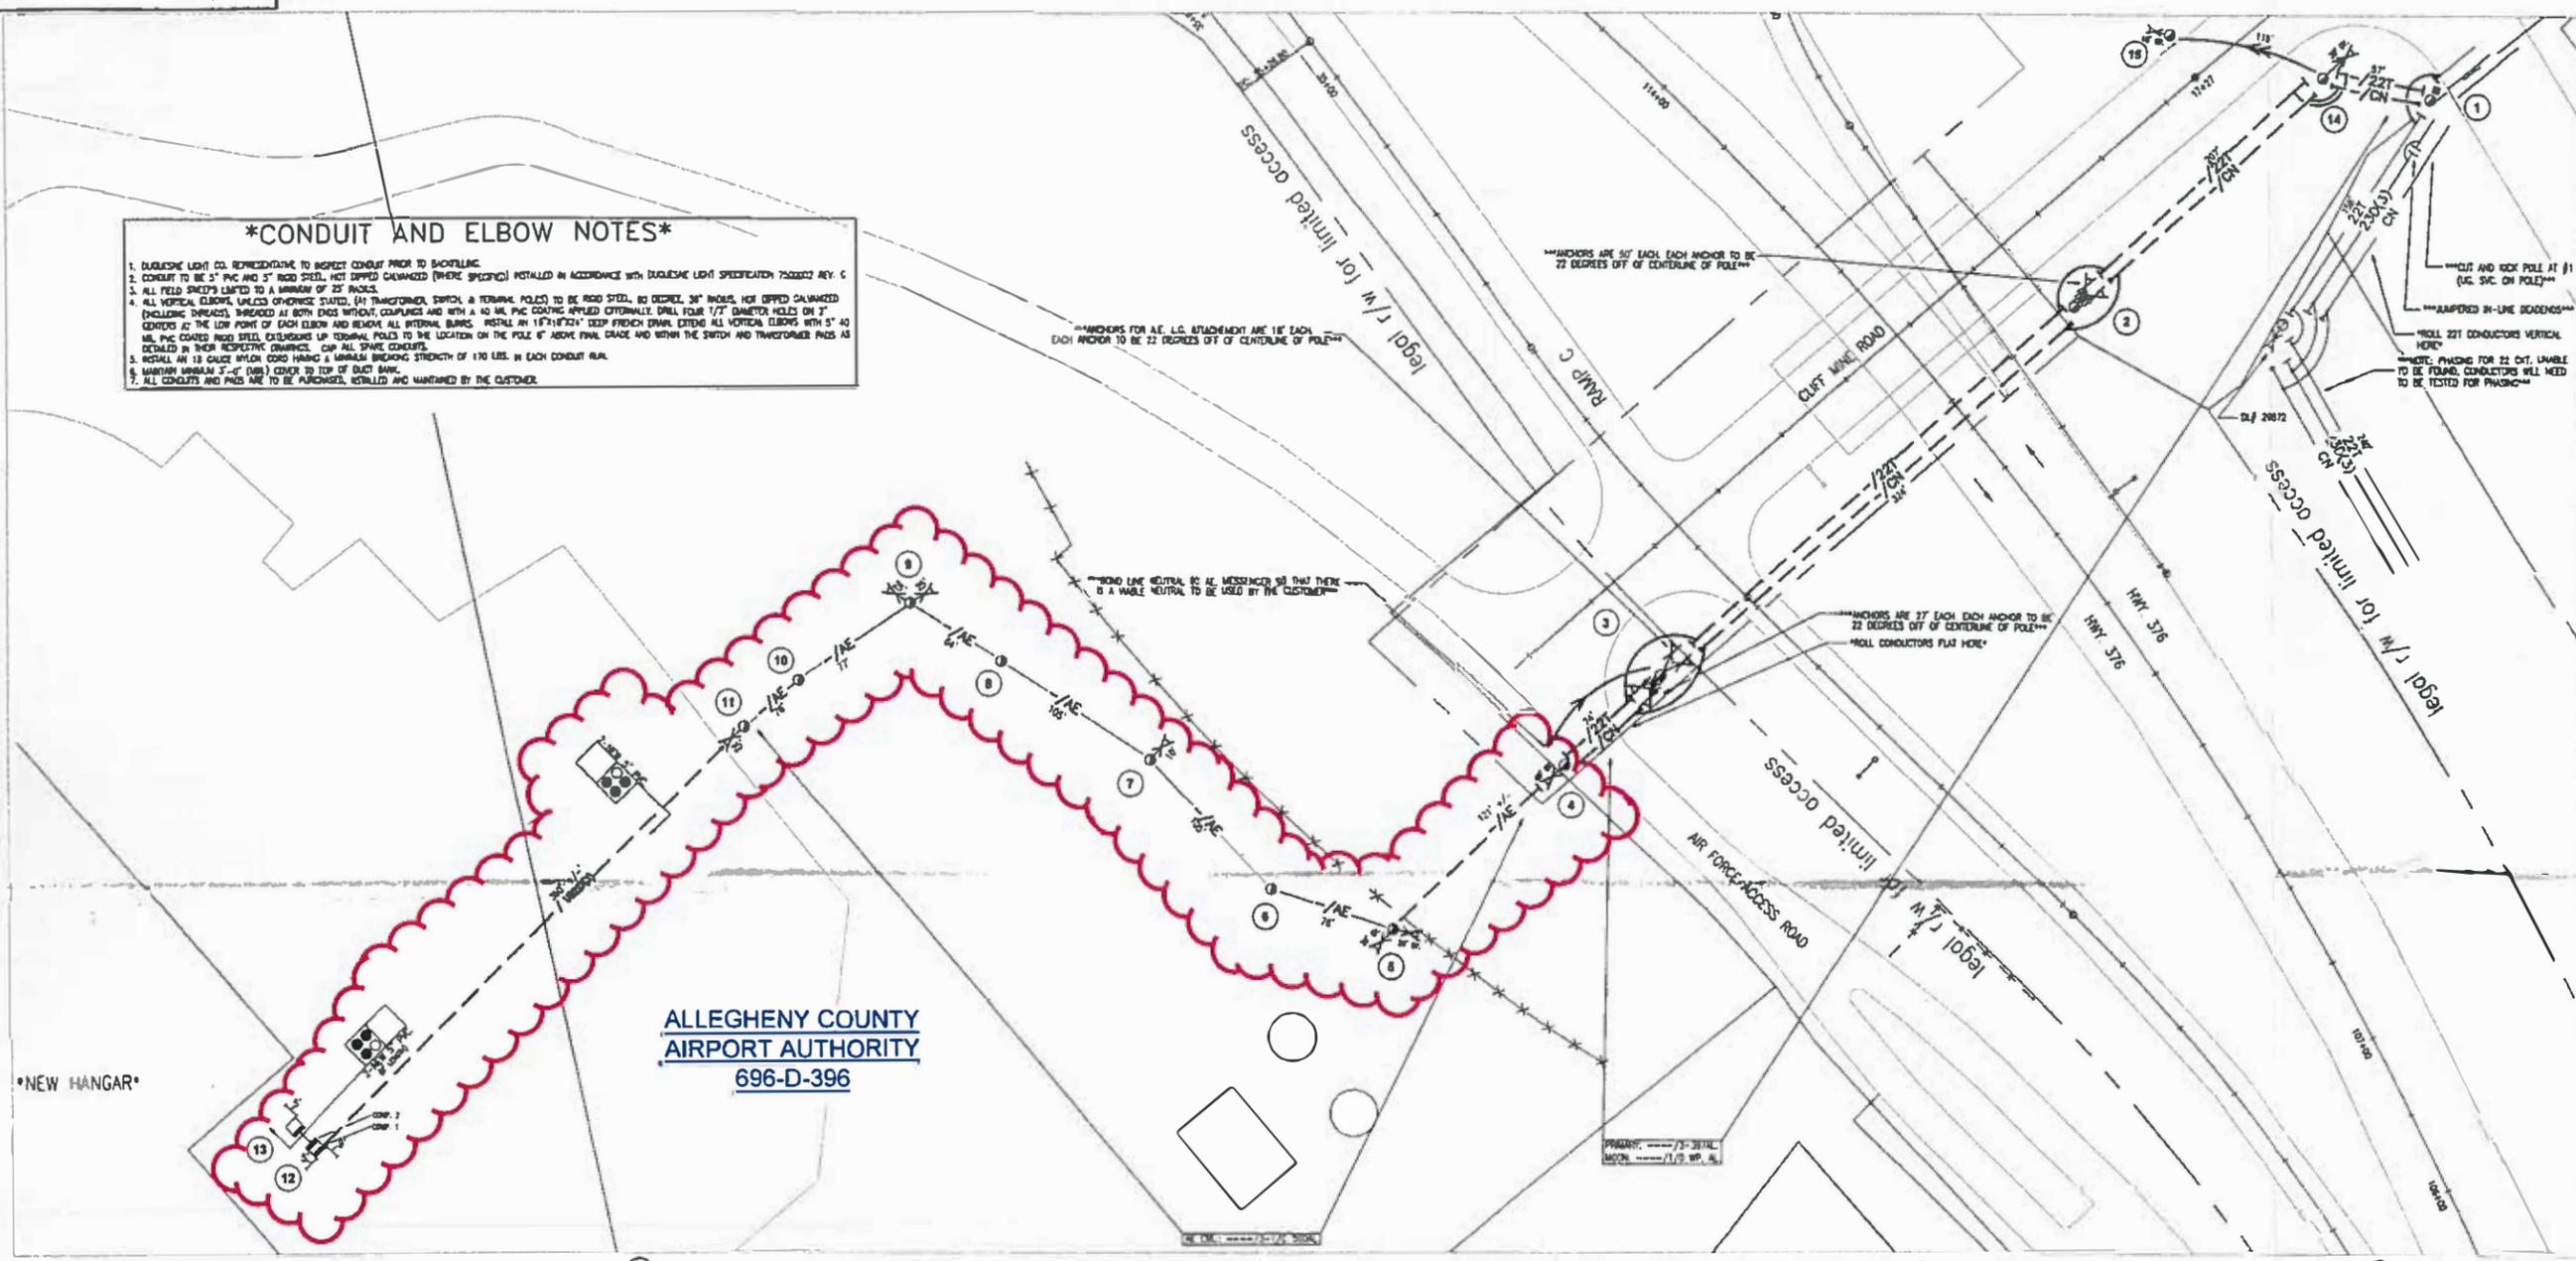

ALLEGHENY COUNTY
 AIRPORT AUTHORITY
 696-D-396

CONDUIT KEY*

- INSTALL 3-1/2" 750 CU. EPR. & 4/0 CU. +/- (CKT. 22849)
- EMPTY CONDUIT
- ⊗ OCCUPIED CONDUIT

DL#371984	DL#371985	DL#371986	DL#371987	DL#371988	DL#371989	DL#371990	DL#371993
60' CL 2 (8) Z2T D.E. INSULATORS (3) Z2T SIDE STATION POSTS (2) CN BKT 'S (4) 18M Z2T A.G.'S (27' GUY LENGTH) (2) 18M SEC. A.G. (40' GUY LENGTH) (4) DHLX ANCHORS	60' CL 2 (8) Z2T D.E. INSULATORS (3) Z2T SIDE STATION POSTS (2) CN BKT 'S (4) 18M Z2T A.G.'S (27' GUY LENGTH) (2) 18M SEC. A.G.'S (17' GUY LENGTH) (2) 18M A.E. A.G.'S (18' GUY LENGTH) (8) DHLX ANCHORS	55' CL 2 (1) Z2T 3Ø D.E. (OH-7-8) (1) Z2T 3Ø T.P. ASSEM. (OH-15-18) (1) CN BKT (1) AE D.E. ATTACHMENT (AE-14-2A) (1) 18M Z2T A.G. (1) 18M A.E. L.G. (1) DHLX ANCHOR	40' CL 3 (1) AE CORNER ATTACHMENT (AE-14-2C) (2) 18M A.E. A.G.'S (2) DHLX ANCHORS	45' CL 2 (1) AE CORNER ATTACHMENT (AE-14-2C) *CUT 5' OFF TOP*	40' CL 3 (1) AE TANGENT ATTACHMENT (AE-14-2B) (1) 18M A.E. A.G. (1) DHLX ANCHOR	40' CL 3 (1) AE TANGENT ATTACHMENT (AE-14-2B)	40' CL 3 (1) AE CORNER ATTACHMENT (AE-14-2C) (2) 18M A.E. A.G.'S (2) DHLX ANCHORS
DL #349086	DL#372230	DL#372231	DL#372232	DL#372233	DL#372233	DL#372303	
50' CL 2 3Ø Z2T DXA 9' 3Ø DXA. (23kV) (1) 13.2kV 120/240V. 1Ø, 15kVA TRANSFORMER (1) CN BKT.	60' CL 2 3-WAY VERTICAL CORNER (Z2T) (OH-7-9.1) 9' 3Ø DXA. (23kV) (OH-7-28) (1) 13.2kV, 120/240V. 1Ø, 25kVA TRANSFORMER (OH-10-44) (2) CN. BKT.'S	40' CL 3 (1) AE. D.E. ATTACHMENT (AE-14-2C) (1) 3-1/2" 5000AL. EPR. TO 3-1/2" 750CU. EPR AERIAL SPLICES (1) 18M A.E. A.G. (1) DHLX ANCHOR	(1) DLM-5 PAD MOUNTED SWITCHGEAR ENCLOSURE (SW. #8263, 3-ØE, TCC-119 FUSE)	(1) 2000KVA, 22.9-277/480V. 3Ø. SUBTRANSMISSION. PAD MOUNTED TRANSFORMER	60' CL 2 2-WAY VERTICAL CORNER (Z2T) (OH-7-9) (2) CN BKT 'S (2) 18M Z2T A.G.'S (2) 18M Z2T L.G.'S (1) DHLX ANCHOR	30' CL 1 (1) 18M SEC. A.G (1) DHLX ANCHOR	

RELATED DRAWINGS

- 432288-T2 - DETAIL FOR DLM-5 PAD MOUNTED SWITCHGEAR
- 432288-T3 - DETAIL FOR 3Ø PAD MOUNTED TRANSFORMER
- 432288-T4 - CIRCUIT MAP REVISIONS

SPEC. 7500002 REV. C - STANDARD CONSTRUCTION SPECIFICATION FOR DLCO ELECTRICAL DUCTBANKS
 SPEC. 7500004 REV. C - STANDARD CONSTRUCTION SPECIFICATION FOR DLCO PRECAST CONCRETE MANHOLES

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

Duquesne Light Our Energy...Your Power
 T&D Engineering

911TH AIRLIFT WING - NEW HANGER SERVICE
 2475 DEFENSE AVE. MOON TWP.
 DLCO TO EXTEND PRIMARY, PULL CABLE, INSTALL SWITCHGEAR AND PAD MOUNTED TRANSFORMER FOR REVISED CUSTOMER SERVICE

SCALE	DATE	BY	CHKD
MFP	9/15/17	J. STOVER	9/18/17
N.T.S.		MFH	9/18/17

A	16-005	432288-T1	5
---	--------	-----------	---