

Ward L. Smith  
Assistant General Counsel  
2301 Market Street / S23-1  
Philadelphia, PA 19103

Direct Dial: 215-841-6863

July 22, 2019

Rosemary Chiavetta, Secretary  
Pennsylvania Public Utility Commission  
Commonwealth Keystone Building  
400 North Street, 2<sup>nd</sup> Floor  
Harrisburg, PA 17120

**Re: Letter of Notification of PECO Energy Company for Approval to Reconductor its  
130-20 kV Transmission Line in Falls Township and Bristol Township, Pennsylvania,  
Docket No. A-2019-3011226**

Dear Secretary Chiavetta:

Enclosed for filing are PECO Energy Company's Public Version of its Answers to Staff Data Requests. A Verification Statement and Certificate of Service are enclosed. Materials that have been designated as Confidential are not included in this Public Version.

Sincerely,



Ward L. Smith  
Assistant General Counsel

Enclosures  
WLS/az

RECEIVED

JUL 23 2019

PA PUBLIC UTILITY COMMISSION  
SECRETARY'S BUREAU

**BEFORE THE  
PENNSYLVANIA PUBLIC UTILITY COMMISSION**

**VERIFICATION**

I, Douglas Dale, hereby declare that I am Manager, Transmission Planning for PECO Energy Company; that as such I am authorized to make this verification on behalf of PECO Energy Company; that the facts sets forth in the following Answers to Staff Data Requests are true to the best of my knowledge, information and belief, and that I make this verification subject to the penalties of 18 Pa. C.S. § 4904 pertaining to false statements to authorities.

Date: July 22, 2019



Douglas Dale  
Manger, Transmission Planning  
PECO Energy Company

**RECEIVED**  
JUL 23 2019  
PA PUBLIC UTILITY COMMISSION  
SECRETARY'S BUREAU

**BEFORE THE  
PENNSYLVANIA PUBLIC UTILITY COMMISSION**

**Letter of Notification of PECO Energy** :  
**Company For Approval to Reconductor** : **DOCKET NO. A-2019-3011226**  
**its 130-20 Transmission Line in Falls** :  
**Township and Bristol Township,** :  
**Pennsylvania** :

**REVISED CERTIFICATE OF SERVICE**

I, Ward L. Smith, hereby certify that I have this day served a true and correct copy of PECO's Answers to Staff Data Requests upon the following persons, in the manner indicated, in accordance with the requirements of 52 Pa. Code Sections 1.54 and 57.74.

**VIA OVERNIGHT MAIL**

Office of Consumer Advocate  
555 Walnut Street  
5<sup>th</sup> Floor Forum Place  
Harrisburg, PA 17101-1923

PA Office of Small Business Advocate  
300 N. Second Street, Suite 202  
Harrisburg, PA 17101

Craig Bowen  
Bristol Township Council President  
2501 Bath Road  
Bristol, PA 19007-2150

Bureau of Investigation  
Pennsylvania Public Utility Commission  
Commonwealth Keystone Building  
2nd Floor, F West  
Harrisburg, PA 17101

William J. McCauley, III  
Bristol Township Manager  
2501 Bath Road  
Bristol, PA 19007-2150

Tom Scott  
Bristol Township Director of Building,  
Planning & Zoning  
Bristol Township Manager  
2501 Bath Road  
Bristol, PA 19007-2150

Peter Gray  
Township Manager, Falls Township  
Municipal Bldg.  
188 Lincoln Highway  
Fairless Hills, PA 19130

Tom Bennett  
Chief Code Enforcement Officer & Zoning  
Officer, Falls Township  
188 Lincoln Highway  
Fairless Hills, PA 19130

Secretary, Department of Transportation  
Keystone Building  
400 North Street, Fifth Floor  
Harrisburg, PA 17120

Brian Hessenthaler  
Chief Operating Officer  
Bucks County  
55 East Court Street, 5<sup>th</sup> Floor  
Doylestown, PA 18901


Robert G. Loughery  
Commission Chairman  
Bucks County  
55 East Court Street  
Doylestown, PA 18901

Robert Harvie  
Chair, Falls Township Board of  
Supervisors  
Municipal Bldg.  
188 Lincoln Highway  
Fairless Hills, PA 19130

Department of Environmental Protection  
Rachel Carson State Office Building  
400 Market Street  
Harrisburg, PA 17101

Chairman, Historical and Museum  
Commission  
State Museum Building  
300 North Street  
Harrisburg, PA 17120

Edward Kisselback, Jr.  
Chairman  
Bucks County Planning Commission  
1260 Almhouse Road  
Doylestown, PA 18901



Ward L. Smith  
Assistant General Counsel  
PECO Energy Company,  
2301 Market Street, S23-1  
Philadelphia, PA 19101-8699  
Phone: 215.841.6863  
E-mail: [ward.smith@exeloncorp.com](mailto:ward.smith@exeloncorp.com)

Date: July 22, 2019

RECEIVED

JUL 23 2019

PA PUBLIC UTILITY COMMISSION  
SECRETARY'S BUREAU

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

A-1 Reference the Letter of Notification, Section 3. Please explain where the 130-20 line extends to.

PECO Answer to Staff Data Request A-1:

The 130-20 line extends from PECO's Emilie substation located on Mill Creek Parkway to PECO's Falls substation located on Old Bristol Pike in Falls Township PA.

**RECEIVED**  
JUL 23 2019  
PA PUBLIC UTILITY COMMISSION  
SECRETARY'S BUREAU

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

A-2 Reference the Letter of Notification, Section 4. Please explain when the violation was identified (e.g. 2018 RTEP).

PECO Answer to Staff Data Request A-2:

PJM was notified of the request to deactivate Mercer #1 and #2 on October 5, 2016. At the December 15, 2016 PJM TEAC meeting, PJM presented its analysis of the requested violation and concluded that, once the generating units were retired, the Emilie-Falls line would be loaded to over 120% of its rated capacity in two outage contingencies. The relevant pages of the December 15, 2016 TEAC Presentation are attached as Exhibit A-2.

The Mercer units were retired on June 1, 2017. Although PJM has developed interim operating measures to mitigate the effects of the deactivation until the upgrade to 130-20 is completed, the violation exists today. Consequently, this project is designated as b2774 in PJMs RTEP database.

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

A-3 Reference the Letter of Notification, Section 4. Please explain when the Mercer #1 & #2 generators will be deactivated.

PECO Answer to Staff Data Request A-3:

The Mercer #1 and #2 units were retired on 6/1/2017.

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

A-4 Reference the Letter of Notification, Section 4. Please explain when the NERC violations will occur (e.g. model year).

PECO Answer to Staff Data Request A-4:

The violation exists today. PJM has developed interim operating measures to mitigate the effects of the deactivation until the upgrade to the 130-20 line is complete.

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

A-5 Reference the Letter of Notification, Section 9. The estimated project cost is not consistent with the costs listed by PJM. Please explain.

PECO Answer to Staff Data Request A-5: The estimated project cost that is reflected in PJM data is based upon preliminary cost data provided to PJM by PECO, based upon a Phase I cost estimate. After PECO was assigned RTEP project b2774, PECO performed a more detailed (Phase II) cost analysis. The project will occur in a residential neighborhood and some local residents have engaged in secondary uses of PECO's right-of-way such as fences, gardens, etc.; the Phase II cost analysis includes costs to avoid or mitigate the effect of this project on such local uses of the right-of-way.

Because this is an RTEP project, PECO was not required to resubmit the new cost estimate to PJM.

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

A-6 Reference the Letter of Notification, Section 9. Please state the name of the individual or entity that will pay for the proposed project.

PECO Answer to Staff Data Request A-6:

The cost of the 130-20 line upgrade project will be paid by PECO.

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

A-7 Reference the Letter of Notification, Section 16. Please provide a certificate of service for Bucks County and ensure that all appropriate landowners have been served.

PECO Answer to Staff Data Request A-7.

A Supplemental Certificate of Service reflecting service to Bucks County is attached as Attachment A-7-1.

PECO previously communicated with each of the approximately 300 residents whose properties abut this transmission right-of-way, providing them with information about the project. In addition, pursuant to 52 Pa. Code 57.74 (c) (iv), PECO served a "notice of filing and map of suitable detail showing the proposed route of the proposed facility," by registered or certified mail, on each of those approximately 300 residents. A copy of the notice and map are attached to both the Public and Confidential Versions of this Answer as Exhibit A-7-2. In addition, the Confidential Version of Exhibit A-7-2 includes a list of the mailing address of each of the local residents on whom this notice and map was served. Because this list includes personally-identifying information (addresses) for its customers, PECO asks that the address list be treated as Confidential and not be placed in the public file.

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

A-8 Reference the Letter of Notification, Attachment Q3. Please provide an aerial map depicting the parcels and landowners whose property the proposed project will traverse.

PECO Answer to Staff Data Request A-8:

Please see Exhibit A-8.

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

**EXHIBIT A-1: December 15, 2016 PJM Presentation**



# Generation Deactivation Notification Update



## Deactivation Status

Unit(s)	Transmission Zone	Requested Deactivation Date	PJM Reliability Status
Columbia Dam Hydroelectric Project (500 kW)	JCPL	11/18/2016	Reliability analysis complete. No impacts identified.
Sammis Units 1 - 4 (668.6 MW)	ATSI	05/31/2020	Reliability analysis complete. Impacts Identified
Bay Shore Unit 1 (136 MW)	ATSI	10/01/2020	Reliability analysis complete. Impacts Identified
Hudson Unit 2 (617.9 MW)	PSE&G	6/1/2017	Reliability analysis complete. Impacts Identified
Mercer Unit 1 (321 MW)	PSE&G	6/1/2017	Reliability analysis complete. Impacts Identified



## Deactivation Status


Unit(s)	Transmission Zone	Requested Deactivation Date	PJM Reliability Status
Mercer Unit 2 (320.3 MW)	PSE&G	6/1/2017	Reliability analysis complete. Impacts Identified
Crane Unit 1 (190 MW)	BGE	6/1/2018	Reliability analysis underway
Crane Unit 2 (195 MW)	BGE	6/1/2018	Reliability analysis underway
Crane Unit 3 (14 MW)	BGE	11/18/2018	Reliability analysis underway
Roanoke Valley Unit 1 (165 MW)	DOM	3/1/2017	Reliability analysis underway
Roanoke Valley Unit 2 (44 MW)	DOM	3/1/2017	Reliability analysis underway





# PECO Transmission Zone

- Generator Deliverability Outage:
- Emilie – Falls 138 kV line (PECO) is loaded to 124.38% of its emergency rating of 248 MVA for the single contingency loss of the Emilie to Neshaminy 138 kV line (~130-25/\* \$BUCKS \$ 130-25 \$ L')
- Immediate Need
  - Due to the timing of the need for the reinforcement an RTEP proposal window is infeasible
- Alternatives Considered
  - Due to the immediate need of the project no alternatives were considered
- New Baseline Upgrade (b2774)- Reconductor the Emilie - Falls 138 kV line, and replace station cable and relay
- Construction Designation
  - Due to the immediate need, the local Transmission Owner will be the Designated Entity
- Cost estimate (b2774): \$4.5M
- Required IS Date: 6/1/2017
- Projected IS Date: 12/15/2019

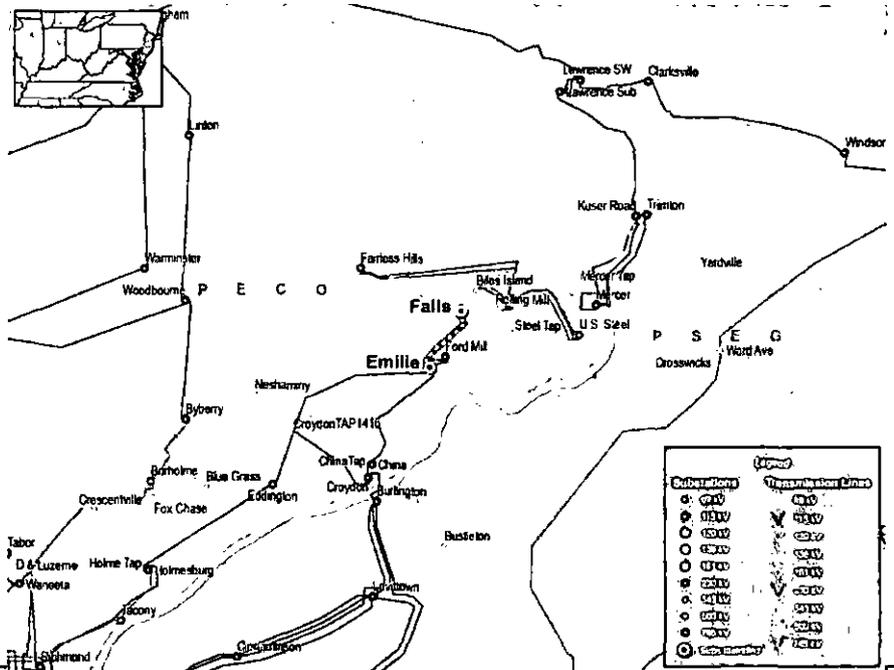


Deactivation – Mercer Unit 1&2



# PECO Transmission Zone

- Generator Deliverability Outage:
- Emilie – Falls 138 kV line (PECO) is loaded to 122.97% of its emergency rating of 248 MVA for the breaker failure contingency loss of the Neshaminy 138 kV bus ('NESHANEW' \$ BUCKS \$ NESHANEW \$ STBK').
- Immediate Need
  - Due to the timing of the need for the reinforcement an RTEP proposal window is infeasible
- Alternatives Considered
  - Due to the immediate need of the project no alternatives were considered
- New Baseline Upgrade (b2774)- Reconductor the Emilie - Falls 138 kV line, and replace station cable and relay
- Construction Designation
  - Due to the immediate need, the local Transmission Owner will be the Designated Entity
- Cost estimate (b2774): \$4.5M
- Required IS Date: 6/1/2017
- Projected IS Date: 12/15/2019

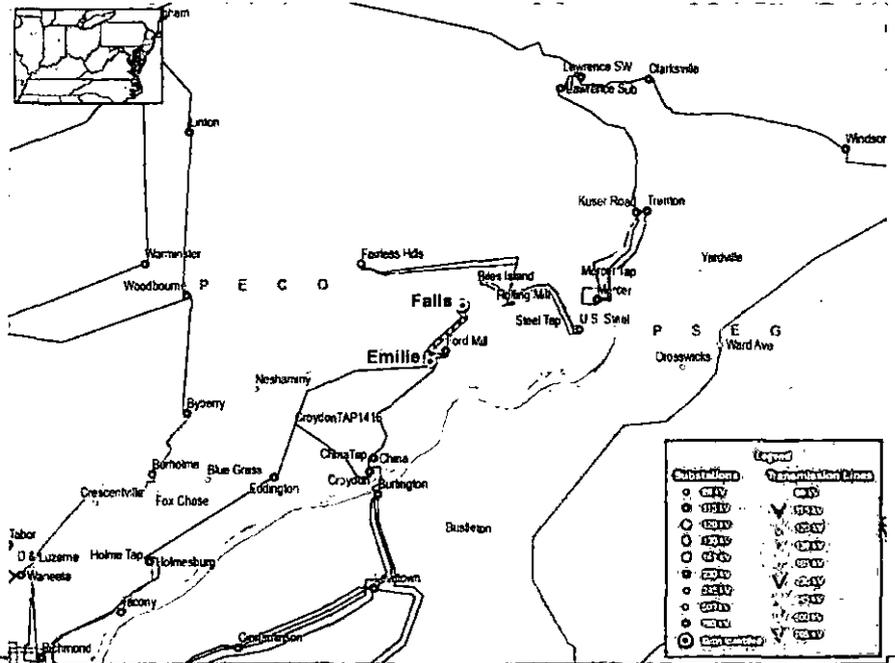

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

**EXHIBIT A-7-1: SUPPLEMENTAL CERTIFICATE OF SERVICE**



**PENNSYLVANIA**  
PUBLIC UTILITY COMMISSION

CONSUMERINFO UTILITY&INDUSTRY FILING&RESOURCES ABOUTPUC CONTACTUS

[Log Off eFiling](#) | [Contact Us](#) | [Search](#)

- [My Filings](#)
- [New Filing](#)
- [Modify Account](#)
- [POR Search](#)
- [eService Directory](#)
- [Subscriptions](#)
- [Technical Assistance](#)
- [eFiling FAQs](#)
- [Log Off](#)

## eFiling Successfully Transmitted

Your filing has been electronically received. Upon review of the filing for conformity with the Commission's filing requirements, a notice will be issued acknowledging acceptance or rejection (with reason) of the filing. The matter will receive the attention of the Commission and you will be advised if any further action is required on your part.

The date filed on will be the current day if the filing occurs on a business day before or at 4:30 p.m. (EST). It will be the next business day if the filing occurs after 4:30 p.m. (EST) or on weekends or holidays.

**Print this page for your records.**



eFiling Confirmation	
Docket Number:	A-2019-3011226
Description:	Letter of Notification of PECO Energy Company for Approval to Reconductor its 130-20 kv Transmission Line in Falls Township and Bristol Township, PA
Transmission Date:	7/22/2019 1:49:25 PM
Filed On:	7/22/2019 1:49:25 PM
eFiling Confirmation Number:	1813124

### Uploaded File List

File Name	Document Class	Document Type
Public Version of LON Filing.pdf	Other Filing	Certificate of Service

For filings exceeding 250 pages, the PUC is requiring that filers submit one paper copy to the Secretary's Bureau within three business days of submitting the electronic filing online. Please mail the paper copy along with copy of this confirmation page to Secretary, Pennsylvania Public Utility Commission, 400 North Street, Harrisburg, PA 17120 a copy of the filing



An Exelon Company

Ward L. Smith  
Assistant General Counsel  
2301 Market Street / S23-1  
Philadelphia, PA 19103

Direct Dial: 215-841-6863

July 22, 2019

Rosemary Chiavetta, Secretary  
Pennsylvania Public Utility Commission  
Commonwealth Keystone Building  
400 North Street, 2<sup>nd</sup> Floor  
Harrisburg, PA 17120

**Re: Letter of Notification of PECO Energy Company for Approval to Reconductor its  
130-20 kV Transmission Line in Falls Township and Bristol Township, Pennsylvania,  
Docket No. A-2019-3011226**

Dear Secretary Chiavetta:

Today PECO Energy Company served a Public Version of the above-noted Letter of Notification ("LON") on a supplemental service list, as indicated in the attached Supplemental Certificate of Service. This transmittal letter, the Supplemental Certificate of Service, and the Public Version of the LON are attached for filing.

Sincerely,

A handwritten signature in black ink, appearing to read "Ward L. Smith".

Ward L. Smith  
Assistant General Counsel

Enclosures  
WLS/az

**BEFORE THE  
PENNSYLVANIA PUBLIC UTILITY COMMISSION**

**Letter of Notification of PECO Energy  
Company For Approval to Reconductor  
its 130-20 Transmission Line in Falls  
Township and Bristol Township,  
Pennsylvania** :  
: **DOCKET NO. A-2019-3011226**  
:  
:  
:

**SUPPLEMENTAL CERTIFICATE OF SERVICE**


I, Ward L. Smith, hereby certify that I have this day served a true and correct copy of the Public Version of PECO Energy Company's Letter of Notification upon the following persons, in the manner indicated, in accordance with the requirements of 52 Pa. Code Sections 1.54 and 57.74.

**VIA CERTIFIED MAIL  
RETURN RECEIPT REQUEST**

**Brian Hessenthaler  
Chief Operating Officer  
Bucks County  
55 East Court Street, 5<sup>th</sup> Floor  
Doylestown, PA 18901**

**Edward Kisselback, Jr.  
Chairman  
Bucks County Planning Commission  
1260 Almhouse Road  
Doylestown, PA 18901**

**Robert G. Loughery  
Commission Chairman  
Bucks County  
55 East Court Street  
Doylestown, PA 18901**



**Ward L. Smith  
Assistant General Counsel  
PECO Energy Company  
2301 Market Street, S23-1  
Philadelphia, PA 19101-8699  
Phone: 215.841.6863  
E-mail: ward.smith@exeloncorp.com**

July 22, 2019

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

**EXHIBIT A-7-2 (PUBLIC): COPY OF NOTICE AND MAP SERVED ON LOCAL  
RESIDENTS**



An Exelon Company

July 22, 2019

RE: PECO's Letter of Notification Filing with the Pennsylvania Public Utility Commission  
Emilie to Falls Reconductoring Project

PECO recently sent you a Fact Sheet regarding its Emilie to Falls Reconductoring Project. This letter is to notify you that PECO has filed its Letter of Notification with the Pennsylvania Public Utility Commission regarding the Emilie to Falls Project. A copy of the map showing the proposed route of the project (also provided with the fact sheet) is attached for your information.

The Commission has assigned Docket No. A-2019-3011226 to PECO's Letter of Notification. If you would like to make any comments regarding PECO's Letter of Notification, you may send them in writing to:

Rosemary Chiavetta  
Secretary  
Pennsylvania Public Utility Commission  
400 North Street  
2nd Floor  
Harrisburg, PA 171120

Please also send a copy to PECO's attorney:

Ward Smith  
Assistant General Counsel  
PECO Energy Company  
2301 Market Street  
S23-1  
Philadelphia, PA 19103


Please reference Docket No. A-2019-3011226 in any written comments that you make.

Sincerely,

A handwritten signature in black ink, appearing to read "Ward Smith", written over a horizontal line.

Ward Smith  
Assistant General Counsel  
PECO Energy Company

Enclosures

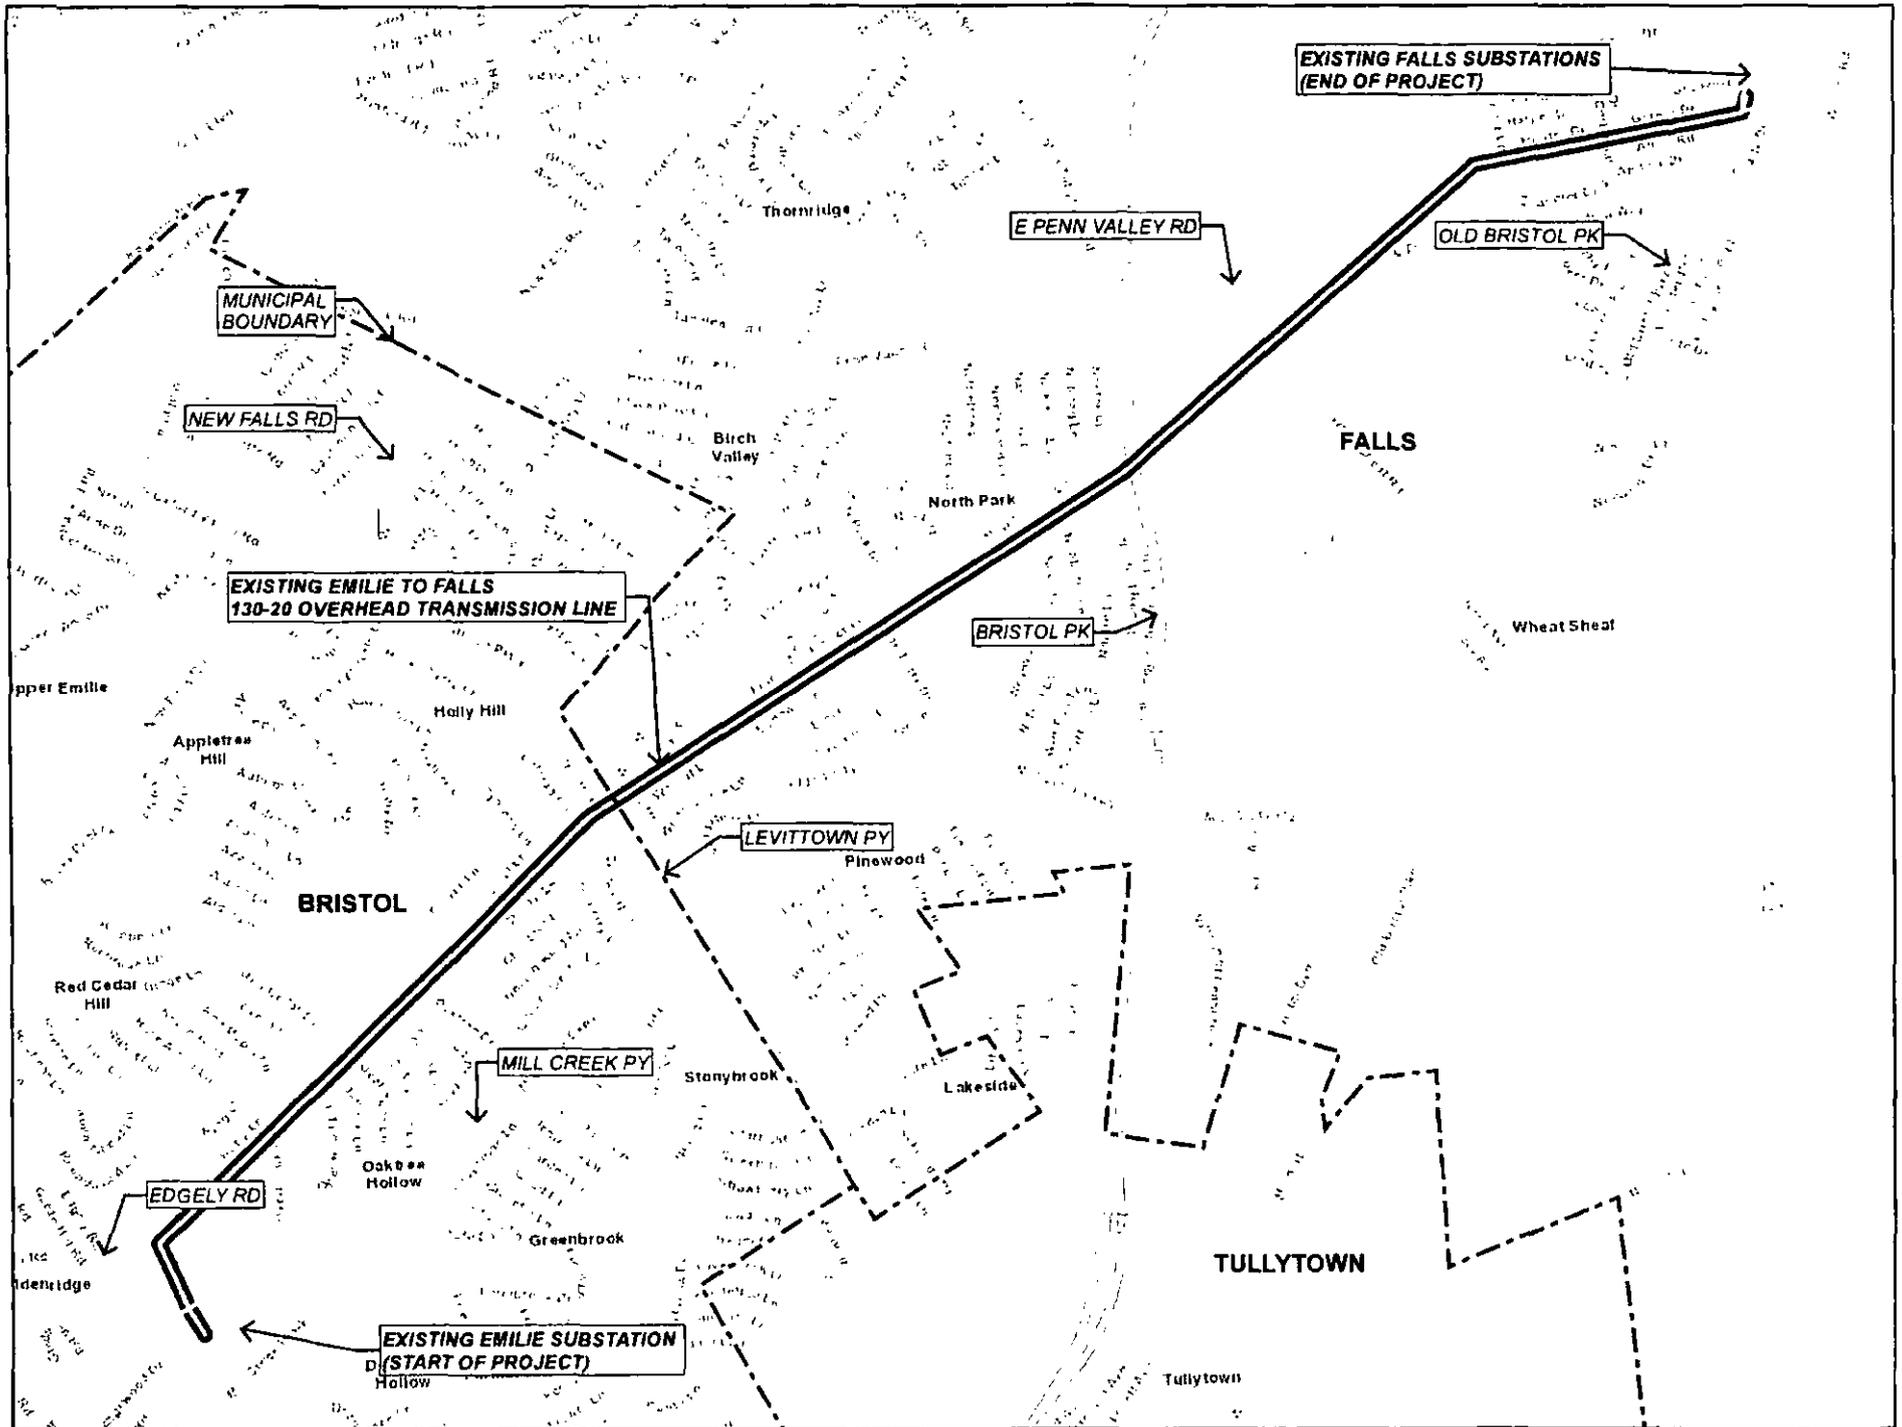

GENERAL AFFIDAVIT

STATE OF PENNSYLVANIA  
COUNTY OF BUCKS

Personally came and appeared before me, the undersigned Notary, the within named **Kelly Henry**, Principal of **H&G Public Affairs, LLC** who is a resident of Bucks County, State of Pennsylvania, and makes this her Statement and General Affidavit upon oath and affirmation of belief and personal knowledge that the following matters, facts and things set forth are true and correct to the best of her knowledge on July 22, 2019,

*On Monday, July 22, 2019, H&G Public Affairs LLC (acting on behalf of PECO Energy Company) delivered to the United States Post Office in Morrisville, PA the attached notice of PECO's filing of Emilie-Falls Reconductoring Letter of Notification. The notice was sent, by registered or certified mail, return receipt requested, to all addressees on the attached list, which comprises every property abutting the subject transmission line right-of-way, including those properties over which PECO has an easement for its transmission line.*

Signature of Affidavit: Kelly Henry Date: 22 Jul 2019  
Name KELLY HENRY

+++++

STATE OF PENNSYLVANIA  
COUNTY OF BUCKS

Signed or sworn to (or affirmed) before me on this day 22 of July, 2019  
By Kelly Henry

Who proved to me on the basis of satisfactory evidence to be the person who appeared before me >

Personally known     

Or

Produced identification X

Type of ID PADL

Signature of Notary

*Stella Brunton*


Commonwealth of Pennsylvania - Notary Seal  
STELLA BRUNTON - Notary Public  
Bucks County  
My Commission Expires May 6, 2022  
Commission Number 1019162

**Letter of Notification of PECO Energy Company to the Reconstructor of the Emilie-Falls  
138 kV Transmission Line in Bucks County, Pennsylvania.  
PECO's Answers to Bureau of Technical Utility Services  
Data Requests  
Docket No. A-2019-3011226**

**EXHIBIT A-8: AERIAL MAP DEPICTING THE PARCELS AND LANDOWNERS  
WHOSE PROPERTY THE PROPOSED PROJECT WILL TRAVERSE**





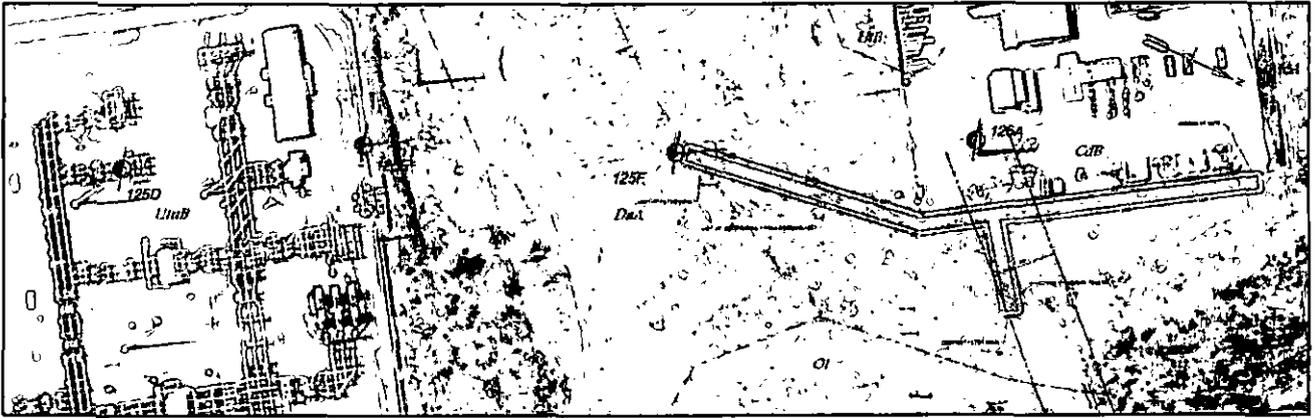


VIEW A

VIEW B




LEGEND

PROPOSED LINE	
EXISTING LINE	
EXISTING TOWER	
EXISTING STRUCTURE	
EXISTING ROAD	
EXISTING FENCE	
EXISTING UTILITY	
EXISTING POWER POLE	
EXISTING TRANSFORMER	
EXISTING BUILDING	
EXISTING ROADWAY	
EXISTING DRIVEWAY	
EXISTING SIDEWALK	
EXISTING CURB	
EXISTING DRIVE	
EXISTING ROADWAY	
EXISTING DRIVEWAY	
EXISTING SIDEWALK	
EXISTING CURB	
EXISTING DRIVE	



<p><b>CEG CEDARVILLE</b> CONSTRUCTION &amp; ENGINEERING</p>
<p>PROJECT: <b>ERSON AND HERBERT CONTROL PLAN</b>          CLIENT: <b>PECO ENERGY COMPANY</b>          LOCATION: <b>EMBLE SUBSTATION - FALLS SUBSTATION</b></p>
<p>DATE: _____          DRAWN BY: _____          CHECKED BY: _____          PROJECT NO: _____          SCALE: _____          SHEET NO. OF _____</p>
<p><b>C-3</b></p>

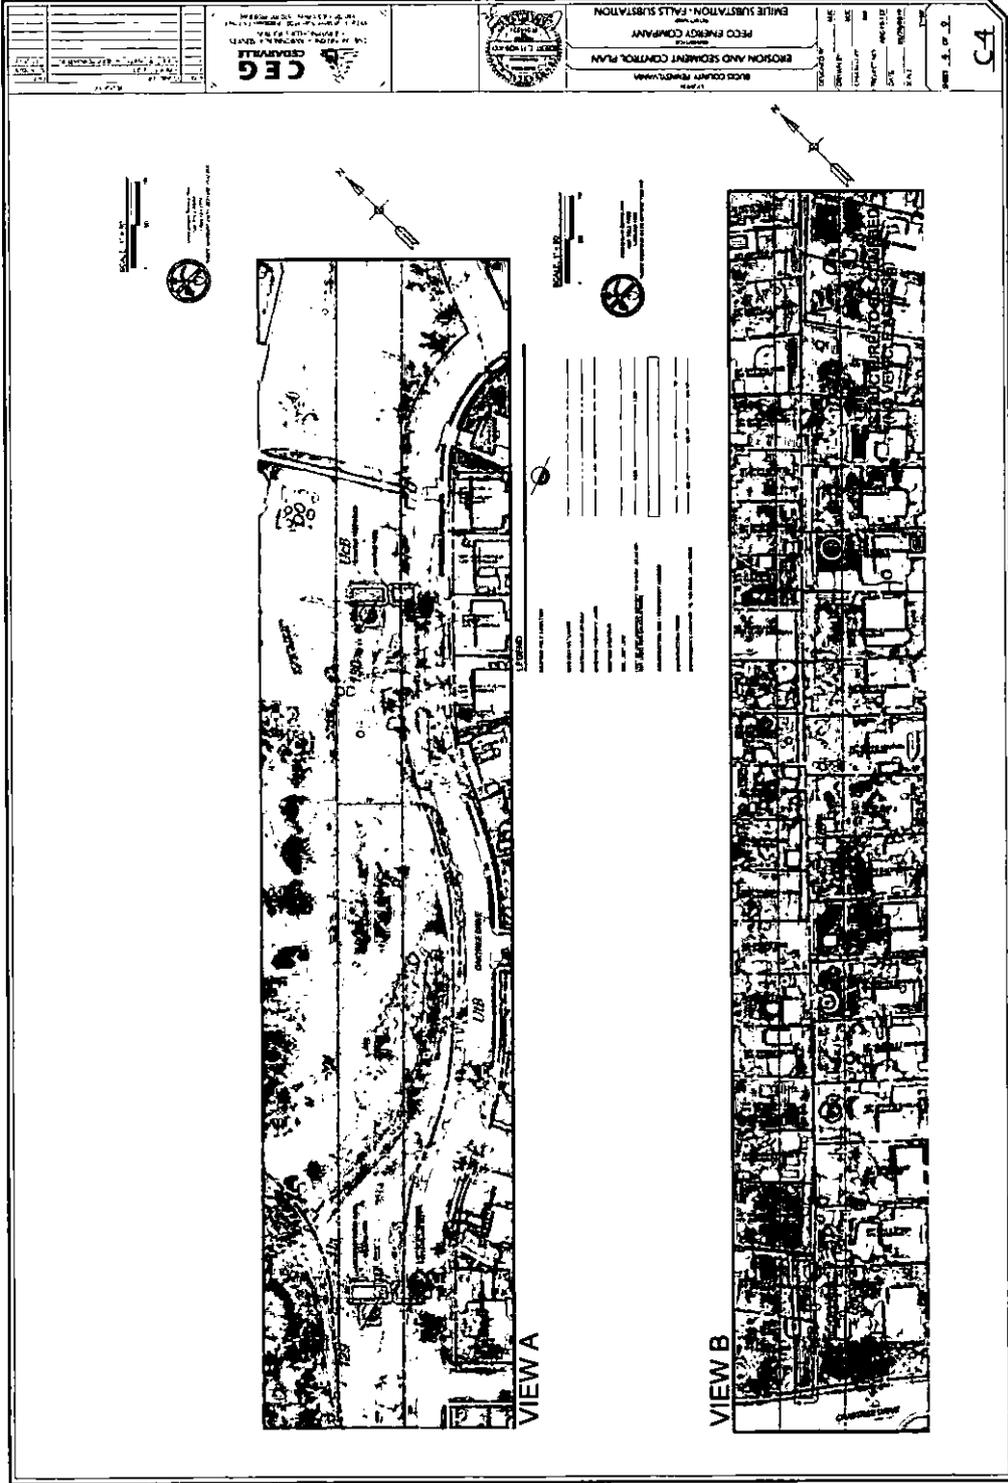

VIEW A

VIEW B

BLUE COURT REPAIRS  
 EROSION AND SEDIMENT CONTROL PLAN  
 PECO ENERGY COMPANY  
 EMILE SUBSTATION - FALLS SUBSTATION

**CEG**  
 CONSULTING ENGINEERS GROUP  
 1000 MARKET STREET, SUITE 1000  
 PHILADELPHIA, PA 19102  
 TEL: 215-592-1000  
 FAX: 215-592-1001  
 WWW.CEG-PA.COM










ORIGIN ID:REDA (215) 841-5353  
ANITA ZAKETA  
2301 MARKET STREET  
S23-1  
PHILADELPHIA, PA 19103  
UNITED STATES US  
SHIP DATE: 22 JUL 19  
ACTWGT: 1.00 LB  
CAD: 102138557/MET4160

BILL SENDER

TO  
**ROSEMARY CHIAVETTA, SECRETARY**  
**PA PUBLIC UTILITY COMMISSION**  
**400 NORTH ST FL 2**  
**COMMONWEALTH KEYSTONE BUILDING**  
**HARRISBURG PA 17120**  
(717) 772-7777 REF: 2019000784  
PA  
PO

827JGWEF9C5A2

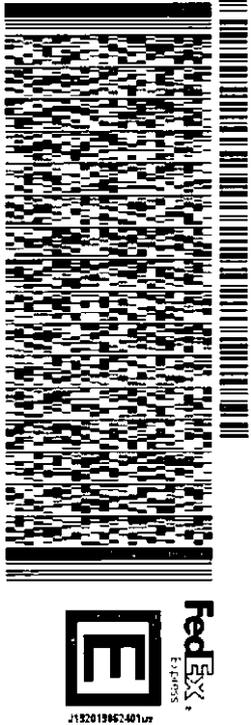

TRK# 7758 0251 2960  
0201  
TUE - 23 JUL 3:00P  
STANDARD OVERNIGHT

**ENMDTA**  
PA-US  
17120  
MDT



**After printing this label:**

1. Use the 'Print' button on this page to print your label to your laser or inkjet printer.
2. Fold the printed page along the horizontal line.
3. Place label in shipping pouch and affix it to your shipment so that the barcode portion of the label can be read and scanned.

**Warning.** Use only the printed original label for shipping. Using a photocopy of this label for shipping purposes is fraudulent and could result in additional billing charges, along with the cancellation of your FedEx account number.

Use of this system constitutes your agreement to the service conditions in the current FedEx Service Guide, available on [fedex.com](http://fedex.com). FedEx will not be responsible for any claim in excess of \$100 per package, whether the result of loss, damage, delay, non-delivery, misdelivery, or misinformation, unless you declare a higher value, pay an additional charge, document your actual loss and file a timely claim. Limitations found in the current FedEx Service Guide apply. Your right to recover from FedEx for any loss, including intrinsic value of the package, loss of sales, income interest, profit, attorney's fees, costs, and other forms of damage whether direct, incidental, consequential, or special is limited to the greater of \$100 or the authorized declared value. Recovery cannot exceed actual documented loss. Maximum for items of extraordinary value is \$1,000, e.g. jewelry, precious metals, negotiable instruments and other items listed in our Service Guide. Written claims must be filed within strict time limits, see current FedEx Service Guide.