

June 4, 2020

**Via Electronic Mail**

Bradley S. Tupi  
Ann Marie Clyne  
[bradtupi@gmail.com](mailto:bradtupi@gmail.com)

**Re: Docket No. C-2019-3013785  
Bradley S. Tupi and Ann Marie Clyne v. West Penn Power Company  
West Penn's Second Supplemental Responses - First Set**

Dear Mr. Tupi and Ms. Clyne:

Attached please find the Second Supplemental Responses of West Penn Power Company to Bradley S. Tupi and Ann Marie Clyne Interrogatories - First Set in the above referenced proceeding as indicated on the attached Certificate of Service. If there are any questions, please do not hesitate to contact me.

Very truly yours,

Reger Rizzo & Darnall LLP

*Margaret A. Morris*  
Margaret A. Morris

MAM/co  
Enclosures

cc: The Honorable Mark Hoyer PA Public Utility Commission [Cover & COS only]  
Rosemary Chiavetta, Esquire, PA Public Utility Commission [Cover & COS only]  
Teresa K. Harrold, Esquire, FirstEnergy Service Company [w/encl.]

**Re: Docket No. C-2019-3013785  
Bradley S. Tupi and Ann Marie Clyne v. West Penn Power Company  
West Penn's Second Supplemental Responses- First Set**

**CERTIFICATE OF SERVICE**

I hereby certify that a true and correct copy of the foregoing document has been served upon the following person(s), in the manner indicated, in accordance with the requirements of § 1.54 (relating to service by a participant).

**Via Electronic Mail**

Bradley S. Tupi  
Ann Marie Clyne  
[bradtupi@gmail.com](mailto:bradtupi@gmail.com)

Dated: June 4, 2020

*Margaret A Morris*  
Margaret A. Morris, Esquire

BEFORE THE  
PENNSYLVANIA PUBLIC UTILITY COMMISSION

BRADLY S. TUPI AND ANN MARIE CLYNE :  
v. : Docket No. C-2019-3013785  
: :  
WEST PENN POWER COMPANY :

**WEST PENN POWER COMPANY'S SECOND SUPPLEMENTAL RESPONSES TO  
FIRST SET OF INTERROGATORIES AND REQUESTS FOR PRODUCTION  
OF DOCUMENTS OF BRADLY S. TUPI AND ANN MARIE CLYNE**

West Penn Power Company ("West Penn" or "Company"), by and through its attorneys, Reger Rizzo & Darnall LLP, pursuant to 52 Pa. Code § 5.342 (c) hereby submits its Second Supplemental Responses to Interrogatories and Requests for Production of Documents of Complainant, Bradley S. Tupi and Ann Marie Clyne ("Complainant"). In response thereto, Respondent responds as follows:

**REQUEST #1**

ADMIT that Complainants suffered power outages at the Property on the following dates, for the following durations, and due to the following causes:

07/11/2017 – 8 hrs. - Trees

09/05/2017 - 1 hr. - Trees

09/05/2017 - 16 minutes - Trees

04/27/2018 - 2 hrs. - Trees

09/09/2018 - 5 hrs. - Trees

11/15/2018 - 35 Minutes - Trees

12/10/2018 - 38 Minutes - Trees

05/21/2019 - 9 hrs. - Trees

06/01/2019 - 4 hrs. - Equipment Failure

07/23/2019 - 30 Minutes - Planned Outage

08/05/2019 - 1 hr. 12 min. - Line Failure

09/29/2019 (1) – 4 hrs. 41 min. - Trees Off ROW - Tree

09/29/2019 (2) - 15 hrs. 49 min. - Trees Off ROW - Limb

10/06/2019 - 1 hr. 30 min. - Open Breaker

**RESPONSE**

**See Bates No. 0002**

Response By: Shawn Hindman  
Position: Reliability Engineer

**SUPPLEMENTAL RESPONSE**

**See Bates No. 0065-0066**

Response By: Shawn Hindman  
Position: Reliability Engineer

**SECOND SUPPLEMENTAL RESPONSE**

**See Bates No. 0071-0072**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #2**

If your response to Discovery Request No. 1 is anything other than an unqualified admission, explain why.

**RESPONSE**

The outage listed for 5/21/19 occurred on 5/20/19. The outages listed for 9/29/19 occurred on 9/28/19.

**See Bates No. 0002**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #3**

IDENTIFY all other power outages at the Property from January 1, 2017, to date, setting forth the date, duration, and cause for each.

**RESPONSE**

**See Bates No. 0002**

Response By: Shawn Hindman  
Position: Reliability Engineer

**SUPPLEMENTAL RESPONSE**

**See Bates No. 0065-0066**

Response By: Shawn Hindman  
Position: Reliability Engineer

**SECOND SUPPLEMENTAL RESPONSE**

**See Bates No. 0071-0075**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #4**

With respect to the outage on July 11, 2017 (“07/11/2017 – 8 hrs. – Trees”):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

**RESPONSE**

**See Bates No. 0010-0011**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #5**

With respect to the first outage on September 5, 2017 (“09/05/2017 - 1 hr. –Trees”):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

**RESPONSE**

**See Bates No. 0012-0013**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #6**

With respect to the second outage on September 5, 2017 (“09/05/2017 - 16 minute Trees”):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

**RESPONSE**

**See Bates No. 0012-0013**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #7**

With respect to the outage on April 27, 2018 (“04/27/2018 - 2 hrs. - Trees”):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

**RESPONSE**

**See Bates No. 0014-0015**

Response By: Shawn Hindman  
Position: Reliability Engineer

## **REQUEST #8**

With respect to the outage on September 9, 2018 (“09/09/2018 - 5 hrs. - Trees”):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

## **RESPONSE**

**See Bates No. 0016-0017**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #9**

With respect to the outage on November 15, 2018 (“11/15/2018 - 35 Minutes - Trees”):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

**RESPONSE**

**See Bates No. 0018-0019**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #10**

With respect to the outage on December 10, 2018 (“12/10/2018 - 38 Minutes - Trees”):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

**RESPONSE**

**See Bates No. 0020-0021**

Response By: Shawn Hindman  
Position: Reliability Engineer

## **REQUEST #11**

With respect to the outage on May 21, 2018 (“05/21/2019 - 9 hrs. - Trees”):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

## **RESPONSE**

The outage was May 20, 2019.

**See Bates No. 0022-0023**

Response By: Shawn Hindman  
Position: Reliability Engineer

## **REQUEST #12**

With respect to the outage on June 1, 2019 (“06/01/2019 - 4 hrs. – Equipment Failure”):

- a. STATE the specific location on the Clifton Circuit where the Equipment Failure caused the outage
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

## **RESPONSE**

**See Bates No. 0024-0025**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #13**

With respect to the outage on July 23, 2019 (“07/23/2019 - 30 Minutes – Planned Outage”):

- a. EXPLAIN the purpose of the Planned Outage;
- b. STATE the geographic scope of the outage;
- c. STATE the time when the outage began and ended;
- d. STATE the number or other identifier for the device(s) that operated to open the circuit;
- e. STATE the local weather conditions at the time of the outage;
- f. PRODUCE all Documents showing Your reasons for the Planned Outage.

**RESPONSE**

**See Bates No. 0026-0027**

Response By: Shawn Hindman  
Position: Reliability Engineer

## **REQUEST #14**

With respect to the outage on August 5, 2019 (“08/05/2019 - 1 hr. 12 min. – Line Failure”):

- a. STATE the specific location on the Clifton Circuit where the Line Failure occurred;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

## **RESPONSE**

**See Bates No. 0028-0029**

Response By: Shawn Hindman  
Position: Reliability Engineer

## **REQUEST #15**

With respect to the first outage on September 29, 2019 ("09/29/2019 (1) – 4 hrs. 41 min. - Trees Off ROW - Tree"):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

## **RESPONSE**

The outage was September 28, 2019.

**See Bates No. 0030-0031**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #16**

With respect to the second outage on September 29, 2019 ("09/29/2019 (2) --15 hrs. 49 min. - Trees Off ROW - Limb"):

- a. STATE the specific location on the Clifton Circuit where the Trees caused the outage;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

**RESPONSE**

The outage was September 28, 2019.

**See Bates No. 0030-0031**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #17**

With respect to the outage on October 6, 2019 (“10/06/2019 - 1 hr. 30 min. –Open Breaker”):

- a. STATE the specific location on the Clifton Circuit where the Open Breaker occurred;
- b. STATE the number or other identifier for the Breaker in question;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

**RESPONSE**

The outage was September 28, 2019.

**See Bates No. 0032-0033**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #18**

With respect to each outage identified in response to Discovery Demand No. 3:

- a. STATE the specific location on the Clifton Circuit where the cause of the outage occurred;
- b. STATE the number or other identifier for the device(s) that operated to open the circuit;
- c. STATE the time when the outage began and ended;
- d. STATE the local weather conditions at the time of the outage;
- e. STATE what remedial measures You took following this outage, if any; and
- f. PRODUCE all Documents showing Your investigation of the outage, Your response to the outage, and Your efforts to prevent another such outage.

**RESPONSE**

**See Bates No. 0003-0037**

Response By: Shawn Hindman  
Position: Reliability Engineer

**SUPPLEMENTAL RESPONSE**

**See Bates No. 0067-0070**

Response By: Shawn Hindman  
Position: Reliability Engineer

**SECOND SUPPLEMENTAL RESPONSE**

**See Bates No. 0072-0075**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #19**

PRODUCE a map of the Clifton Circuit.

**RESPONSE**

**See Bates No. 0001**

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #20**

IDENTIFY the house numbers of all residences in Deerfield Manor served by the Clifton Circuit and above-ground service.

**RESPONSE**

Deerfield Manor is not a recognized subdivision in the Company's business records.

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #21**

STATE whether You have received any complaints about the reliability of service in Deerfield Manor, aside from the Formal Complaint. If so:

- a. STATE the house numbers corresponding to the complaints;
- b. STATE whether the homes corresponding to the complaints had above- ground or underground electrical service; and
- c. PRODUCE any and all Documents relating to such complaints and Your evaluations such complaints.

**RESPONSE**

Deerfield Manor is not a recognized subdivision in the Company's business records.

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #22**

STATE whether You have evaluated the reliability of service in Deerfield Manor. If so, PRODUCE any and all Documents relating to any such evaluations.

**RESPONSE**

No. See Response #22.

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #23**

STATE whether You have evaluated whether above-ground electrical service is a contributing factor in the outages experienced at the Property or in Deerfield Manor. If so, PRODUCE any and all Documents relating to any such evaluations.

**RESPONSE**

No. See Response #22.

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #24**

STATE whether You have evaluated whether installing underground electrical service would improve reliability of service either at the Property or in Deerfield Manor. If so, PRODUCE any and all Documents relating to any such evaluations.

**RESPONSE**

No. See Response #22.

Response By: Shawn Hindman

Position: Reliability Engineer

**REQUEST #25**

STATE whether You have evaluated the cost to install underground service for those homes in Deerfield Manor that have above-ground electrical service. If so, PRODUCE any and all Documents relating to any such evaluations.

**RESPONSE**

No. See Response #22.

Response By: Shawn Hindman  
Position: Reliability Engineer

**REQUEST #26**

STATE the name and job title of the person in charge of evaluating the Clifton Circuit for purposes of reporting reliability to the PUC.

**RESPONSE**

Shawn Hindman, Reliability Engineer

Response By: Shawn Hindman

Position: Reliability Engineer

**REQUEST #27**

STATE the name and job title of the person in charge of tree trimming in the area served by the Clifton Circuit.

**RESPONSE**

Richard Scott, Forestry Manager

Response By: Shawn Hindman

Position: Reliability Engineer

**REQUEST #28**

STATE the name and job title of the person assisting counsel in preparing Your responses to these Discovery Demands.

**RESPONSE**

Request #28 it is not a request. 52 PA Code § 5.342 sets forth the requirement that the answer “shall identify the name and position of the individual who provided the answer.”

Response By: Margaret A. Morris, Esquire  
Position: Counsel for West Penn

**REQUEST #29**

STATE the full name, address, and telephone number of each person You expect to call to testify at any hearing in this case.

**RESPONSE**

A determination has not been made at this time since the matter is with the Commission's Mediation Unit consistent with the Interim Order.

Response By: Margaret A. Morris, Esquire  
Position: Counsel for West Penn

**REQUEST #30**

STATE the full name, address, and telephone number of each person You expect to call to testify as an expert witness at any hearing in this case. For each expert witness:

- a. STATE the subject matter on which the expert is expected to testify;
- b. STATE the substance of the facts and opinions to which the expert is expected testify; and
- c. STATE a summary of the grounds for each expert opinion.

**RESPONSE**

A determination has not been made at this time since the matter is with the Commission's Mediation Unit consistent with the Interim Order.

Response By: Margaret A. Morris, Esquire  
Position: Counsel for West Penn

**REQUEST #31**

Produce the report of any expert You intend to call to testify on Your behalf at any hearing in this case.

**RESPONSE**

A determination has not been made at this time since the matter is with the Commission's Mediation Unit consistent with the Interim Order.

Response By: Margaret A. Morris, Esquire  
Position: Counsel for West Penn

**REQUEST #32**

Produce the curriculum vitae of any expert that You intend to call to testify on Your behalf at any hearing in this case.

**RESPONSE**

A determination has not been made at this time since the matter is with the Commission's Mediation Unit consistent with the Interim Order.

Response By: Margaret A. Morris, Esquire  
Position: Counsel for West Penn

Respectfully submitted,

Dated: June 4, 2020

*Margaret A Morris*

Margaret A. Morris, Esq.  
Attorney ID No. 75048  
Reger Rizzo & Darnall LLP  
Cira Centre, 13<sup>th</sup> Floor  
2929 Arch Street  
Philadelphia, PA 19104  
(215) 495-6524  
[mmorris@regerlaw.com](mailto:mmorris@regerlaw.com)

# West Penn Power ERS Complaint Action Plan

<b>Basic Complaint Information:</b>	
Customer Name:	Tupi, Bradley S
Service Address:	1470 Redfern Dr Pittsburgh, PA
Account Number:	100097115370
Date Order Taken:	11/04/19

****EXTENDED OUTAGE HISTORY (2 YEAR)****				
DATE/TIME	DURATION (HOUR/MIN)	OUTAGE CAUSE	CUSTOMERS AFFECTED	WEATHER/ADDITIONAL COMMENTS
05/29/2020 19:39:00	390	TREES OFF ROW-TREE	30	FAIR-SUNNY-OVERCAST
03/21/2020 04:00:00	5	FORCED OUTAGE	977	FAIR-SUNNY-OVERCAST
02/20/2020 09:50:00	90	PLANNED OUTAGE	3	FAIR-SUNNY-OVERCAST
11/15/2019 09:22:09	117	UNKNOWN	975	FAIR-SUNNY-OVERCAST
10/25/2019 09:44:00	179	TREES OFF ROW-TREE	975	FAIR-SUNNY-OVERCAST
10/08/2019 12:02:00	90	UNKNOWN	976	FAIR-SUNNY-OVERCAST
09/28/2019 19:21:21	949	TREES OFF ROW-LIMB	31	
08/05/2019 16:31:00	72	LINE FAILURE	652	FAIR-SUNNY-OVERCAST
07/23/2019 13:05:00	30	PLANNED OUTAGE	191	FAIR-SUNNY-OVERCAST
06/01/2019 04:43:00	235	EQUIPMENT FAILURE	972	FAIR-SUNNY-OVERCAST
05/20/2019 23:50:25	462	TREES OFF ROW-TREE	4	FAIR-SUNNY-OVERCAST
12/10/2018 11:13:47	38	UNKNOWN	979	FAIR-SUNNY-OVERCAST
11/15/2018 13:18:00	35	TREES ON ROW	419	FAIR-SUNNY-OVERCAST
09/09/2018 13:47:53	302	TREES OFF ROW-TREE	984	FAIR-SUNNY-OVERCAST
04/27/2018 19:38:00	122	TREES OFF ROW-TREE	980	FAIR-SUNNY-OVERCAST
09/05/2017 06:00:00	78	TREES OFF ROW-TREE	463	
07/11/2017 17:47:00	508	TREES OFF ROW-TREE	784	FAIR-SUNNY-OVERCAST
06/28/2017 05:26:00	182	TREES ON ROW	208	FAIR-SUNNY-OVERCAST
05/05/2017 15:50:00	99	FORCED OUTAGE	1022	FAIR-SUNNY-OVERCAST
03/08/2017 14:04:31	366	TREES OFF ROW-TREE	15	

<b>****CONTACT HISTORY****</b>			
(copy additional rows in if needed)			
#1 Date/Time	Contact Name	Company Employee	
	Bradley Tupi	Shawn Hindman	
<b>Explanation of Discussion</b>			
Spoke with customer about his reliability and what we were going to correct the issue. We also spoke about his neighbors being on a different circuit so when his lights are out they are on. He also asked for a map and reliability numbers.			
#2 Date/Time	Contact Name	Company Employee	
<b>Explanation of Discussion</b>			
#3 Date/Time	Contact Name	Company Employee	
<b>Explanation of Discussion</b>			

<b>****OUTAGE ANALYSIS****</b>	
<i>Click All That Apply:</i>	
Momentary Outage Problem	<input type="checkbox"/>
Extended Outage Problem	<input checked="" type="checkbox"/>

Other ERS problem

**ANALYSIS COMMENTS:**

Patrolling circuit to find causes for unknown outages and trimming trees .

**\*\*\*\*RELIABILITY IMPROVEMENTS / ACTION PLAN\*\*\*\***

We started patrolling zone 1, nothing found yet, We will continue

Actions that will be taken:

1 Tollgrade monitors will be installed on the line, to identify fault areas.

2 Forestry is removing some off right of way trees and ash trees.

3 There is a WR60075596 for an area of phase slap, replacing 8' arms with 10' was a problem due to side clearance, so job changed to install phase spacers.

2014 Pole inspection

2020 CRC OH Ckt inspection will be done

2018 infrared. No repairs needed.

2017 cycle tree trimming. Next 2022


2019 Reliability tree trimming

**Follow-up Summary**

	Actual	Target	
Date of This Update	5/29/2020		
Date Order Taken			
Date of Initial Response			Estimate 3-5 days for initial response
Date of Next Update			Est. Follow-up communication every 10 days after initial response until completed.
Projected Completion Date			Est Completion Date

**Report Log:**

Date	Responder	Comments on Changes

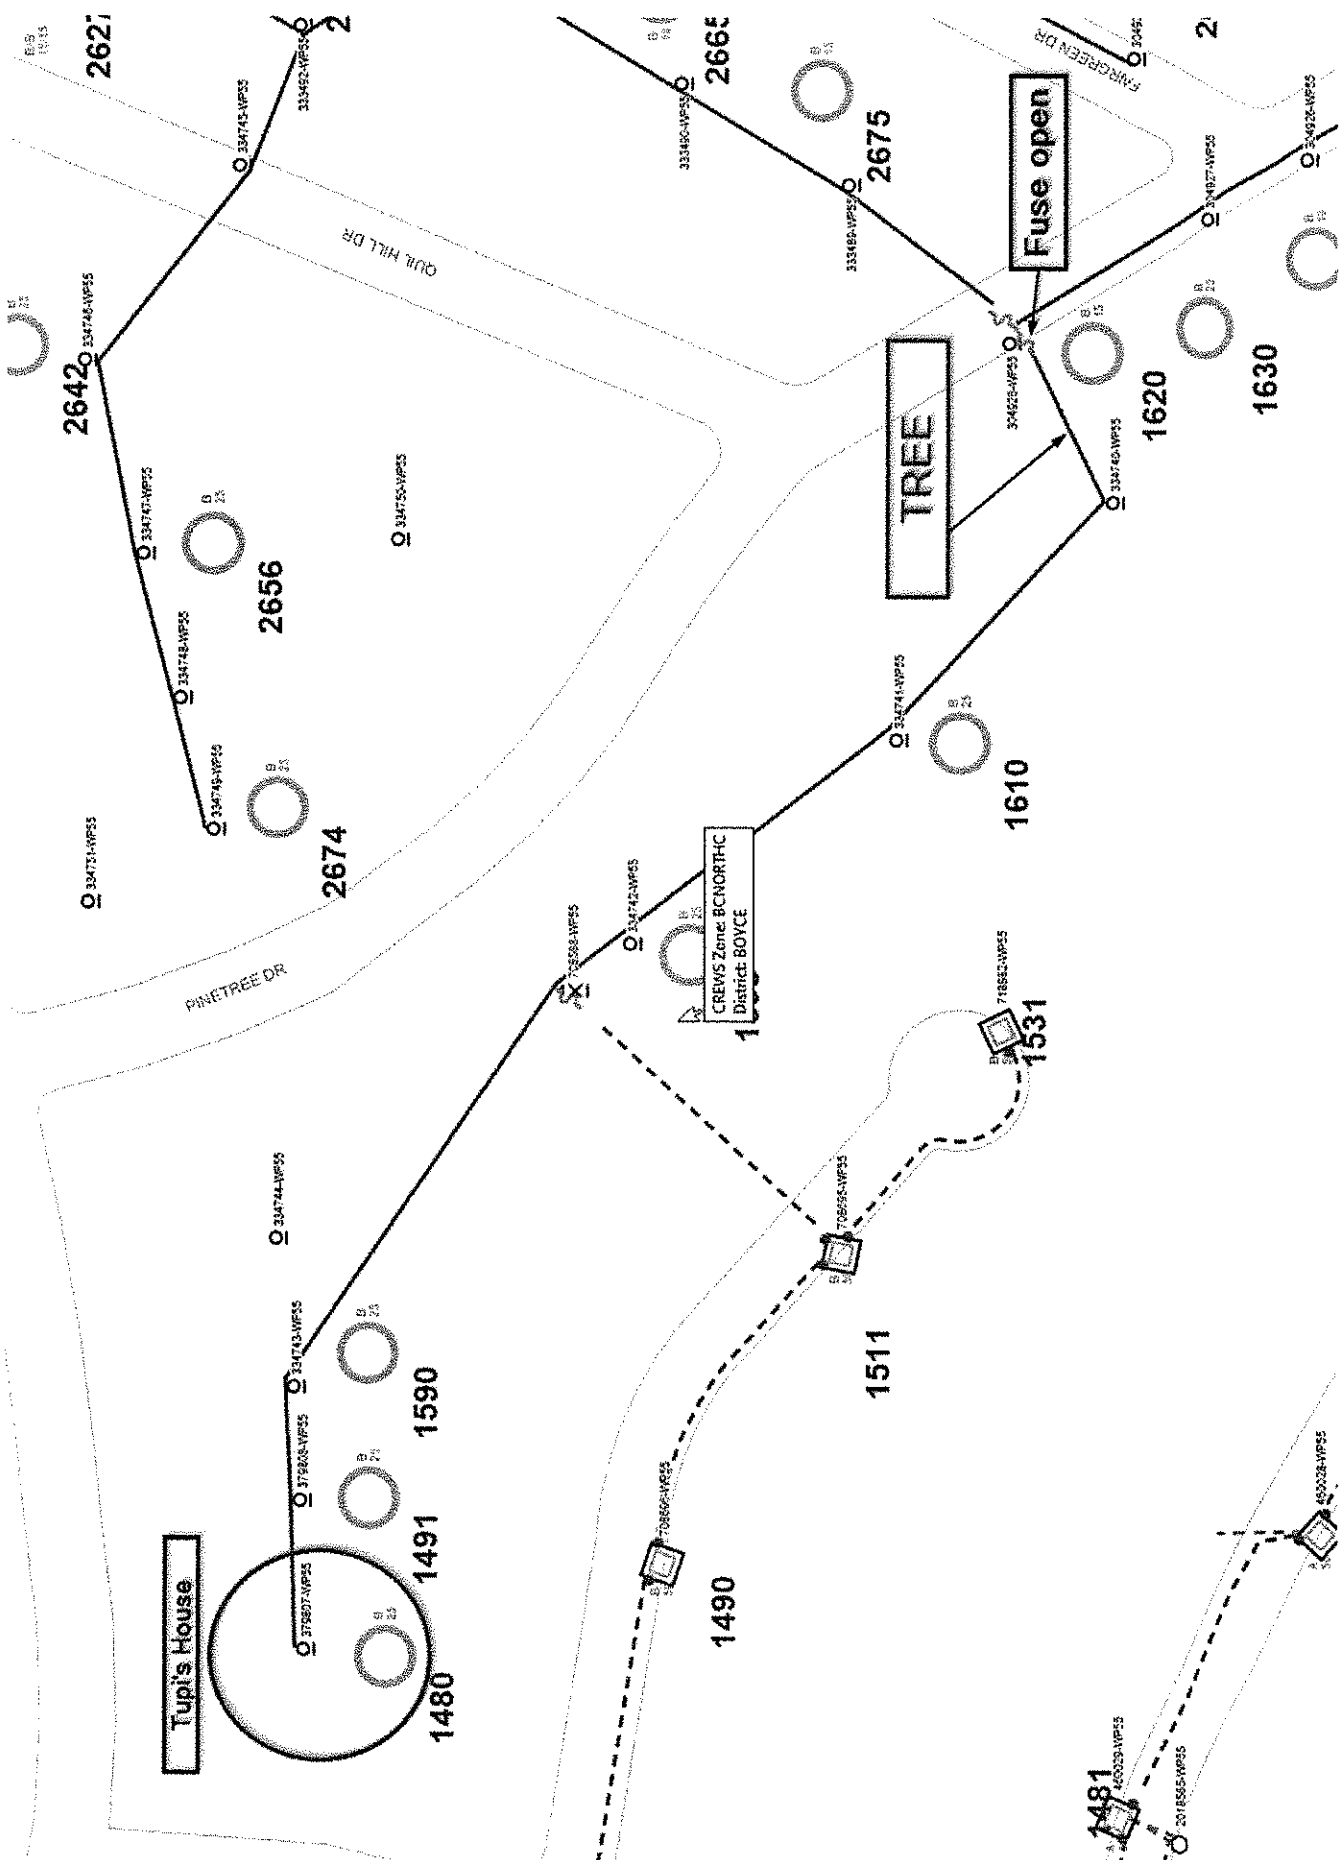

<b>Order #</b> 9624895-2	<b>Type</b> Outage	<b>Status</b> Closed	<b>Priority</b> 4	<b>Special</b> 
-----------------------------	-----------------------	-------------------------	----------------------	--------------------

<b>Order Details for Order 9624895-2</b>			
<b>Time Off</b> 05/29/2020 19:39	<b>Order Created</b> 05/29/2020 21:36	<b>Assigned</b> 05/29/2020 21:50	<b>Dispatch</b> 05/29/2020 22:55
<b>En Route</b> 05/29/2020 23:07	<b>Arrived</b> 05/29/2020 23:53	<b>Last Restoration</b> 05/30/2020 02:10	<b>Field Complete</b> 05/30/2020 02:32
<b>Closed</b> 05/30/2020 02:36	<b>ETR</b> 05/30/2020 04:00	<b>Calls</b> 25	<b>Custs Affected</b> 30
<b>Crew</b> DORSEY, JUSTIN - 134175		<b>Crew Area</b> BOYCE CA	
<b>Work Desc</b> Safety Forces On Site		<b>Duration (Min)</b> 391	<b>Total CMI</b> 11730

<b>Organization</b>		
<b>Current Org</b> Dispatch	<b>Substation</b> BETHEL PARK	<b>Disp Center</b> Boyce District
<b>Owner</b> Murdock, Justin	<b>Circuit</b> CLIFTON	<b>Disp Area</b> Boyce Oper Area

<b>Device Info</b>	
<b>ID</b> Fuse Installation 304928-WP55 65T	
<b>Type</b> Fuse	<b>Voltage</b> Unknown

<b>Event Details</b>		
<b>Cause</b> Trees Off ROW-Tree	<b>Cause Pole</b> 304928-WP55	
<b>Failed Comp</b> Conductor. - Bare	<b>Facility Location</b> Fuse Installation (304928-WP55)	
<b>Action Taken</b> Repaired Trim/Removed Tree(s)	<b>Outage Type</b> Distribution	<b>Weather</b> Fair-Sunny-Overcast
<b>Related Events</b> 9624895-1	<b>Follow Ups Sent</b> 	
<b>Follow Up</b> 		
<b>Comments</b> Opened 304928 to 334740 under emergency at 2115. Tree brought wire down 304928 to 334740. need tree crew and line crew. -2 for crew. WP-20-10409-CC. [MDT Comments - DORSEY-05/30/20 put wire back up and energized ]		
<b>Order Instructions</b> 		

Order # 9624895-2      Type Outage      Status Closed      Priority 4      Special

Order #	Start	End	Priority	Duration	Est	Facility	Impact	Category	Sub-Category	Code	Code	Code
9624895-2	05/29/2020 19:39	05/30/2020 02:10	30	391	11,730	Fuse Installation 304928-WP55	B	TREES OFF ROW-TREE	D	N	N	N