



Emily M. Farah
Counsel, Regulatory

411 Seventh Avenue
Mail drop 15-7
Pittsburgh, PA 15219

Tel: 412-393-6431
efarah@duqlight.com

October 11, 2021

VIA ELECTRONIC FILING

Rosemary Chiavetta, Secretary
Pennsylvania Public Utility Commission
Commonwealth Keystone Building, 2nd Floor
400 North Street
Harrisburg, PA 17120

**Re: Municipal Contract –Right of Way Agreement between Duquesne Light Company
and The Borough of Fox Chapel
Docket No. U-2021-_____**

Dear Secretary Chiavetta:

Enclosed for review and approval in accordance with 66 Pa.C.S. § 507 and 52 Pa. Code § 3.101, is a Right of Way Agreement dated September 27, 2021 between Duquesne Light Company (“Duquesne Light” or the “Company”) and the Borough of Fox Chapel (“Borough”). The Borough granted to Duquesne Light a Right of Way on its property situated on Fox Chapel Road in Fox Chapel Borough, Allegheny County, which provides the right to install, use, own, operate, maintain, repair, renew and remove an electrical line.

Should you have any questions regarding the enclosed right of way, please contact Dan Antosik at 412-393-8628.

Respectfully Submitted,

A handwritten signature in blue ink, appearing to read "Emily M. Farah".

Emily M. Farah
Attorney ID#322559

Enclosure

DUQUESNE LIGHT CO. COPY

UGPPP/01/08
810966

PRIVATE PROPERTY PRIMARY RIGHT OF WAY AGREEMENT

The undersigned Grantor, BOROUGH OF FOX CHAPEL, a Municipal corporation, does hereby grant unto Duquesne Light Company, its successors and assigns, for providing, transmitting and/or distributing electric and/or communications services for any and all purposes, the right, privilege and authority to erect, install, use, operate, maintain, repair, renew and finally remove an underground system consisting of cables, wires, transformer, and other fixtures and apparatus thereto belonging, upon, over, under, along, across and through Grantor's land, (having tax I.D. 289-J-85), fronting on Fox Chapel Rd. situate in the Borough of Fox Chapel, Allegheny County, Pennsylvania, together with the right to occupy and use as part of the underground system the conduit and transformer pad provided by Grantor; to trim or to remove any trees, shrubbery, roots or obstructions which at any time may interfere or threaten to interfere with the erection, installation, use, operation, maintenance, repair, renewal or final removal of the underground system(s); to enter upon the land at any time for such purposes; and to sublet or assign Duquesne's interest in whole or in part, without the prior consent of Grantor. The underground system shall be within an easement and right of way hereinafter described as being a strip of land twenty feet (20') in width, the centerline being facilities as installed in the field, beginning at pole DLC#474256 and continuing in a northerly direction approx. two hundred forty five (245') feet, to switch #90805; hence in a north westerly direction approx. two hundred eighty (280') feet to switch #90806; hence in a northerly direction approx. one hundred eighty (180') feet ending at transformer #90807, all in accordance with and substantially at the location shown on Duquesne Light Company Drawing No.

869324-T1, 869324-T2, 867324-T3 & 867324-T4, copies of which has been attached to and made part hereof.

The responsibility for the installation and construction of the underground system shall be as detailed and defined on the herein referred drawing and/or related drawings. The conduit, switch pad, transformer pad, guard posts and chain barrier required as part of the underground system shall be installed, owned, maintained, renewed and finally removed by Grantor, its successors and assigns.

Utility shall file a copy of this Agreement with the Pennsylvania Public Utility Commission as required by Title 66, Section 507 of the Public Utility Code, and this Agreement shall become effective in accordance therewith.

IN WITNESS whereof and intending to be legally bound hereby, the parties have executed this Agreement this 27 day of September, 2021.

GRANTOR:

BOROUGH OF FOX CHAPEL, a Municipal corporation

ATTEST:

Shaun M. Peterson
Secretary

By:

ACB
Andrew C. Bennett,
Borough Council President

NOTARY STATEMENT TO FOLLOW _____

COMMONWEALTH OF PENNSYLVANIA)) SS:
COUNTY OF ALLEGHENY))

On this 27th day of September, 2021, before me, the undersigned officer, a Notary Public in and for the Commonwealth and County, personally appeared Andrew C. Bennett, Borough Council President of the Borough of Fox Chapel, and as such President, being authorized to do so, executed the foregoing Agreement for the purposes therein contained.

IN WITNESS WHEREOF I have set my hand and official seal.

Commonwealth of Pennsylvania - Notary Seal
Shawn M. Peterson, Notary Public
Allegheny County
My commission expires January 14, 2025
Commission number 1372918
Member, Pennsylvania Association of Notaries

Shawn M. Peterson
Notary Public


TABLE 1 - SUBSURFACE STRUCTURE CLEARANCES

STRUCTURE TYPE	MINIMUM DESIGN CLEARANCE (FT)	
	PARALLEL	CROSSING
SEWER	1 FT	1 FT
WATER	15 FT	15 FT
GAS	1 FT	1 FT
TELECOM	1 FT	5 FT


SUMMARY

DLC WORK	QTY	PRIVATE PROPERTY	QTY	TOWNSHIP
INSTALL POLE	0		1	(1)
INSTALL COFFIN	2	(2) (3)	0	
INSTALL XFMR	1	(4)	0	


MAP: P6-15
CITY: D23712-3 (PINE CREEK)

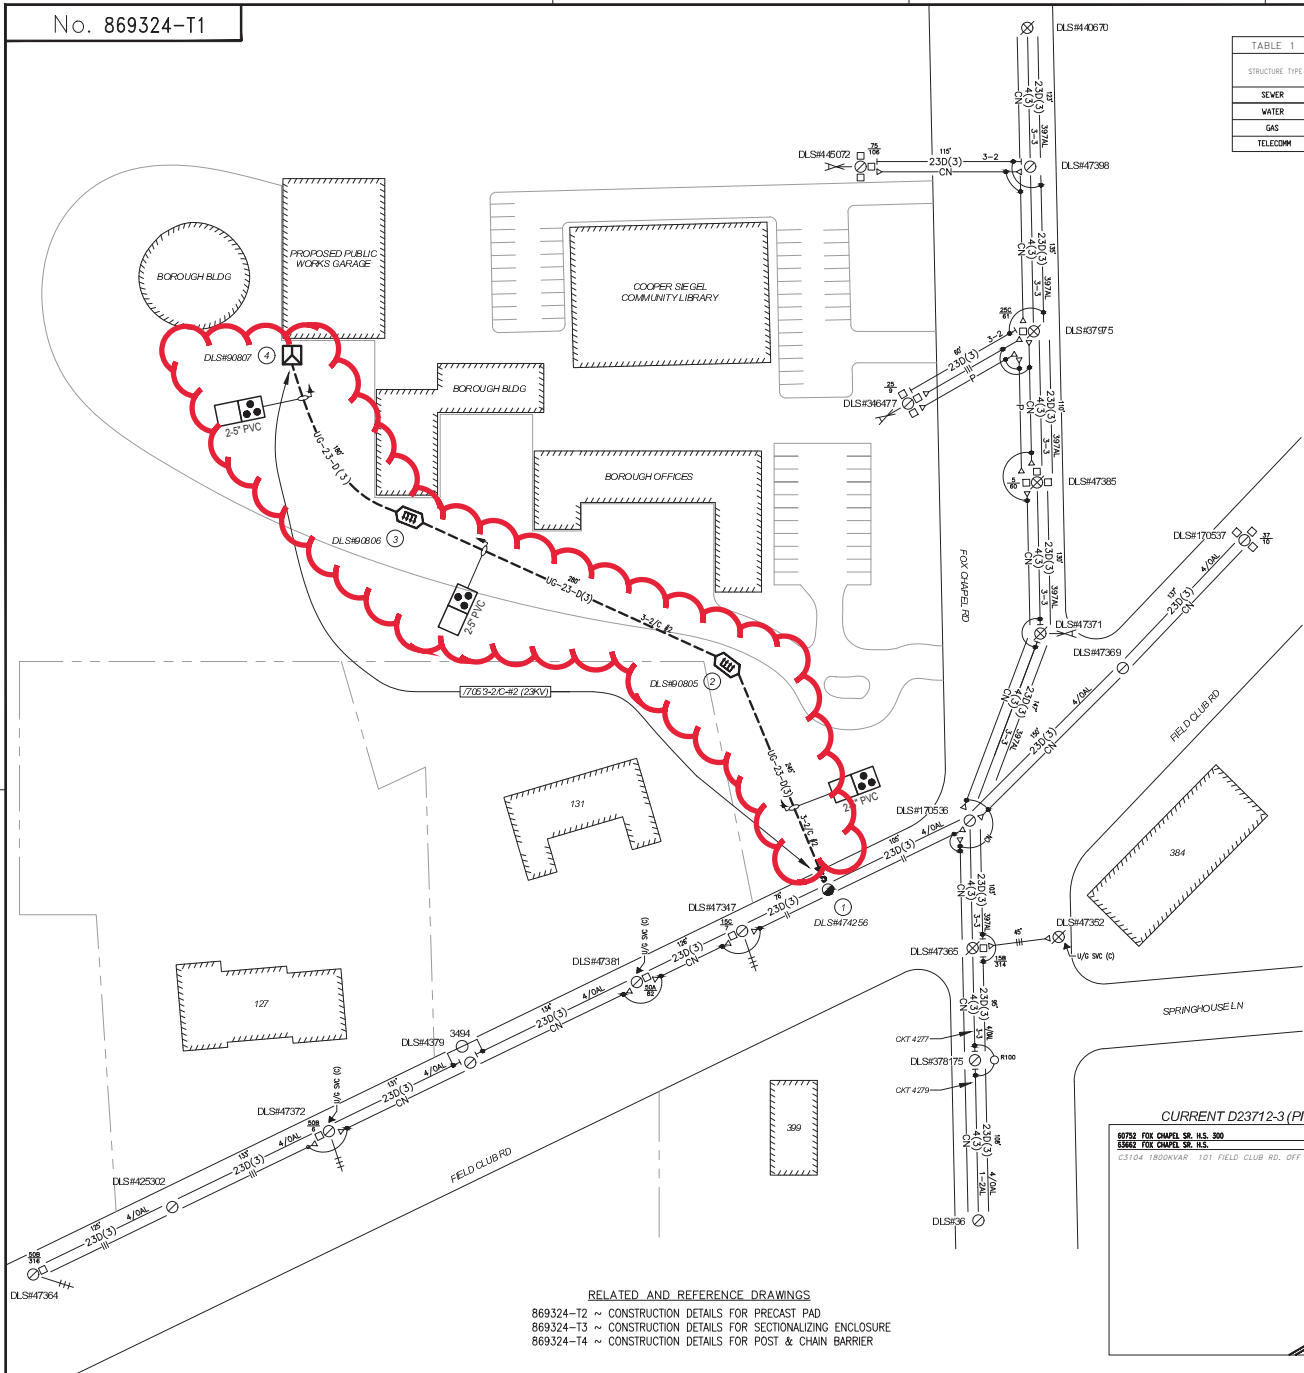


- 1
DLS#474256 - 45(2)
- 45(D)
 - 81 SNA (23KV)
 - (OH-2-ZTC)
 - 30 TERM. POLE
 - (23KV) (OH-15-24.1)
 - 3-23K FUSES
 - 1-CN BKT





- 2
SITE #80806
- 30 SECTIONALIZER
 - (23KV) (LFD-11-42)
 - 6-LB ELBOWS
 - 6-DE RECEPTACLES
- NOTE: CUSTOMER TO INSTALL BOLLARDS AROUND SECTIONALIZER PER DLC SPECS AFTER DLC INSTALLS SECTIONALIZER.

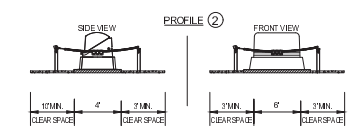

- 3
SITE #80809
- 30 SECTIONALIZER
 - (23KV) (LFD-11-42)
 - 6-LB ELBOWS
 - 6-DE RECEPTACLES
- NOTE: CUSTOMER TO INSTALL BOLLARDS AROUND SECTIONALIZER PER DLC SPECS AFTER DLC INSTALLS SECTIONALIZER.

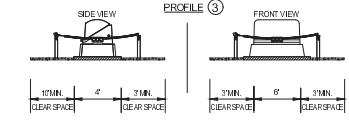



- 4
SITE #80807
- 75KVA (23KV) 30 4W
 - (120/208V) PAD MTD
 - XFMR
- NOTE: CUSTOMER TO INSTALL BOLLARDS AROUND TRANSFORMER PER DLC SPECS

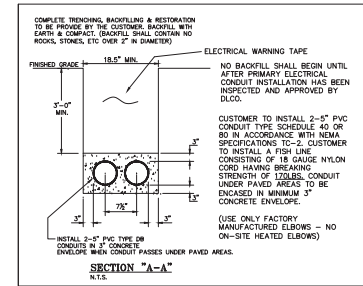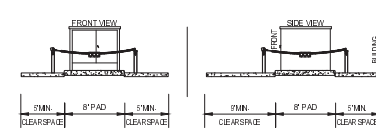


- LEGEND
- - EMPTY CONDUIT
 - ⊕ - INSTALL 3-2C #2AL
 - ⊕ - DLCO TRANSFORMER
 - ⊕ - DLCO SECTIONALIZING ENCLOSURE
 - - EXISTING 100% DLC OWNED POLE
 - ⊕ - INSTALL/REPLACE DLC OWNED POLE
 - ⊕ - JOINT VZ OWNED POLE
 - - UTILITY POLE W/ 10 TRANSFORMER
 - - UTILITY POLE W/ 30 TRANSFORMERS

RELATED AND REFERENCE DRAWINGS


- 869324-T2 ~ CONSTRUCTION DETAILS FOR PRECAST PAD
- 869324-T3 ~ CONSTRUCTION DETAILS FOR SECTIONALIZING ENCLOSURE
- 869324-T4 ~ CONSTRUCTION DETAILS FOR POST & CHAIN BARRIER

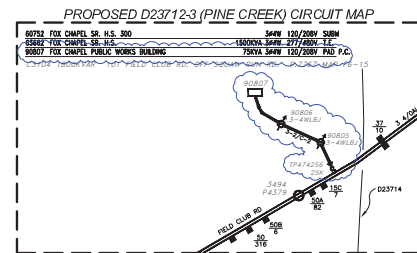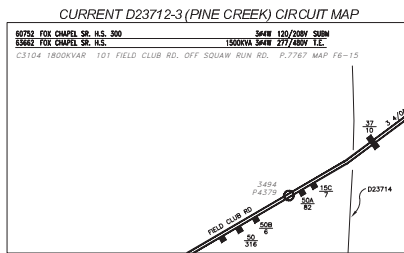

REVISIONS					DLC DUGUESNE LIGHT CO. T.&D ENGINEERING		NEW COMMERCIAL SERVICE - FOX CHAPEL PUBLIC WORKS BUILDING	
	SCALE	DRAWN BY	DATE	INCH. CHECKED	DATE	401 FOX CHAPEL RD PITTSBURGH, PA 15238 FOX CHAPEL		
	N.T.S.	S. BOOTH	09/09/2021	D. ALEXANDER	09/14/2021	CONSTRUCTION DETAILS AND CONDUIT PLAN		
	DRAWN BY	DATE	INCH. CHECKED	DATE	INSTALL (1) 45(2) POLE, (2) SECTIONALIZERS & (1) 75KVA PAD MTD XFMR		ANSI	
	S. BOOTH	09/09/2021	D. ALEXANDER	09/14/2021	D		REV. NO.	
						20-0005	869324-T1	
							0	

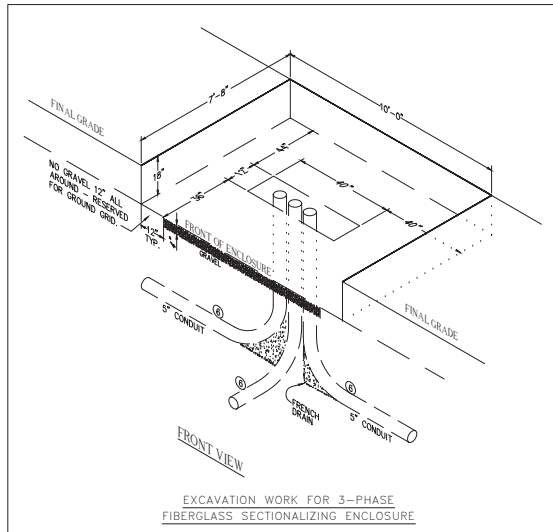


EXCAVATION WORK FOR 3-PHASE FIBERGLASS SECTIONALIZING ENCLOSURE

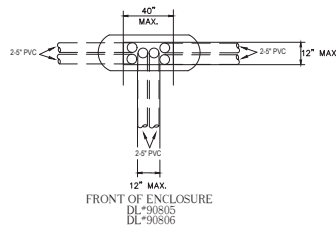


NOTE: ALL CONDUITS MUST BE CENTERED WITHIN THE 12" X 40" SPACE.



TYPICAL CONDUIT AND SWEEP PLACEMENT AREA FOR SECTIONALIZING ENCLOSURE (8 BENDS MAX)

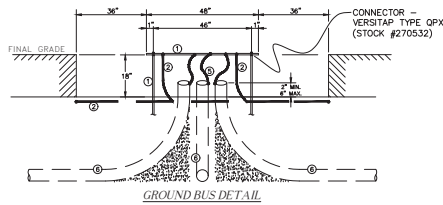


GROUND BUS DETAIL

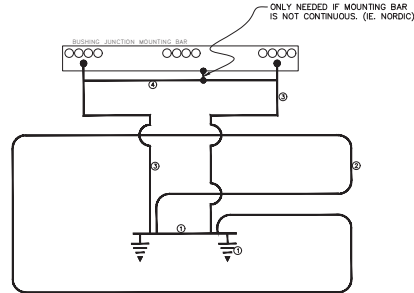

GROUNDING SCHEMATIC

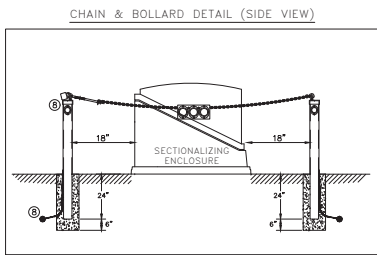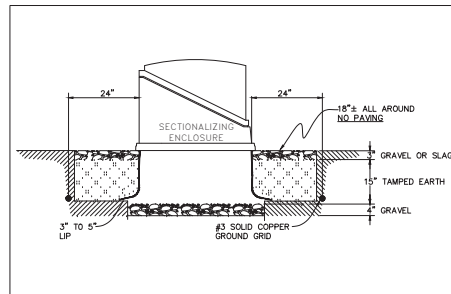

CHAIN & BOLLARD DETAIL (SIDE VIEW)

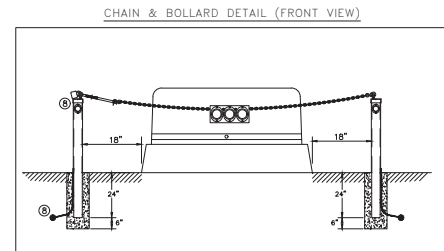

CHAIN & BOLLARD DETAIL (FRONT VIEW)

GENERAL NOTES:

- ALL EQUIPMENT AND WORK SHALL CONFORM WITH THE NATIONAL ELECTRICAL SAFETY CODE AND APPLICABLE UNDERWRITERS' AND GOVERNMENTAL BUILDING CODES. CERTAIN ITEMS AS NOTED ON THIS DRAWING ARE SUBJECT TO INSPECTION AND APPROVAL BY THE DUQUESNE LIGHT COMPANY. FOR DUQUESNE LIGHT COMPANY INSPECTION, CALL SHAWN BOOTH @ 412-383-2610.
- DUQUESNE LIGHT COMPANY IS TO HAVE THE RIGHT OF INGRESS AND EGRESS AT ALL TIMES. DLCD SHALL BE ABSOLVED FROM ALL PROPERTY DAMAGES DUE TO NON-NEGLIGENT INGRESS OR EGRESS OF DLCD PERSONNEL OR EQUIPMENT.

DUQUESNE LIGHT CO. WORK:

- INSTALL TWO 5/8" X 9' COPPERWELD GROUND RODS 46" APART AND 6" BEHIND CUSTOMER'S CONDUIT. INSTALL ONE 1/2" X 48" SOLID COPPER ROD (STK #480740) ACROSS THE TOPS OF THE DRIVEN GROUND RODS AND CONNECT WITH A VERSTAP TYPE GPX CONNECTOR (STOCK #270532).
- INSTALL #3 SOFT DRAWN SOLID COPPER GROUND GRID CONTINUOUSLY AROUND ENCLOSURE (24" ALL AROUND) AND CONNECT TO EACH END OF 4/0 BUS ROD USING 4/0 SPLIT BOLT (STOCK #270596).
- INSTALL AND CONNECT TWO #3 TINNED STRANDED COPPER WIRE GROUND STRAPS FROM BUSHING MOUNTING BAR TO 1/2" GROUND BUS USING 4/0 SPLIT BOLT AT BUS (STOCK #270760) AND BOLT TO MOUNTING BAR LUG TYPE CONNECTION WITH SILICON BRONZE OR STAINLESS STEEL BOLTS.
- INSTALL AND CONNECT #3 TINNED STRANDED COPPER WIRE CONNECTING STRAP BETWEEN BUSHING JUNCTION EQUIPMENT GROUND USING #3 SPLIT BOLT (STOCK #270532). THE GROUND END FROM THE HEAD END PLUS SHOULD BE CONNECTED TO THIS STRAP USING THE SAME #3 SPLIT BOLT CONNECTORS. NOTE: IF THE MANUFACTURER HAS SEPARATE MOUNTING BARS (W/ORDC) AN ADDITIONAL #3 TINNED STRANDED COPPER GROUND SHOULD BE CONNECTED FROM THE B# BAR TO THIS STRAP.
- CONNECT CUSTOMER'S CONDUIT GROUNDING COLLARS TO 1/2" BUS USING #3 SOFT DRAWN SOLID COPPER AND CONNECT TO BUS USING 4/0 SPLIT BOLT (STOCK #270596).

NOTE: CONNECT ALL CONCENTRIC NEUTRALS FROM ELBOWS SEPARATELY TO 4/0 SOLID COPPER BUS USING FARGO HOT LINE CLAMPS (STOCK #270076). THIS WILL FACILITATE THE SAFE REMOVAL/INSTALLATION OF ELBOWS WHEN ENCLOSURE IS ENERGIZED.

CUSTOMER WORK:

- INSTALL AT THE PAD, SECTIONALIZING PIT AND/OR POLE 90° ELBOWS. FOR 1# INSTALLATIONS, THE TYPE MAY CONSIST OF ONE OF THE FOLLOWING:
 - A) GALVANIZED STEEL WITH A 40 MIL PVC JACKET, ELBOWS WITH A 36" RADIUS. AT PAD INSTALL A THREADED INSULATED GROUNDING BUSHING ON EACH ELBOW AND CONNECT TO THE GROUND BUS USING #4 SOFT DRAWN COPPER WIRE.
 - B) PVC SCHEDULE 80, TYPE DB, IN ACCORDANCE WITH NEMA SPECIFICATION TCC. THE USE OF PVC ELBOWS WILL NOT REQUIRE THE USE OF GROUNDING BUSHINGS.
- FOR 3# INSTALLATIONS, THE TYPE MAY ONLY CONSIST OF:
 - A) GALVANIZED STEEL WITH A 40 MIL PVC JACKET, ELBOWS WITH A 36" RADIUS. AT PAD INSTALL A THREADED INSULATED GROUNDING BUSHING ON EACH ELBOW AND CONNECT TO THE GROUND BUS USING #4 SOFT DRAWN COPPER WIRE.

EXTEND BENDS 6" INTO PAD OR SECTIONALIZING PIT OPENING OR 6" UP POLE. DRILL 1/2" DIA HOLES OR 7" ORDER IN THE SECTION OF STRAP PIG BEFORE THE ELBOW AND REMOVE ALL INTERNAL BURRS. INSTALL AN 18" X 18" X 24" FRENCH DRAIN. INSTALL AN 1# GAUGE NYLON CORD HAVING A MINIMUM BREAKING STRENGTH OF 170 POUNDS IN EACH CONDUIT. CAP ALL CONDUIT. NO BACKFILLING SHALL BEGIN UNTIL THE PRIMARY ELECTRICAL CONDUIT HAS BEEN INSPECTED AND APPROVED BY DUQUESNE LIGHT COMPANY.

- EXCAVATE PIT FOR SECTIONALIZING ENCLOSURE AS SHOWN. ENCLOSURE TO BE A MINIMUM OF 5' FROM VEHICULAR TRAFFIC AND HAVE 9' X 9' CLEAR LEVEL UNRESTRICTED WORK AREA AT FRONT OF ENCLOSURE.
- INSTALL A POST AND CHAIN BARRIER AS SHOWN AND PER DRAWING NUMBER 869324-T4. CONNECT THE STEEL POSTS TO THE GROUND GRID (INSTALLED BY DLCD) USING #4 SOFT DRAWN SOLID COPPER WIRE. WIRE TO BE EXOTHERMICALLY WELDED TO THE POSTS. THIS PORTION OF THE INSTALLATION WILL NEED TO BE DONE AFTER SECTIONALIZER INSTALLATION BY DLCD. DLCD TO LEAVE GROUND GRID EXPOSED FOR CUSTOMER TO CONNECT TO THE GROUND GRID.
- THE EXCAVATION SHALL HAVE A FINAL INSPECTION BY DUQUESNE LIGHT CO. PRIOR TO THE INSTALLATION OF THE SECTIONALIZING ENCLOSURE. CALL SHAWN BOOTH @ 412-383-2610.

NOTE: ALL PRIMARY EQUIPMENT SHALL BE NO CLOSER THAN 5' FROM THE CURB. THE BACK OF THE EQUIPMENT NO FURTHER THAN 11' FROM THE CURB.

RELATED AND REFERENCE DRAWINGS


- 869324-T1 ~ CONSTRUCTION DETAILS & CONDUIT PLAN
- 869324-T2 ~ CONSTRUCTION DETAILS FOR PRECAST PAD
- 869324-T4 ~ CONSTRUCTION DETAILS FOR POST & CHAIN BARRIER




DUQUESNE LIGHT CO. T&D ENGINEERING					
SCALE	DRAWN BY	DATE	ENGR. CHKD	DATE	
N.T.S.	S. BOOTH	09/11/2021	D. ALEXANDER	09/13/2021	
	DRAWN CHG#	DATE	ENGR. APPR.	DATE	
	S. BOOTH	09/11/2021	D. ALEXANDER	09/13/2021	

NEW COMMERCIAL SERVICE - FOX CHAPEL PUBLIC WORKS BUILDING		FOX CHAPEL	
401 FOX CHAPEL RD. PITTSBURGH, PA 15238			
CONSTRUCTION DETAILS & ELECTRICAL LAYOUT			
SECTIONALIZING ENCLOSURE			
ANSI	FIG. NO.	FIG. NO.	REV. NO.
D	20-0005	869324-T3	0

REVISIONS

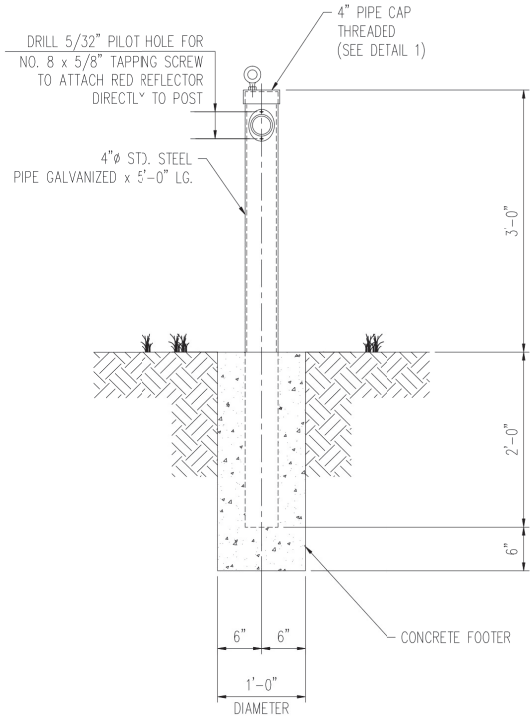


POST MK. P1
AS REQ'D

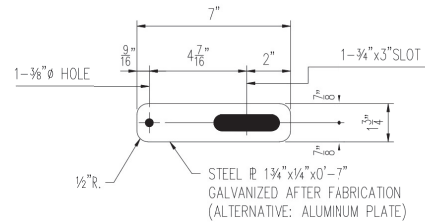


LOCK STRAP
1 - REQ'D

(SCALE: 3"=1'-0")

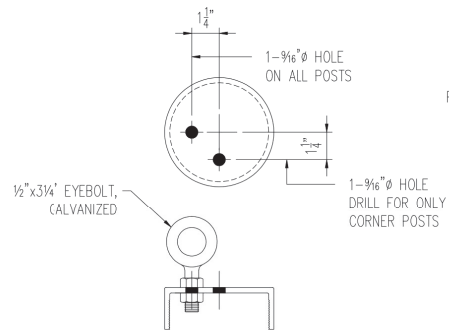


DETAIL 1
PIPE CAP ASSEMBLY

(SCALE: 1 1/2"=1'-0")

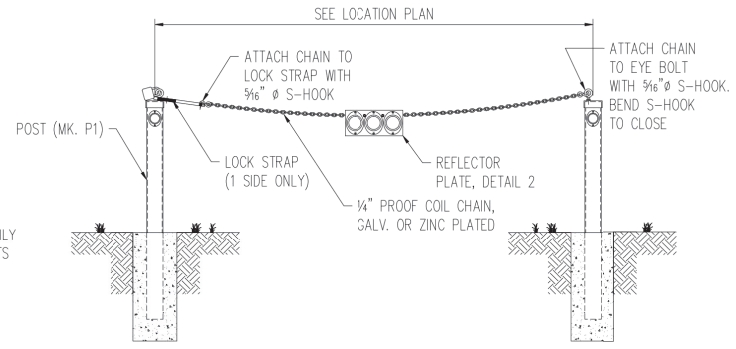

POST & CHAIN BARRIER

(SCALE: 2"=1'-0")

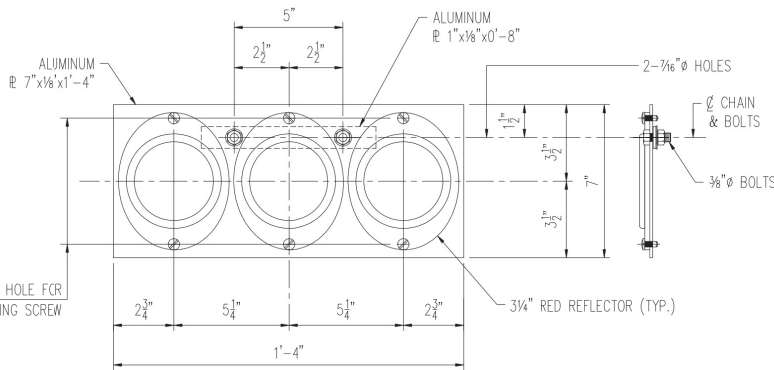

DETAIL 2
AS REQ'D

(SCALE: 3"=1'-0")

RELATED AND REFERENCE DRAWINGS
869324-T1 ~ CONSTRUCTION DETAILS & CONDUIT PLAN
869324-T2 ~ CONSTRUCTION DETAILS FOR PRECAST PAD
869324-T3 ~ CONSTRUCTION DETAILS FOR SECTIONALIZING ENCLOSURE

REVISIONS



DLC DUGUESNE LIGHT CO. T&D ENGINEERING			
SCALE	DRAWN BY	DATE	ENGR. CHECKED
N.T.S.	S. BOOTH	09/11/2021	D. ALEXANDER
	DATE	DATE	DATE
	09/11/2021	09/13/2021	09/13/2021

NEW COMMERCIAL SERVICE - FOX CHAPEL PUBLIC WORKS BUILDING		FOX CHAPEL	
401 FOX CHAPEL RD., PITTSBURGH, PA 15238		FOX CHAPEL	
CONSTRUCTION DETAILS			
POST AND CHAIN BARRIER			
ANSI	FIG. NO.	FIG. NO.	REV. NO.
D	20-0005	869234-T4	0