


PECO Exhibit GP-1 C-2015-2475335
Landis + Gyr AMR System 11/15/16, Phila, 3R
(2000 – Present)

RECEIVED
2016 DEC 15 AM 10:41
PA PIC
SECRETARY'S BUREAU

Landis+Gyr AMR System

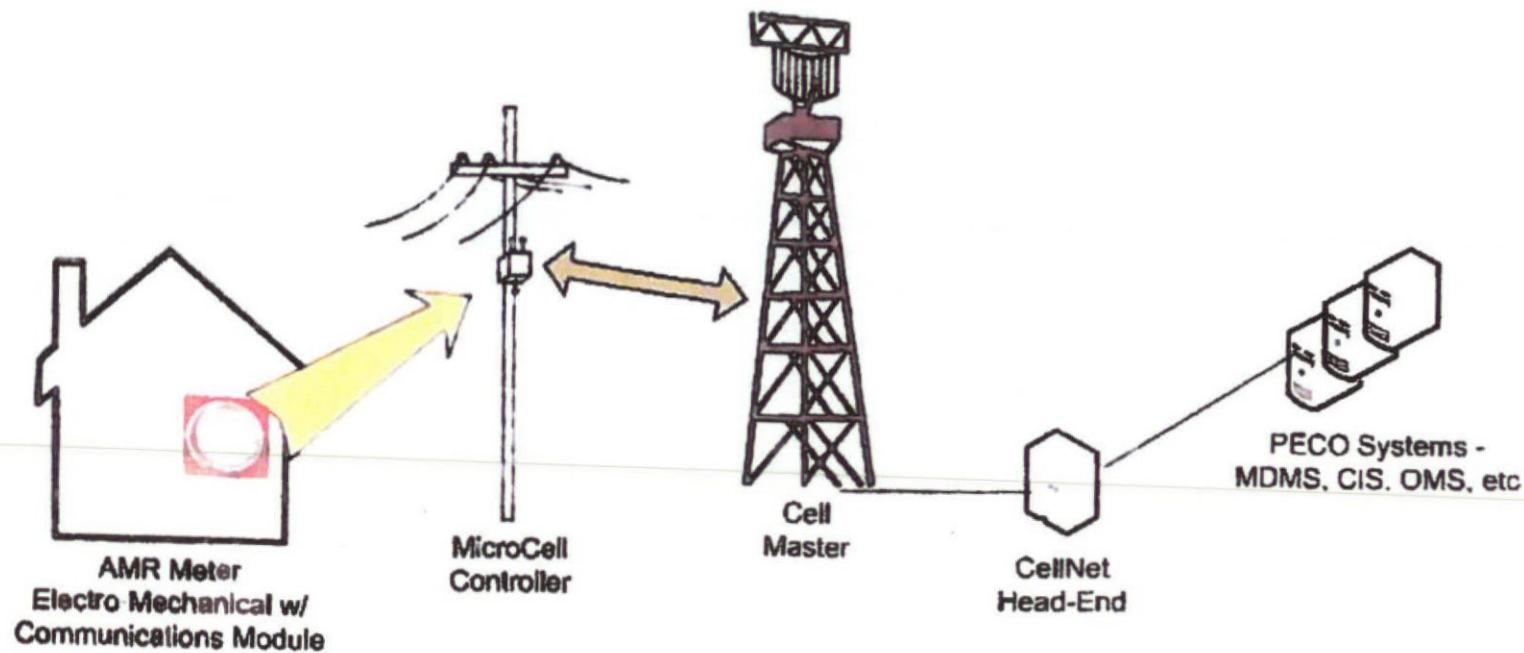


PECO Exhibit GP-2

*C-2015-2475355
11/15/16, Phila, PA*


Sensus AMI System

(2011 – Present)

RECEIVED
2016 DEC 15 AM 10:41
P.A. PUC
SECRETARY'S BUREAU



Sensus AMI System

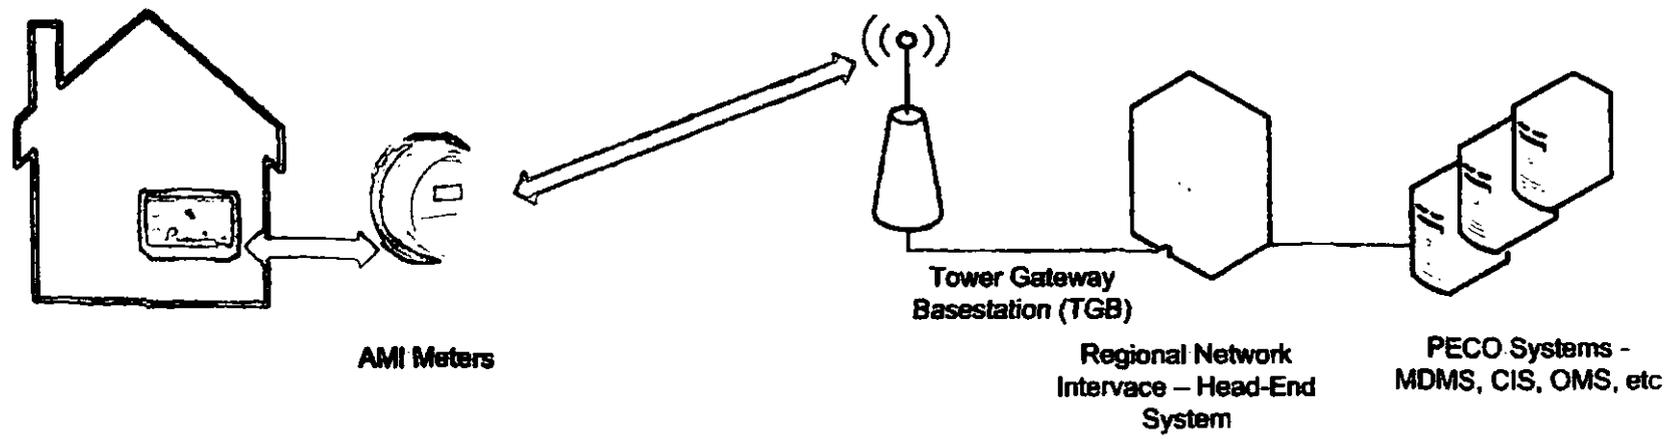

PECO Exhibit GP-3
Select Tariff Rules

C-2015-2475355
11/15/16, Phila, 3k

RECEIVED
2016 DEC 15 AM 10:41
PA PUBLIC
SECRETARY'S BUREAU

Exhibit GP-3 Selected Provisions of PECO's Electric Service Tariff

3.2 METER LOCATION. There shall be provided, free of expenses to the Company, at a location outdoors, unless otherwise designated by the Company or another AMSP, which the Company or another AMSP will designate in writing upon request, a suitable place for the meter or meters and any other supply, protective or control equipment of the Company or another AMSP which may be required in the provision of service. The customer shall provide access and space, in an amount deemed necessary by the Company, to install and maintain its meter(s) and equipment. This location shall be convenient, unimpeded and easily accessible to the Company's employees, contactors and agents. The Customer shall also minimize any risk for damage and/or harm to the Company's employees, contractors, agents and equipment at the meter location. There also must not be any impediment or obstruction of the Company's ability to receive, an adequate communication signal from its meter(s) for remote reading purposes. The meter(s) location shall also be situated so that the meter(s) are not concealed, but shall be situated in a fashion acceptable to the Company.

Exhibit GP-3 Selected Provisions of PECO's Electric Service Tariff

3.4 SERVICE ENTRANCE EQUIPMENT. All equipment beyond the point of delivery, except the meter, shall be installed by the customer. Installation shall be in conformity with the National Electrical Code and the Company's published "Electric Service Requirements", and shall include, where necessary, an approved sealable device for mounting a meter. The meter will be supplied, owned and sealed by the Company or another AMSP.

Exhibit GP-3 Selected Provisions of PECO's Electric Service Tariff

6.2 SERVICE - SUPPLY ALTERATIONS. Changes related to a service-supply line or a meter owned by the Company, including the installation of protective devices or visual markers to denote safe operating distance from the Company's facilities, for the accommodation of the customer, shall be at the expense of the customer. If the alteration to the Company's facilities is temporary in nature and the materials used in that alteration can later be re-used by the Company, as for example the installation of protective "hard cover" to allow a customer, developer, or contractor to work safely in close proximity to the Company's facilities, then at the Company's discretion it may charge a refundable deposit in lieu of charging the customer for the cost of the re-usable materials.

Exhibit GP-3 Selected Provisions of PECO's Electric Service Tariff

14.1 SUPPLY OF METERS. An EGS that is also an AMSP may provide Advanced Meter Services in accordance with the Electric Generation Supplier Coordination Tariff. Otherwise, subject to Rules 14.3 and 14.9, the measurement of service for billing purposes shall be by meters furnished and installed by the Company. The Company will select the type and make of metering equipment to be used for meters supplied by the Company, and may, from time to time, change or alter the equipment, its sole obligation being to supply meters that will accurately and adequately furnish records for billing purposes. In fulfilling its obligations with respect to metering and meter reading, and with respect to AMSPs that provide Advanced Meter Services, the Company will comply with Electric Generation Supplier Coordination Tariff.

PECO Exhibit GP-4 C-2015-2475355
11/15/16, Phila, 3A
Map Showing AMI Meters Near Paul Residence

RECEIVED

2016 DEC 15 AM 10:41

SECRETARY'S BUREAU
PA PUC

