

Darsh Singh, Esq.  
(610) 212-8331  
(330) 315-9263 (Fax)

August 24, 2023

**VIA E-FILING**

Rosemary Chiavetta, Secretary  
Pennsylvania Public Utility Commission  
Commonwealth Keystone Building  
400 North Street, 2<sup>nd</sup> Floor  
Harrisburg, PA 17120

**Re: Completed Restoration of Momentary and Sustained Interruptions –  
Metropolitan Edison Company; Docket No. M-2021-3023564**

Dear Secretary Chiavetta:

Pursuant to 52 Pa. Code § 67.1, Metropolitan Edison Company (“Met-Ed”) submits written notification of completed restoration efforts following storm conditions that began on August 7, 2023 that caused multiple service interruptions in the Met-Ed service territory.

Attached please find the details relative to the impact of this recent outage event and the restoration activities that took place. It should be noted that the review and approval process of this outage information is still in progress at the time of filing this report and as such, all outage information contained in this report should be considered preliminary.

If you have any questions, please contact me at (610) 212-8331.

Sincerely,



Darsh Singh

Enclosures

c: Dan Searfoorce - PaPUC Bureau of Technical Utility Services (via electronic mail)  
Derek Ruhl - PaPUC Bureau of Technical Utility Services (via electronic mail)  
John Van Zant - PaPUC Bureau of Technical Utility Services (via electronic mail)  
Harry Bidelspach – PaPUC Bureau of Technical Utility Services (via electronic mail)

ELECTRIC UTILITY REPORT OF OUTAGE TO  
PENNSYLVANIA PUBLIC UTILITY COMMISSION  
SECRETARY'S BUREAU  
P O BOX 3265  
HARRISBURG, PA 17105-3265

1. Reporting Utility: Metropolitan Edison Company ("Met-Ed")  
Address: 800 Cabin Hill Drive  
Greensburg, PA 15601
  
2. Name and title of person making report:  
Scott Wyman President, Pennsylvania Operations  
*(Name)* *(Title)*
  
3. Telephone number: (814) 444-2026  
*(Telephone Number)*
  
4. Date and time report was made to Commission:  
August 7, 2023 2047  
*(Date)* *(Time)*
  
5. Interruption or Outage:
  - (a) Number of customers affected: 69,434 (Represents 12% of Met-Ed's total customers)
  - (b) Approximate number of outage cases and trouble cases for each county affected during event: See response to 5(c).
  - (c) Approximate number of outages for each county affected during the event:

County	Outages	Outage Cases	Trouble Cases
Adams	494	9	12
Berks	7,801	200	267
Bucks	5,245	52	73
Chester	647	4	5
Cumberland	864	6	9
Dauphin	272	7	3
Lancaster	254	6	8
Lebanon	117	9	25
Lehigh	99	5	6
Monroe	9,252	55	113
Montgomery	427	18	34
Northampton	9,014	78	175
Pike	437	5	8
York	34,511	394	1,028
<b>Total</b>	<b>69,434</b>	<b>848</b>	<b>1,766</b>

- (d) Approximate number of outage cases exceeding 6 or more hours in duration: 603
- (e) A listing of each outage case exceeding 6 or more hours in duration:  
See Attachment A.

Reason for the interruption or outages: Beginning Monday afternoon, August 7, 2023, a weather system moved through Pennsylvania, including the Met-Ed service territory. The system produced storms with heavy precipitation, lightning, and straight line wind gusts estimated by the National Weather Service to be between 70 and 85 miles per hour. In addition to the straight line winds, the National Weather Service confirmed an EF1 tornado with winds of up to 107 miles per hour touched down in southern York County. This severe weather resulted in extensive damage including downed trees and wires, damaged or broken poles and crossarms, and damaged transformers and substations. In one area, a complete line rebuild was required to provide a source to restore customers when wind brought down 10 poles.

Multiple challenges were encountered during this restoration effort. Initially, crews reported that the amount of damage in a concentrated area made travel difficult and hindered the assessment process. The main challenge, however, was the limited availability to back feed and restore customers due to the damage sustained. This occurred in the York and Easton Districts, where damage to distribution lines feeding to and from substations resulted in lock outs and loss of feeders. In the Stroudsburg

district, a transformer at the Snydersville substation failed as a result of the storm damage and required the relocation and installation of a mobile substation in order to restore customers. In addition to these challenges, on Thursday, August 10, 2023, as crews were working to restore service to customers, the Met-Ed service territory experienced heavy precipitation throughout the day which slowed the restoration progress.

The York, Easton, and Stroudsburg districts were the hardest hit areas. Approximately 58.5% of the total outages that occurred were tree related with an additional 10.1% wind related. See Attachment B for the maximum wind gusts and the 24-hour total precipitation for August 7, 2023 and 24-hour total precipitation for August 10, 2023.

In total, Met-Ed had 1,099 line, forestry, hazard responders, and other supporting personnel working to restore service to affected customers. These personnel included Met-Ed employees, FirstEnergy affiliate employees, and contractors. See the response to 5(h) below for a complete list of personnel.

Met-Ed activated its Local Water & Ice Program at several Giant Food locations in the Easton and Stroudsburg districts August 9 through August 10, and in the York district from August 9 through August 11. Customers without power were eligible for two bags of ice and two gallons of water daily, free of charge.

Met-Ed Regional External Affairs Consultants (“EACs”) provided regular updates to emergency management agency directors, state and local elected officials, municipal officials, and first responders via email, phone, and text for the duration of the event. Communications responded to numerous media inquiries on storm restoration status throughout the event and communicated water and ice locations to reporters in the locations where activated. Storm messages were published to Facebook and Twitter before, during, and after the event. This included safety reminders, information on how to report outages and downed power lines, the status of restoration efforts, and water and ice locations. An email was also sent to customers in Northampton, Monroe, and York counties with information about water and ice locations, tips to safely manage through a power outage, and information on how to get restoration updates. Additionally, customers were able to stay informed about service restoration by utilizing the suite of web and mobile tools that are made available by Met-Ed.

Approximately 65% of customers were restored within 24 hours, 77% were restored within 48 hours, and 95% were restored within 72 hours. Preliminary data indicates the reliability impact of the storm was 161.2 minutes of SAIDI, 0.12 of SAIFI frequency, and an overall storm CAIDI of 1,342.4 minutes.

- (g) Projected time of restoration: It was initially estimated that the majority of customers affected by the Monday storms and tornado would be restored by 2300 on August 10, 2023. The discovery of additional damage, as well as the inclement weather on

Thursday, August 10, 2023, resulted in the estimated time of restoration being extended to 1800 on August 11, 2023.

See Attachment C for the restoration curve and Attachment D for the order restoration graphs.

- (h) The number of utility workers, contract workers, and workers received as mutual aid assigned specifically to the repair work by general function:

<b>Company</b>	<b># of Workers</b>	<b>General Function</b>
Met-Ed	210	Line Workers
Cleveland Electric Illuminating Co.	21	Line Workers
Ohio Edison	46	Line Workers
Penelec	58	Line Workers
Penn Power	12	Line Workers
Toledo Edison	20	Line Workers
West Penn Power	46	Line Workers
<b>Subtotal</b>	<b>413</b>	<b>Line Workers</b>
Agostino Utilities LLC	25	Line Contractors
Frankart Power Line Services	25	Line Contractors
Henkels & McCoy	40	Line Contractors
IB Able	8	Line Contractors
NG Gilbert	20	Line Contractors
JW Didado	18	Line Contractors
Thompson Electric	9	Line Contractors
Miller Bros.	15	Line Contractors
Valiant Energy Service	9	Line Contractors
<b>Subtotal</b>	<b>169</b>	<b>Line Contractors</b>
Davey Tree	30	Forestry Contractor
Lewis Tree	139	Forestry Contractor
Penn Line Services, Inc.	26	Forestry Contractor
Nelson Tree	18	Forestry Contractor
York Tree Family	5	Forestry Contractor
<b>Subtotal</b>	<b>218</b>	<b>Forestry Contractor</b>
Met-Ed	74	Hazard Responder/Damage Assessor
FirstEnergy Service Co.	43	Hazard Responder/Damage Assessor
Ohio Edison	2	Hazard Responder/Damage Assessor

Company	# of Workers	General Function
Penelec	62	Hazard Responder/Damage Assessor
West Penn Power	56	Hazard Responder/Damage Assessor
<b>Subtotal</b>	<b>237</b>	<b>Hazard Responder/Damage Assessor</b>
Penelec	4	Substation/Network
West Penn Power	1	Substation/Network
<b>Subtotal</b>	<b>5</b>	<b>Substation/Network</b>
Met-Ed	30	Supporting Roles
Cleveland Electric Illuminating Co.	2	Supporting Roles
FirstEnergy Service Co.	5	Supporting Roles
Ohio Edison	6	Supporting Roles
Penelec	2	Supporting Roles
Penn Power	2	Supporting Roles
Toledo Edison	2	Supporting Roles
Various Contractors	8	Supporting Roles
<b>Subtotal</b>	<b>57</b>	<b>Supporting Roles</b>
<b>Grand Total</b>	<b>1,099</b>	

- (i) The date and time of the first information of a service interruption: August 7, 2023 at 1652.
- (j) The date and time that repair crews were assembled: Scheduled crews were held over with additional crews called in as needed.
- (k) The actual time that service was restored to the last affected customer: August 12, 2023 at 1646.
- (l) A general description of the physical damage sustained by the utility facilities as a result of the interruption/outage:

Equipment	Number
Primary Spans Down	929
Secondary Spans Down	169
Crossarms Replaced	319
Cutouts Replaced	209
Poles Replaced	159
Transformers Replaced	99
Wire & Cable Replaced (feet)	33,660

- (m) If the interruption/outage event was weather-related, the utility’s weather reports, outlooks, or scenarios for the day before and the day of the interruption/outage event:

See Attachment E for the weather forecast reports.

If the interruption/outage event caused approximate outages that exceed 10% or more of the number of customers in the utility’s entire service territory, rank the event in terms of the number and duration of outages and provide 2 comparable events, including the number and duration of outages for those comparable events.

The below chart reflects a ranking of the subject event in relation to two comparable Penn Power events (based on the number and duration of outages).

Rank by Number of Outages	Operating Company	Date	Event Description	Duration (hours)	Customers Affected
1	Met-Ed	May 15 to May 20, 2018	Thunderstorms	126 hours 17 minutes	111,894 (19.9%)
2	Met-Ed	<b>August 7 to August 12, 2023</b>	<b>Thunderstorms /Tornado</b>	<b>119 hours 54 minutes</b>	<b>69,434 (12%)</b>
3	Met-Ed	September 1 to September 6, 2021	Tropical Storm Ida	113 hours 19 minutes	61,317 (10.7%)

Remarks: The storm statistics contained in this report are preliminary. The review and approval of the storm statistics were still in progress as of the time this report was filed.

**Attachment A: A listing of each outage case exceeding six or more hours in duration, including the following information<sup>1</sup>:**

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
596516	York	4	7,158	8/7/2023 17:17	8/12/2023 16:35
599494	York	2	7,146	8/7/2023 17:40	8/12/2023 16:46
597678	York	11	7,037	8/7/2023 17:24	8/12/2023 14:41
598714	York	9	6,981	8/7/2023 17:24	8/12/2023 13:45
598725	York	11	6,913	8/7/2023 17:24	8/12/2023 12:37
589684	York	2	6,823	8/7/2023 17:17	8/12/2023 11:00
596392	York	1	6,793	8/7/2023 17:28	8/12/2023 10:41
598721	York	2	6,106	8/7/2023 17:24	8/11/2023 23:10
592464	York	6	6,044	8/7/2023 17:20	8/11/2023 22:04
596091	York	2	6,025	8/7/2023 17:20	8/11/2023 21:45
598752	York	18	5,994	8/7/2023 17:28	8/11/2023 21:22
587520	York	25	5,992	8/7/2023 17:30	8/11/2023 21:22
580224	York	133	5,981	8/7/2023 17:29	8/11/2023 21:10
587529	York	18	5,960	8/7/2023 17:40	8/11/2023 21:00
597905	York	55	5,954	8/7/2023 17:24	8/11/2023 20:38
591110	York	2	5,905	8/7/2023 20:00	8/11/2023 22:25
597953	York	3	5,834	8/7/2023 17:24	8/11/2023 18:38
598342	York	14	5,815	8/7/2023 17:24	8/11/2023 18:19
596697	York	6	5,814	8/7/2023 17:24	8/11/2023 18:18
593230	York	10	5,783	8/7/2023 17:08	8/11/2023 17:31
595414	York	40	5,765	8/7/2023 17:20	8/11/2023 17:25
594884	York	129	5,755	8/7/2023 17:20	8/11/2023 17:15
598123	York	510	5,751	8/7/2023 17:24	8/11/2023 17:15
596648	York	45	5,718	8/7/2023 17:24	8/11/2023 16:42
596629	York	81	5,676	8/7/2023 17:24	8/11/2023 16:00
596382	York	23	5,643	8/7/2023 17:24	8/11/2023 15:27
596407	York	5	5,627	8/7/2023 17:14	8/11/2023 15:01
595117	York	8	5,619	8/7/2023 17:14	8/11/2023 14:53
589624	York	1	5,591	8/7/2023 17:17	8/11/2023 14:28

<sup>1</sup> When applicable, the individual restoration steps for an order are provided for those customers that were out of service for 6 hours or more.

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
580147	York	282	5,589	8/7/2023 17:23	8/11/2023 14:32
594884	York	9	5,580	8/7/2023 17:20	8/11/2023 14:20
594883	York	22	5,580	8/7/2023 17:20	8/11/2023 14:20
591215	York	2	5,549	8/7/2023 17:57	8/11/2023 14:26
596525	York	3	5,543	8/7/2023 17:21	8/11/2023 13:44
596606	York	1	5,542	8/7/2023 17:38	8/11/2023 14:00
584825	York	22	5,529	8/7/2023 17:08	8/11/2023 13:17
595363	York	13	5,521	8/7/2023 17:14	8/11/2023 13:15
592522	York	250	5,501	8/7/2023 17:08	8/11/2023 12:49
597998	York	3	5,497	8/7/2023 17:24	8/11/2023 13:01
595117	York	196	5,470	8/7/2023 17:14	8/11/2023 12:24
595265	York	1	5,450	8/7/2023 17:30	8/11/2023 12:20
592425	York	2	5,442	8/7/2023 17:20	8/11/2023 12:02
596696	York	10	5,413	8/7/2023 17:24	8/11/2023 11:37
596693	York	45	5,401	8/7/2023 17:24	8/11/2023 11:25
593026	York	3	5,394	8/7/2023 21:08	8/11/2023 15:02
593670	York	4	5,379	8/7/2023 17:27	8/11/2023 11:06
589692	York	2	5,348	8/8/2023 19:43	8/12/2023 12:51
597793	York	44	5,319	8/7/2023 17:30	8/11/2023 10:09
593526	York	2	5,299	8/7/2023 17:27	8/11/2023 9:46
589890	York	1	5,282	8/8/2023 20:25	8/12/2023 12:27
581068	Lancaster	8	5,133	8/7/2023 18:04	8/11/2023 7:37
598146	York	1	4,845	8/8/2023 8:25	8/11/2023 17:10
580728	York	36	4,679	8/7/2023 17:49	8/10/2023 23:48
580657	York	112	4,590	8/7/2023 17:30	8/10/2023 22:00
585528	York	1	4,578	8/8/2023 5:17	8/11/2023 9:35
587699	York	426	4,555	8/7/2023 17:21	8/10/2023 21:16
595208	York	1	4,553	8/7/2023 18:29	8/10/2023 22:22
594977	York	1	4,540	8/7/2023 17:08	8/10/2023 20:48
591891	York	12	4,509	8/7/2023 17:43	8/10/2023 20:52
594605	York	22	4,494	8/7/2023 17:25	8/10/2023 20:19
596515	York	2	4,481	8/7/2023 17:14	8/10/2023 19:55
593938	York	141	4,473	8/7/2023 17:29	8/10/2023 20:02
595373	York	1	4,472	8/7/2023 17:14	8/10/2023 19:46

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
589658	York	30	4,458	8/7/2023 17:17	8/10/2023 19:35
589800	York	12	4,452	8/7/2023 17:38	8/10/2023 19:50
592548	York	18	4,431	8/7/2023 17:29	8/10/2023 19:20
595344	York	66	4,419	8/7/2023 17:14	8/10/2023 18:53
596116	York	6	4,410	8/7/2023 17:24	8/10/2023 18:54
596332	York	18	4,406	8/7/2023 17:34	8/10/2023 19:00
593499	York	36	4,395	8/7/2023 17:30	8/10/2023 18:45
595500	York	100	4,386	8/7/2023 17:14	8/10/2023 18:20
596119	York	18	4,365	8/7/2023 17:26	8/10/2023 18:11
593064	York	34	4,352	8/7/2023 17:28	8/10/2023 18:00
587499	York	4	4,347	8/7/2023 18:00	8/10/2023 18:27
584344	York	1	4,344	8/7/2023 17:25	8/10/2023 17:49
595337	York	125	4,334	8/7/2023 17:14	8/10/2023 17:28
592588	York	8	4,325	8/7/2023 17:24	8/10/2023 17:29
594795	York	2	4,307	8/7/2023 17:14	8/10/2023 17:01
589698	York	30	4,307	8/7/2023 17:17	8/10/2023 17:04
593596	York	11	4,306	8/7/2023 17:20	8/10/2023 17:06
593410	York	18	4,287	8/7/2023 17:15	8/10/2023 16:42
596210	York	3	4,283	8/7/2023 17:45	8/10/2023 17:08
595092	York	19	4,283	8/7/2023 17:15	8/10/2023 16:38
593490	York	13	4,263	8/7/2023 17:17	8/10/2023 16:20
591199	York	3	4,249	8/7/2023 17:16	8/10/2023 16:05
596117	York	10	4,242	8/7/2023 17:24	8/10/2023 16:06
596118	York	7	4,241	8/7/2023 17:24	8/10/2023 16:05
596090	York	2	4,240	8/7/2023 17:20	8/10/2023 16:00
588657	York	42	4,239	8/7/2023 17:26	8/10/2023 16:05
593582	York	32	4,237	8/7/2023 17:20	8/10/2023 15:57
593269	York	14	4,227	8/7/2023 17:15	8/10/2023 15:42
595250	York	1	4,208	8/7/2023 17:28	8/10/2023 15:36
593748	York	60	4,207	8/7/2023 17:20	8/10/2023 15:27
592555	York	1	4,204	8/7/2023 17:29	8/10/2023 15:33
592240	York	2	4,185	8/7/2023 17:47	8/10/2023 15:32
587791	York	2	4,170	8/7/2023 17:30	8/10/2023 15:00
592865	Bucks	1	4,169	8/7/2023 19:32	8/10/2023 17:01

## Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
592493	York	2	4,168	8/7/2023 17:24	8/10/2023 14:52
590929	York	50	4,166	8/7/2023 17:28	8/10/2023 14:54
593495	Monroe	2	4,155	8/7/2023 19:45	8/10/2023 17:00
580505	York	93	4,145	8/7/2023 17:41	8/10/2023 14:46
593529	York	27	4,112	8/7/2023 17:27	8/10/2023 13:59
589614	York	15	4,108	8/7/2023 17:17	8/10/2023 13:45
580027	York	1655	4,078	8/7/2023 17:17	8/10/2023 13:15
593668	York	673	4,074	8/7/2023 17:23	8/10/2023 13:17
593500	York	6	4,066	8/7/2023 17:30	8/10/2023 13:16
583577	York	1	4,062	8/7/2023 20:17	8/10/2023 15:59
593217	York	1	4,026	8/7/2023 17:09	8/10/2023 12:15
590167	York	22	4,023	8/7/2023 17:18	8/10/2023 12:21
590193	Northampton	1	4,005	8/7/2023 19:45	8/10/2023 14:30
591255	York	2	4,003	8/7/2023 22:17	8/10/2023 17:00
590099	Berks	59	4,001	8/7/2023 19:00	8/10/2023 13:41
592424	York	4	3,997	8/7/2023 17:37	8/10/2023 12:14
593415	York	48	3,964	8/7/2023 17:15	8/10/2023 11:19
582314	Northampton	11	3,961	8/7/2023 19:36	8/10/2023 13:37
583046	Monroe	1	3,961	8/7/2023 19:52	8/10/2023 13:53
590358	Monroe	8	3,950	8/7/2023 19:47	8/10/2023 13:37
589866	York	11	3,946	8/7/2023 17:20	8/10/2023 11:06
580121	York	347	3,938	8/7/2023 17:20	8/10/2023 10:58
593298	York	20	3,926	8/7/2023 17:49	8/10/2023 11:15
585422	Berks	5	3,918	8/7/2023 19:25	8/10/2023 12:43
594943	Berks	4	3,918	8/7/2023 19:25	8/10/2023 12:43
591828	Monroe	7	3,900	8/7/2023 19:45	8/10/2023 12:45
584555	Northampton	9	3,878	8/7/2023 19:36	8/10/2023 12:14
586841	Berks	1	3,860	8/7/2023 19:17	8/10/2023 11:37
590897	York	1	3,840	8/8/2023 21:03	8/11/2023 13:03
594603	York	17	3,840	8/7/2023 17:25	8/10/2023 9:25
589917	Monroe	3	3,840	8/7/2023 20:20	8/10/2023 12:20
594914	York	3	3,827	8/7/2023 19:58	8/10/2023 11:45
581674	Berks	1	3,822	8/7/2023 18:59	8/10/2023 10:41
593454	Monroe	7	3,774	8/7/2023 19:45	8/10/2023 10:39

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
582960	Berks	1	3,761	8/7/2023 19:49	8/10/2023 10:30
593988	Berks	13	3,742	8/7/2023 18:46	8/10/2023 9:08
593703	Monroe	75	3,680	8/7/2023 19:47	8/10/2023 9:07
585568	Monroe	2	3,673	8/7/2023 20:58	8/10/2023 10:11
581435	Berks	2	3,589	8/7/2023 18:42	8/10/2023 6:31
592433	York	13	3,538	8/7/2023 17:08	8/10/2023 4:06
592967	Bucks	4	3,523	8/8/2023 5:45	8/10/2023 16:28
593194	Monroe	8	3,508	8/7/2023 19:48	8/10/2023 6:16
594176	Berks	2	3,314	8/8/2023 2:18	8/10/2023 9:32
585740	Northampton	1	3,302	8/8/2023 6:38	8/10/2023 13:40
591918	York	110	3,276	8/7/2023 17:29	8/10/2023 0:05
593102	York	30	3,276	8/7/2023 17:29	8/10/2023 0:05
592535	York	3	3,275	8/9/2023 14:50	8/11/2023 21:25
582025	Berks	2	3,253	8/7/2023 18:50	8/10/2023 1:03
580198	York	13	3,235	8/7/2023 17:29	8/9/2023 23:24
581212	York	2	3,202	8/7/2023 18:16	8/9/2023 23:38
580670	York	1	3,091	8/7/2023 17:48	8/9/2023 21:19
581490	Berks	13	3,058	8/7/2023 18:48	8/9/2023 21:46
593270	York	1,090	3,054	8/7/2023 17:15	8/9/2023 20:09
587571	York	34	3,041	8/7/2023 17:27	8/9/2023 20:08
594191	York	4	3,035	8/9/2023 14:36	8/11/2023 17:11
585369	York	31	3,033	8/7/2023 17:30	8/9/2023 20:03
589783	York	25	3,021	8/7/2023 17:26	8/9/2023 19:47
583734	Monroe	1	3,010	8/7/2023 20:28	8/9/2023 22:38
590028	York	3	3,008	8/7/2023 17:37	8/9/2023 19:45
592289	York	2	3,007	8/9/2023 13:13	8/11/2023 15:20
580044	York	7	2,998	8/7/2023 17:15	8/9/2023 19:13
593269	York	744	2,995	8/7/2023 17:15	8/9/2023 19:10
590336	Monroe	62	2,990	8/7/2023 19:49	8/9/2023 21:39
593796	Berks	1	2,988	8/7/2023 19:14	8/9/2023 21:02
583108	Monroe	53	2,978	8/7/2023 19:57	8/9/2023 21:35
580116	York	292	2,974	8/7/2023 17:25	8/9/2023 18:59
581918	Berks	4	2,974	8/7/2023 19:14	8/9/2023 20:48
579978	York	304	2,970	8/7/2023 17:08	8/9/2023 18:38

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
589611	Bucks	7	2,960	8/8/2023 5:01	8/10/2023 6:21
581684	Berks	4	2,938	8/7/2023 19:00	8/9/2023 19:58
591195	York	81	2,927	8/7/2023 17:21	8/9/2023 18:08
592574	York	12	2,926	8/7/2023 17:29	8/9/2023 18:15
586963	York	41	2,915	8/7/2023 17:35	8/9/2023 18:10
579978	York	2	2,911	8/7/2023 17:08	8/9/2023 17:39
593153	Berks	8	2,906	8/7/2023 18:34	8/9/2023 19:00
588419	York	11	2,902	8/7/2023 18:02	8/9/2023 18:24
580265	York	12	2,902	8/7/2023 17:29	8/9/2023 17:51
588783	York	1	2,902	8/7/2023 17:08	8/9/2023 17:30
580135	York	15	2,902	8/7/2023 17:21	8/9/2023 17:43
590369	Monroe	15	2,901	8/7/2023 19:47	8/9/2023 20:08
582895	Monroe	1,273	2,901	8/7/2023 19:47	8/9/2023 20:08
581914	Montgomery	2	2,896	8/7/2023 19:14	8/9/2023 19:30
580613	York	7	2,894	8/7/2023 17:46	8/9/2023 18:00
582814	Monroe	4,591	2,888	8/7/2023 19:45	8/9/2023 19:53
584315	York	1	2,882	8/7/2023 21:19	8/9/2023 21:21
591955	York	9	2,880	8/8/2023 0:00	8/10/2023 0:00
585210	Bucks	17	2,879	8/7/2023 23:17	8/9/2023 23:16
593532	York	1	2,876	8/7/2023 20:04	8/9/2023 20:00
586896	Berks	1	2,875	8/8/2023 10:05	8/10/2023 10:00
581385	Berks	8	2,851	8/7/2023 18:34	8/9/2023 18:05
592359	York	9	2,851	8/7/2023 17:29	8/9/2023 17:00
588244	York	1	2,841	8/8/2023 14:34	8/10/2023 13:55
581793	York	3	2,836	8/7/2023 19:06	8/9/2023 18:22
581782	Montgomery	5	2,821	8/7/2023 19:06	8/9/2023 18:07
581562	Berks	1	2,810	8/7/2023 18:53	8/9/2023 17:43
579978	York	293	2,799	8/7/2023 17:08	8/9/2023 15:47
592735	York	302	2,799	8/7/2023 17:08	8/9/2023 15:47
580313	York	1	2,799	8/7/2023 17:31	8/9/2023 16:10
580851	York	8	2,783	8/7/2023 17:53	8/9/2023 16:16
587262	Berks	1	2,783	8/7/2023 18:57	8/9/2023 17:20
581697	Berks	6	2,783	8/7/2023 19:01	8/9/2023 17:24
581549	Berks	15	2,778	8/7/2023 18:52	8/9/2023 17:10

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
580928	York	18	2,778	8/7/2023 17:57	8/9/2023 16:15
583806	York	1	2,765	8/7/2023 20:33	8/9/2023 18:38
581491	Berks	2	2,761	8/7/2023 18:48	8/9/2023 16:49
580198	York	59	2,760	8/7/2023 17:29	8/9/2023 15:29
595199	York	4	2,750	8/8/2023 22:56	8/10/2023 20:46
583013	Northampton	997	2,744	8/7/2023 19:36	8/9/2023 17:20
580120	York	177	2,738	8/7/2023 17:22	8/9/2023 15:00
583156	Northampton	11	2,734	8/7/2023 19:36	8/9/2023 17:10
592436	Berks	2	2,733	8/8/2023 12:42	8/10/2023 10:15
590156	Berks	8	2,730	8/7/2023 18:55	8/9/2023 16:25
591741	York	2	2,728	8/8/2023 20:32	8/10/2023 18:00
591968	York	45	2,722	8/7/2023 17:33	8/9/2023 14:55
579978	York	473	2,720	8/7/2023 17:08	8/9/2023 14:28
583468	Northampton	305	2,708	8/7/2023 19:35	8/9/2023 16:43
589796	York	25	2,707	8/7/2023 17:29	8/9/2023 14:36
589785	York	38	2,707	8/7/2023 17:29	8/9/2023 14:36
584739	Monroe	32	2,692	8/7/2023 22:35	8/9/2023 19:27
582648	Montgomery	13	2,678	8/7/2023 19:42	8/9/2023 16:20
587373	Northampton	2	2,674	8/7/2023 19:36	8/9/2023 16:10
582887	Northampton	4	2,671	8/7/2023 19:48	8/9/2023 16:19
583261	Northampton	16	2,668	8/7/2023 20:01	8/9/2023 16:29
581547	Berks	31	2,658	8/7/2023 18:52	8/9/2023 15:10
583478	Northampton	1	2,644	8/7/2023 20:11	8/9/2023 16:15
588683	York	10	2,643	8/7/2023 17:59	8/9/2023 14:02
592094	Berks	1	2,643	8/7/2023 19:07	8/9/2023 15:10
581986	Berks	1	2,639	8/7/2023 19:18	8/9/2023 15:17
590435	Berks	18	2,637	8/7/2023 18:46	8/9/2023 14:43
598257	York	1	2,637	8/7/2023 17:23	8/9/2023 13:20
585132	Berks	1	2,630	8/7/2023 19:20	8/9/2023 15:10
598256	York	5	2,618	8/7/2023 17:22	8/9/2023 13:00
596025	York	1	2,614	8/10/2023 15:28	8/12/2023 11:02
581423	Berks	21	2,607	8/7/2023 18:40	8/9/2023 14:07
581466	Berks	13	2,601	8/7/2023 18:45	8/9/2023 14:06
581861	Berks	6	2,585	8/7/2023 19:10	8/9/2023 14:15

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
591931	York	27	2,577	8/7/2023 17:24	8/9/2023 12:21
584706	York	51	2,569	8/7/2023 17:45	8/9/2023 12:34
583275	Berks	2	2,560	8/7/2023 20:02	8/9/2023 14:42
590137	Bucks	14	2,556	8/7/2023 19:32	8/9/2023 14:08
581545	Berks	6	2,553	8/7/2023 18:52	8/9/2023 13:25
580265	York	726	2,543	8/7/2023 17:29	8/9/2023 11:52
585421	Montgomery	1	2,530	8/7/2023 19:07	8/9/2023 13:17
580183	York	200	2,529	8/7/2023 17:25	8/9/2023 11:34
582693	Berks	3	2,524	8/7/2023 19:43	8/9/2023 13:47
594794	Berks	6	2,524	8/8/2023 17:12	8/10/2023 11:16
589047	Berks	1	2,521	8/8/2023 17:12	8/10/2023 11:13
584886	Northampton	2	2,518	8/7/2023 19:53	8/9/2023 13:51
590127	Bucks	1	2,518	8/7/2023 19:32	8/9/2023 13:30
584227	Monroe	65	2,510	8/7/2023 21:10	8/9/2023 15:00
580111	York	12	2,503	8/7/2023 17:22	8/9/2023 11:05
580630	York	1	2,498	8/7/2023 17:47	8/9/2023 11:25
595204	York	3	2,498	8/8/2023 22:56	8/10/2023 16:34
588400	York	43	2,496	8/7/2023 17:37	8/9/2023 11:13
581540	Berks	3	2,490	8/7/2023 18:51	8/9/2023 12:21
591633	York	8	2,483	8/8/2023 20:05	8/10/2023 13:28
589546	York	1	2,475	8/7/2023 17:47	8/9/2023 11:02
581745	Berks	38	2,472	8/7/2023 17:25	8/9/2023 10:37
589137	York	2	2,471	8/8/2023 17:21	8/10/2023 10:32
596088	Lancaster	64	2,468	8/9/2023 14:28	8/11/2023 7:36
583817	Bucks	9	2,466	8/7/2023 20:33	8/9/2023 13:39
581116	York	22	2,457	8/7/2023 18:07	8/9/2023 11:04
585633	Berks	5	2,456	8/8/2023 3:18	8/9/2023 20:14
589670	York	1	2,455	8/8/2023 19:35	8/10/2023 12:30
580566	York	26	2,436	8/7/2023 17:44	8/9/2023 10:20
580438	York	2	2,426	8/7/2023 17:39	8/9/2023 10:05
581830	Berks	44	2,422	8/7/2023 19:08	8/9/2023 11:30
585455	Monroe	2	2,415	8/7/2023 20:02	8/9/2023 12:17
583846	York	2	2,407	8/7/2023 20:37	8/9/2023 12:44
581210	York	2	2,406	8/7/2023 18:15	8/9/2023 10:21

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
582766	Northampton	1	2,391	8/7/2023 19:44	8/9/2023 11:35
587587	York	2	2,385	8/7/2023 17:39	8/9/2023 9:24
581892	Berks	2	2,378	8/7/2023 19:12	8/9/2023 10:50
582128	Berks	7	2,374	8/7/2023 19:26	8/9/2023 11:00
581745	Berks	29	2,373	8/7/2023 19:04	8/9/2023 10:37
583095	Northampton	4	2,367	8/7/2023 19:57	8/9/2023 11:24
583539	Northampton	3	2,360	8/7/2023 20:15	8/9/2023 11:35
580485	York	1	2,359	8/7/2023 17:41	8/9/2023 9:00
582233	Bucks	13	2,356	8/7/2023 19:33	8/9/2023 10:49
581166	York	5	2,349	8/7/2023 18:11	8/9/2023 9:20
589308	Monroe	4	2,336	8/7/2023 19:45	8/9/2023 10:41
590530	York	69	2,331	8/8/2023 23:09	8/10/2023 14:00
580704	York	24	2,331	8/7/2023 17:48	8/9/2023 8:39
584723	Bucks	1	2,321	8/7/2023 22:29	8/9/2023 13:10
584844	Chester	13	2,300	8/7/2023 23:01	8/9/2023 13:21
590201	Monroe	1	2,285	8/8/2023 23:27	8/10/2023 13:32
584084	Northampton	13	2,255	8/7/2023 20:55	8/9/2023 10:30
584084	Northampton	13	2,255	8/7/2023 20:55	8/9/2023 10:30
584009	Bucks	8	2,228	8/7/2023 19:32	8/9/2023 8:40
583076	Monroe	3	2,227	8/7/2023 19:55	8/9/2023 9:02
590017	Berks	4	2,168	8/8/2023 21:20	8/10/2023 9:28
585593	Berks	2	2,105	8/8/2023 6:01	8/9/2023 17:06
587578	Berks	4	2,035	8/7/2023 18:51	8/9/2023 4:46
588720	Berks	2	2,011	8/8/2023 16:12	8/10/2023 1:43
587956	Berks	1	2,003	8/8/2023 13:35	8/9/2023 22:58
589959	Northampton	5	1,968	8/8/2023 0:57	8/9/2023 9:45
585578	York	5	1,952	8/8/2023 5:53	8/9/2023 14:25
581707	Berks	2	1,889	8/7/2023 19:02	8/9/2023 2:31
581804	Berks	3	1,883	8/7/2023 19:07	8/9/2023 2:30
585893	Bucks	4	1,867	8/8/2023 7:05	8/9/2023 14:12
581662	Berks	14	1,842	8/7/2023 18:59	8/9/2023 1:41
593530	York	1	1,837	8/9/2023 20:03	8/11/2023 2:40
589856	York	19	1,811	8/7/2023 17:18	8/8/2023 23:29
580044	York	55	1,807	8/7/2023 17:15	8/8/2023 23:22

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
586918	Berks	5	1,800	8/7/2023 18:55	8/9/2023 0:55
581039	York	2	1,797	8/7/2023 18:03	8/9/2023 0:00
582349	Berks	3	1,793	8/7/2023 19:35	8/9/2023 1:28
586941	York	4	1,786	8/8/2023 10:13	8/9/2023 15:59
593293	Berks	2	1,782	8/8/2023 20:51	8/10/2023 2:33
590165	Bucks	2	1,774	8/8/2023 7:58	8/9/2023 13:32
588118	York	2	1,766	8/8/2023 14:11	8/9/2023 19:37
586327	Bucks	2	1,766	8/8/2023 8:08	8/9/2023 13:34
589339	York	4	1,765	8/7/2023 17:03	8/8/2023 22:28
587661	Chester	15	1,755	8/8/2023 12:25	8/9/2023 17:40
581716	Berks	1	1,750	8/7/2023 19:02	8/9/2023 0:12
586410	York	35	1,747	8/7/2023 17:18	8/8/2023 22:25
581740	Montgomery	19	1,744	8/7/2023 19:03	8/9/2023 0:07
588496	Northampton	1	1,739	8/8/2023 15:19	8/9/2023 20:18
588897	Bucks	2	1,735	8/8/2023 6:25	8/9/2023 11:20
582170	Berks	1	1,721	8/7/2023 19:28	8/9/2023 0:09
587125	Northampton	4	1,716	8/8/2023 10:39	8/9/2023 15:15
587200	Montgomery	2	1,708	8/8/2023 10:57	8/9/2023 15:25
585395	Bucks	7	1,708	8/7/2023 19:33	8/9/2023 0:01
581927	Berks	13	1,703	8/7/2023 19:15	8/8/2023 23:38
591228	York	7	1,702	8/8/2023 10:08	8/9/2023 14:30
594657	York	4	1,697	8/10/2023 8:43	8/11/2023 13:00
591752	York	1	1,674	8/9/2023 11:13	8/10/2023 15:07
581834	Berks	6	1,668	8/7/2023 19:09	8/8/2023 22:57
579978	York	68	1,664	8/7/2023 17:08	8/8/2023 20:52
588508	York	280	1,650	8/7/2023 17:26	8/8/2023 20:56
582802	Northampton	4	1,648	8/7/2023 19:45	8/8/2023 23:13
581856	Montgomery	1	1,639	8/7/2023 19:10	8/8/2023 22:29
581623	Berks	11	1,637	8/7/2023 18:57	8/8/2023 22:14
580135	York	77	1,636	8/7/2023 17:21	8/8/2023 20:37
581535	Berks	20	1,633	8/7/2023 18:51	8/8/2023 22:04
584265	York	32	1,625	8/7/2023 17:40	8/8/2023 20:45
587303	Cumberland	2	1,621	8/8/2023 11:19	8/9/2023 14:20
594500	York	11	1,621	8/10/2023 8:22	8/11/2023 11:23

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
582099	Berks	1	1,612	8/7/2023 19:24	8/8/2023 22:16
588570	York	2	1,611	8/8/2023 15:41	8/9/2023 18:32
581975	Berks	6	1,609	8/7/2023 19:17	8/8/2023 22:06
580075	York	240	1,606	8/7/2023 17:18	8/8/2023 20:04
581768	Berks	3	1,606	8/7/2023 19:05	8/8/2023 21:51
580073	York	255	1,604	8/7/2023 17:17	8/8/2023 20:01
580269	York	70	1,602	8/7/2023 17:31	8/8/2023 20:13
588345	York	1	1,601	8/8/2023 14:50	8/9/2023 17:31
590172	Bucks	1	1,600	8/7/2023 21:20	8/9/2023 0:00
586931	Berks	70	1,597	8/7/2023 19:03	8/8/2023 21:40
587691	York	15	1,594	8/7/2023 17:21	8/8/2023 19:55
584306	York	620	1,591	8/7/2023 17:25	8/8/2023 19:56
581825	Berks	26	1,585	8/7/2023 19:08	8/8/2023 21:33
589562	York	111	1,583	8/7/2023 17:47	8/8/2023 20:10
581913	Berks	25	1,576	8/7/2023 19:14	8/8/2023 21:30
591147	Bucks	1	1,550	8/9/2023 9:57	8/10/2023 11:47
597802	York	1	1,549	8/11/2023 10:02	8/12/2023 11:51
587751	Northampton	4	1,538	8/7/2023 20:50	8/8/2023 22:28
581447	Berks	3	1,537	8/7/2023 18:43	8/8/2023 20:20
588427	York	16	1,537	8/7/2023 17:33	8/8/2023 19:10
583414	Monroe	4	1,522	8/7/2023 20:08	8/8/2023 21:30
584374	Berks	1	1,517	8/7/2023 21:26	8/8/2023 22:43
580111	York	1,117	1,508	8/7/2023 17:22	8/8/2023 18:30
583964	York	104	1,508	8/7/2023 17:28	8/8/2023 18:36
579926	Adams	8	1,503	8/7/2023 17:01	8/8/2023 18:04
581554	York	23	1,500	8/7/2023 17:03	8/8/2023 18:03
581757	Berks	19	1,500	8/7/2023 19:11	8/8/2023 20:11
581714	Berks	38	1,496	8/7/2023 19:02	8/8/2023 19:58
581413	Berks	1	1,494	8/7/2023 18:39	8/8/2023 19:33
580895	Dauphin	1	1,490	8/7/2023 17:55	8/8/2023 18:45
582157	York	3	1,489	8/7/2023 17:34	8/8/2023 18:23
589052	Berks	34	1,488	8/8/2023 12:42	8/9/2023 13:30
582132	York	3	1,476	8/7/2023 17:47	8/8/2023 18:23
581564	Berks	32	1,473	8/7/2023 18:53	8/8/2023 19:26

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
588202	York	4	1,460	8/8/2023 13:21	8/9/2023 13:41
598055	York	1	1,458	8/10/2023 16:45	8/11/2023 17:03
592513	York	1	1,457	8/9/2023 14:49	8/10/2023 15:06
582712	Bucks	19	1,457	8/7/2023 19:43	8/8/2023 20:00
590587	Berks	1	1,444	8/8/2023 16:56	8/9/2023 17:00
593862	York	1	1,437	8/9/2023 21:36	8/10/2023 21:33
581688	Berks	3	1,428	8/7/2023 19:00	8/8/2023 18:48
581730	Berks	18	1,425	8/7/2023 19:03	8/8/2023 18:48
585504	Bucks	1	1,417	8/7/2023 19:34	8/8/2023 19:11
581576	Berks	43	1,415	8/7/2023 18:54	8/8/2023 18:29
581531	Berks	31	1,409	8/7/2023 18:51	8/8/2023 18:20
580528	York	1	1,405	8/7/2023 17:43	8/8/2023 17:08
592660	York	4	1,401	8/9/2023 15:20	8/10/2023 14:41
589526	Northampton	4	1,401	8/7/2023 19:39	8/8/2023 19:00
587382	Northampton	13	1,394	8/7/2023 19:36	8/8/2023 18:50
588033	York	7	1,386	8/8/2023 13:52	8/9/2023 12:58
588331	Berks	87	1,383	8/7/2023 19:03	8/8/2023 18:06
581791	Berks	1	1,379	8/7/2023 19:06	8/8/2023 18:05
595151	York	1	1,378	8/10/2023 13:23	8/11/2023 12:21
593754	York	12	1,376	8/9/2023 20:36	8/10/2023 19:32
580357	York	33	1,372	8/7/2023 17:34	8/8/2023 16:26
580263	York	2	1,372	8/7/2023 17:28	8/8/2023 16:20
582557	Berks	2	1,369	8/7/2023 19:40	8/8/2023 18:29
596401	York	1	1,368	8/9/2023 18:54	8/10/2023 17:42
584720	Northampton	10	1,367	8/7/2023 19:41	8/8/2023 18:28
582609	Northampton	1	1,364	8/7/2023 19:41	8/8/2023 18:25
581636	Montgomery	7	1,344	8/7/2023 18:58	8/8/2023 17:22
588128	Northampton	1	1,341	8/8/2023 14:14	8/9/2023 12:35
585210	Bucks	32	1,333	8/7/2023 23:17	8/8/2023 21:30
581548	Berks	1	1,326	8/7/2023 18:52	8/8/2023 16:58
595418	York	1	1,324	8/10/2023 14:23	8/11/2023 12:27
581783	Montgomery	34	1,324	8/7/2023 19:06	8/8/2023 17:10
582210	Berks	1	1,317	8/7/2023 19:31	8/8/2023 17:28
588771	Northampton	69	1,310	8/7/2023 19:45	8/8/2023 17:35

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
581749	Berks	14	1,308	8/7/2023 19:04	8/8/2023 16:52
584708	Berks	7	1,304	8/7/2023 22:27	8/8/2023 20:11
581733	Berks	29	1,298	8/7/2023 19:03	8/8/2023 16:41
580081	York	121	1,296	8/7/2023 17:38	8/8/2023 15:14
583459	Northampton	9	1,294	8/7/2023 20:10	8/8/2023 17:44
581186	York	6	1,292	8/7/2023 17:38	8/8/2023 15:10
586822	York	27	1,290	8/7/2023 17:45	8/8/2023 15:15
587692	York	28	1,286	8/7/2023 17:00	8/8/2023 14:26
587392	York	397	1,285	8/7/2023 17:23	8/8/2023 14:48
580352	York	60	1,284	8/7/2023 17:23	8/8/2023 14:47
593847	York	1	1,279	8/9/2023 21:26	8/10/2023 18:45
588452	Berks	1	1,277	8/8/2023 15:07	8/9/2023 12:24
582225	Northampton	69	1,274	8/7/2023 19:32	8/8/2023 16:46
582934	Northampton	7	1,270	8/7/2023 19:49	8/8/2023 16:59
591830	York	1	1,268	8/9/2023 10:59	8/10/2023 8:07
583124	Northampton	6	1,264	8/7/2023 19:58	8/8/2023 17:02
592841	York	1	1,260	8/9/2023 16:11	8/10/2023 13:11
590091	York	4	1,249	8/8/2023 21:56	8/9/2023 18:45
583816	Berks	2	1,249	8/7/2023 20:33	8/8/2023 17:22
581910	Berks	30	1,246	8/7/2023 19:14	8/8/2023 16:00
592528	York	2	1,246	8/9/2023 16:35	8/10/2023 13:21
588635	Northampton	25	1,244	8/8/2023 15:51	8/9/2023 12:35
594321	York	19	1,232	8/9/2023 19:28	8/10/2023 16:00
584312	Northampton	1	1,229	8/7/2023 21:19	8/8/2023 17:48
583711	Northampton	44	1,227	8/7/2023 20:26	8/8/2023 16:53
588133	York	792	1,223	8/7/2023 18:00	8/8/2023 14:23
583865	Northampton	1	1,223	8/7/2023 20:38	8/8/2023 17:01
592314	Northampton	2	1,216	8/9/2023 13:25	8/10/2023 9:41
584403	York	246	1,215	8/7/2023 17:26	8/8/2023 13:41
583127	Northampton	9	1,212	8/7/2023 19:58	8/8/2023 16:10
583418	Northampton	9	1,209	8/7/2023 20:08	8/8/2023 16:17
581254	York	1	1,209	8/7/2023 18:20	8/8/2023 14:29
593440	York	6	1,199	8/9/2023 19:25	8/10/2023 15:24
581555	Berks	10	1,197	8/7/2023 18:53	8/8/2023 14:50

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
580111	York	316	1,196	8/7/2023 17:22	8/8/2023 13:18
584020	Monroe	1	1,194	8/7/2023 20:50	8/8/2023 16:44
581935	York	62	1,187	8/7/2023 17:00	8/8/2023 12:47
584305	York	37	1,181	8/7/2023 17:25	8/8/2023 13:06
581761	Berks	81	1,177	8/7/2023 19:04	8/8/2023 14:41
586923	York	219	1,174	8/7/2023 17:38	8/8/2023 13:12
586704	Berks	2	1,172	8/8/2023 9:24	8/9/2023 4:56
598357	Northampton	18	1,169	8/11/2023 15:38	8/12/2023 11:07
583848	Berks	6	1,163	8/7/2023 20:37	8/8/2023 16:00
582800	Northampton	5	1,161	8/7/2023 22:39	8/8/2023 18:00
588777	Northampton	7	1,159	8/8/2023 16:24	8/9/2023 11:43
580381	York	34	1,157	8/7/2023 17:35	8/8/2023 12:52
582846	Monroe	1	1,153	8/7/2023 19:47	8/8/2023 15:00
583384	Northampton	7	1,149	8/7/2023 20:06	8/8/2023 15:15
581735	Berks	2	1,146	8/7/2023 19:16	8/8/2023 14:22
585102	Northampton	248	1,145	8/7/2023 19:41	8/8/2023 14:46
585327	Bucks	28	1,132	8/7/2023 19:38	8/8/2023 14:30
598583	York	1	1,132	8/11/2023 17:47	8/12/2023 12:39
580226	York	159	1,130	8/7/2023 17:27	8/8/2023 12:17
580061	York	25	1,123	8/7/2023 17:16	8/8/2023 11:59
580352	York	119	1,121	8/7/2023 17:23	8/8/2023 12:04
584708	Berks	40	1,113	8/7/2023 22:27	8/8/2023 17:00
583925	Monroe	8	1,093	8/7/2023 20:43	8/8/2023 14:56
585572	Bucks	1	1,092	8/8/2023 5:48	8/9/2023 0:00
581641	Berks	13	1,082	8/7/2023 18:58	8/8/2023 13:00
585218	Northampton	24	1,064	8/8/2023 0:57	8/8/2023 18:41
589803	York	2	1,061	8/8/2023 20:04	8/9/2023 13:45
582601	Northampton	23	1,060	8/7/2023 19:41	8/8/2023 13:21
583463	Montgomery	37	1,058	8/7/2023 20:10	8/8/2023 13:48
593608	York	1	1,057	8/9/2023 20:07	8/10/2023 13:44
580551	York	196	1,054	8/7/2023 17:44	8/8/2023 11:18
581472	Berks	41	1,049	8/7/2023 18:46	8/8/2023 12:15
582096	Berks	1	1,048	8/7/2023 19:24	8/8/2023 12:52
581763	Berks	32	1,046	8/7/2023 19:04	8/8/2023 12:30

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
593794	Monroe	2	1,035	8/9/2023 20:59	8/10/2023 14:14
596557	York	33	1,031	8/10/2023 19:35	8/11/2023 12:46
590344	York	48	1,029	8/9/2023 2:49	8/9/2023 19:58
584575	Berks	3	1,027	8/7/2023 22:12	8/8/2023 15:19
584964	York	2	1,025	8/7/2023 17:55	8/8/2023 11:00
581671	Berks	8	1,021	8/7/2023 18:59	8/8/2023 12:00
581907	Montgomery	2	1,007	8/7/2023 19:13	8/8/2023 12:00
583422	Monroe	3	1,001	8/7/2023 20:08	8/8/2023 12:49
582233	Bucks	474	1,001	8/7/2023 19:33	8/8/2023 12:14
580456	York	43	999	8/7/2023 17:40	8/8/2023 10:19
584859	Northampton	24	995	8/7/2023 19:40	8/8/2023 12:15
580426	York	237	982	8/7/2023 17:39	8/8/2023 10:01
580442	York	593	982	8/7/2023 17:39	8/8/2023 10:01
581695	Montgomery	51	979	8/7/2023 19:01	8/8/2023 11:20
590188	Lebanon	16	975	8/8/2023 23:12	8/9/2023 15:27
582407	Northampton	955	975	8/7/2023 19:35	8/8/2023 11:50
584869	Northampton	49	973	8/7/2023 19:38	8/8/2023 11:51
585712	Bucks	7	973	8/8/2023 6:32	8/8/2023 22:45
580710	York	13	972	8/7/2023 17:49	8/8/2023 10:01
589385	Berks	1	971	8/8/2023 18:18	8/9/2023 10:29
598854	Montgomery	1	969	8/11/2023 19:29	8/12/2023 11:38
593127	Bucks	12	963	8/9/2023 17:58	8/10/2023 10:01
581664	Berks	12	961	8/7/2023 18:59	8/8/2023 11:00
584882	Northampton	23	959	8/7/2023 19:38	8/8/2023 11:37
590660	Berks	2	957	8/9/2023 7:04	8/9/2023 23:01
593760	York	1	950	8/9/2023 20:40	8/10/2023 12:30
581599	Berks	23	949	8/7/2023 18:56	8/8/2023 10:45
580561	York	316	946	8/7/2023 17:44	8/8/2023 9:30
586795	Berks	226	944	8/7/2023 18:57	8/8/2023 10:41
581500	York	5	941	8/7/2023 18:49	8/8/2023 10:30
583564	Monroe	18	937	8/7/2023 20:16	8/8/2023 11:53
589958	Berks	2	933	8/8/2023 20:56	8/9/2023 12:29
584806	Northampton	395	931	8/7/2023 19:36	8/8/2023 11:07
590371	Lehigh	36	924	8/9/2023 3:25	8/9/2023 18:49

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
594371	York	2	920	8/9/2023 23:20	8/10/2023 14:40
585661	Bucks	2	915	8/8/2023 6:21	8/8/2023 21:36
581696	Berks	115	914	8/7/2023 19:01	8/8/2023 10:15
586829	Montgomery	150	911	8/7/2023 19:15	8/8/2023 10:26
588822	Northampton	4	896	8/8/2023 16:36	8/9/2023 7:32
583374	Monroe	29	895	8/7/2023 20:05	8/8/2023 11:00
581852	Berks	51	892	8/7/2023 19:10	8/8/2023 10:02
581626	Berks	355	883	8/7/2023 19:00	8/8/2023 9:43
581738	Montgomery	56	882	8/7/2023 19:03	8/8/2023 9:45
586628	Berks	8	881	8/7/2023 19:04	8/8/2023 9:45
594149	Lehigh	14	880	8/10/2023 3:54	8/10/2023 18:34
580770	York	98	880	8/7/2023 17:50	8/8/2023 8:30
584384	York	5	877	8/7/2023 21:28	8/8/2023 12:05
592187	York	2	860	8/8/2023 22:22	8/9/2023 12:42
583073	Monroe	59	856	8/7/2023 19:54	8/8/2023 10:10
590468	York	8	853	8/9/2023 5:13	8/9/2023 19:26
581666	Berks	107	842	8/7/2023 18:58	8/8/2023 9:00
588883	York	1	837	8/8/2023 20:33	8/9/2023 10:30
584458	Monroe	2	819	8/7/2023 21:43	8/8/2023 11:22
596686	York	3	814	8/10/2023 20:21	8/11/2023 9:55
598961	York	3	806	8/11/2023 21:35	8/12/2023 11:01
583553	Monroe	18	795	8/7/2023 20:15	8/8/2023 9:30
598962	York	2	789	8/11/2023 21:36	8/12/2023 10:45
583378	Monroe	33	782	8/7/2023 20:05	8/8/2023 9:07
593484	York	4	773	8/9/2023 19:40	8/10/2023 8:33
599143	York	4	758	8/12/2023 2:06	8/12/2023 14:44
586871	Berks	232	754	8/7/2023 20:33	8/8/2023 9:07
594059	Berks	1	749	8/10/2023 1:31	8/10/2023 14:00
580694	Adams	1	744	8/7/2023 17:48	8/8/2023 6:12
591037	York	1	743	8/9/2023 9:11	8/9/2023 21:34
598985	York	10	714	8/11/2023 21:46	8/12/2023 9:40
594178	Northampton	10	696	8/10/2023 4:24	8/10/2023 16:00
597080	York	3	677	8/11/2023 0:58	8/11/2023 12:15
581920	Lehigh	11	674	8/7/2023 19:14	8/8/2023 6:28

Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
597645	York	1	673	8/11/2023 9:07	8/11/2023 20:20
594453	Berks	26	666	8/10/2023 8:07	8/10/2023 19:13
585380	York	16	641	8/8/2023 3:36	8/8/2023 14:17
598835	York	6	636	8/11/2023 19:24	8/12/2023 6:00
589601	Berks	1	628	8/8/2023 19:17	8/9/2023 5:45
590357	Monroe	91	623	8/8/2023 17:04	8/9/2023 3:27
586147	Bucks	113	617	8/8/2023 7:39	8/8/2023 17:56
595483	York	2	616	8/10/2023 14:53	8/11/2023 1:09
590235	York	3	593	8/9/2023 0:03	8/9/2023 9:56
580294	York	53	590	8/7/2023 17:33	8/8/2023 3:23
585180	Monroe	62	581	8/7/2023 23:06	8/8/2023 8:47
589316	York	5	562	8/8/2023 18:04	8/9/2023 3:26
594319	Berks	1	560	8/10/2023 6:55	8/10/2023 16:15
589630	Bucks	66	558	8/8/2023 19:27	8/9/2023 4:45
583143	Northampton	50	557	8/7/2023 19:58	8/8/2023 5:15
598566	York	1	556	8/11/2023 15:43	8/12/2023 0:59
581988	Berks	6	548	8/7/2023 19:18	8/8/2023 4:26
584947	Berks	57	537	8/7/2023 23:18	8/8/2023 8:15
582219	Bucks	837	535	8/7/2023 19:34	8/8/2023 4:29
584116	Monroe	13	530	8/7/2023 20:58	8/8/2023 5:48
590988	Bucks	1	530	8/9/2023 8:55	8/9/2023 17:45
594458	York	26	529	8/10/2023 8:13	8/10/2023 17:02
582234	Bucks	606	520	8/7/2023 19:34	8/8/2023 4:14
586971	Berks	17	518	8/8/2023 9:52	8/8/2023 18:30
598666	York	1	505	8/11/2023 18:06	8/12/2023 2:31
594952	York	1	501	8/10/2023 11:34	8/10/2023 19:55
588462	York	18	497	8/8/2023 15:11	8/8/2023 23:28
594855	York	1	483	8/10/2023 10:41	8/10/2023 18:44
580339	York	664	481	8/7/2023 17:32	8/8/2023 1:33
582268	Bucks	636	480	8/7/2023 19:34	8/8/2023 3:34
582232	Bucks	1,076	480	8/7/2023 19:34	8/8/2023 3:34
582264	Bucks	419	480	8/7/2023 19:34	8/8/2023 3:34
582824	Northampton	45	479	8/7/2023 19:46	8/8/2023 3:45
582290	Bucks	401	479	8/7/2023 19:35	8/8/2023 3:34


Metropolitan Edison Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
587567	Lebanon	13	477	8/8/2023 11:00	8/8/2023 18:57
594446	Cumberland	103	469	8/10/2023 8:05	8/10/2023 15:54
595394	York	6	465	8/10/2023 13:35	8/10/2023 21:20
595280	Berks	36	464	8/10/2023 13:48	8/10/2023 21:32
596502	Monroe	3	459	8/10/2023 18:40	8/11/2023 2:19
587086	Berks	11	459	8/8/2023 6:06	8/8/2023 13:45
594468	Cumberland	50	455	8/10/2023 8:15	8/10/2023 15:50
596052	Berks	1	445	8/10/2023 15:35	8/10/2023 23:00
599156	Bucks	1	445	8/12/2023 2:28	8/12/2023 9:53
594968	Cumberland	1	436	8/10/2023 11:44	8/10/2023 19:00
597485	York	1	435	8/11/2023 7:47	8/11/2023 15:02
599213	Monroe	3	418	8/12/2023 1:11	8/12/2023 8:09
596901	Bucks	1	416	8/10/2023 22:16	8/11/2023 5:12
588022	Berks	7	416	8/8/2023 13:50	8/8/2023 20:46
594866	York	2	411	8/10/2023 10:49	8/10/2023 17:40
592846	York	8	406	8/9/2023 12:20	8/9/2023 19:06
592248	Bucks	2	406	8/9/2023 13:01	8/9/2023 19:47
588482	Berks	1	405	8/8/2023 15:16	8/8/2023 22:01
580833	York	2	402	8/7/2023 17:53	8/8/2023 0:35
580622	Lancaster	11	401	8/7/2023 17:46	8/8/2023 0:27
581552	Berks	38	399	8/7/2023 18:52	8/8/2023 1:31
584253	Berks	99	394	8/7/2023 18:51	8/8/2023 1:25
592060	Adams	1	393	8/9/2023 12:04	8/9/2023 18:37
587831	Bucks	13	381	8/8/2023 13:10	8/8/2023 19:31
586378	York	2	378	8/8/2023 8:18	8/8/2023 14:36
592380	Pike	1	377	8/9/2023 14:00	8/9/2023 20:17
580683	Lancaster	139	370	8/7/2023 17:48	8/7/2023 23:58
588597	York	5	369	8/8/2023 15:46	8/8/2023 21:55
592940	York	20	368	8/9/2023 14:51	8/9/2023 20:59
597546	York	1	364	8/11/2023 8:21	8/11/2023 14:25


**Attachment B: Wind and Precipitation Report**

**Wind and Precipitation Reports:** Graphic 1 illustrates the maximum wind gusts in the Met-Ed service territory on August 7, 2023. Graphics 2 and 3 illustrate precipitation in the Met-Ed service territory on August 7, 2023 and August 10, 2023. The graphics are from the National Oceanic and Atmospheric Administration (“NOAA”).


**Graphic 1: Wind Gusts – Monday, August 7, 2023**

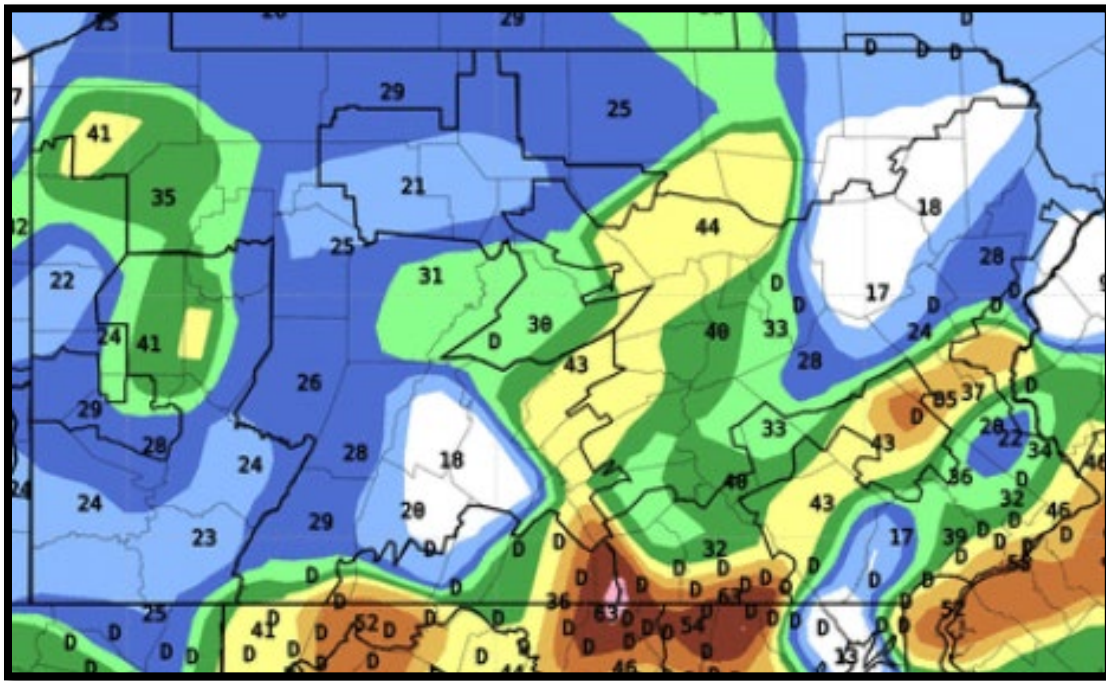


**Graphic 2: 24-Hour Total Precipitation – Monday, August 7, 2023**

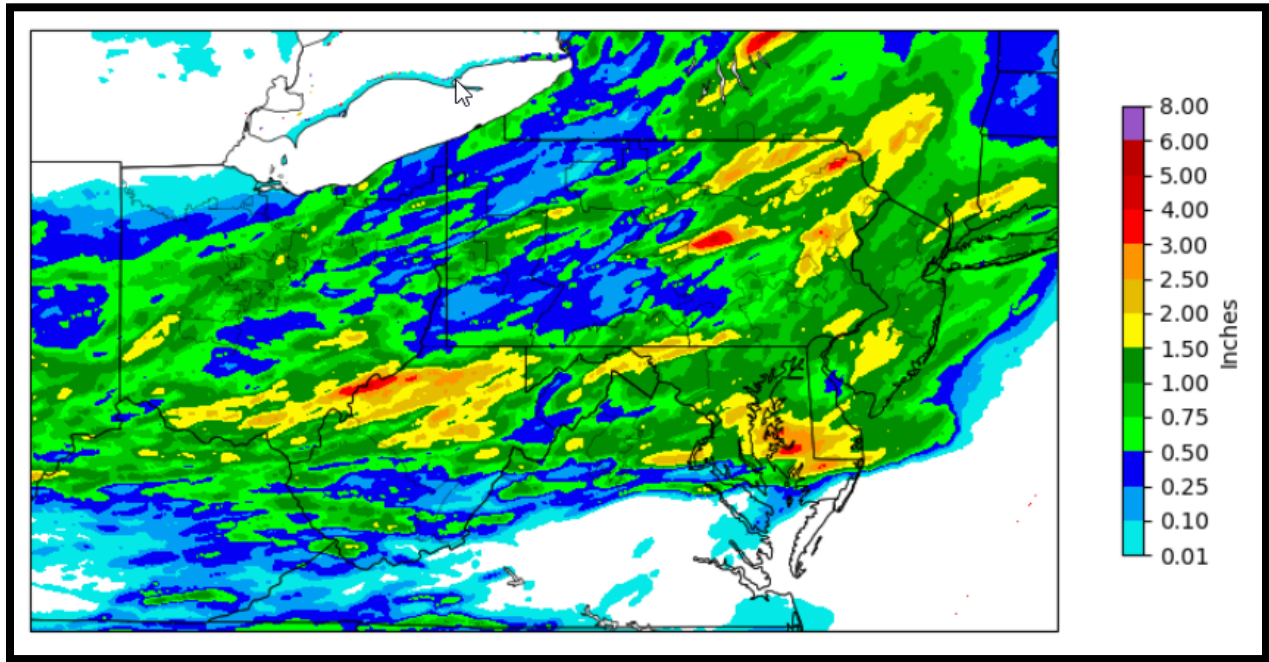


**Graphic 3: 24-Hour Total Precipitation – Thursday, August 10, 2023**

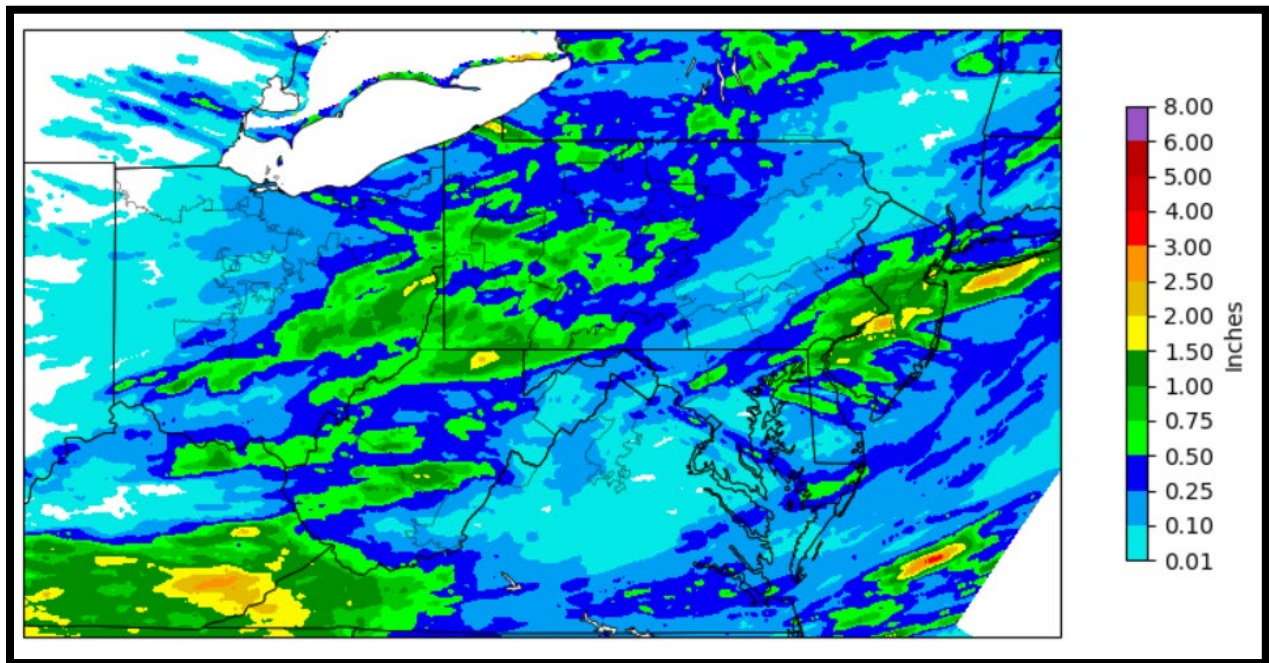


**Attachment C: Order Restoration Curve**

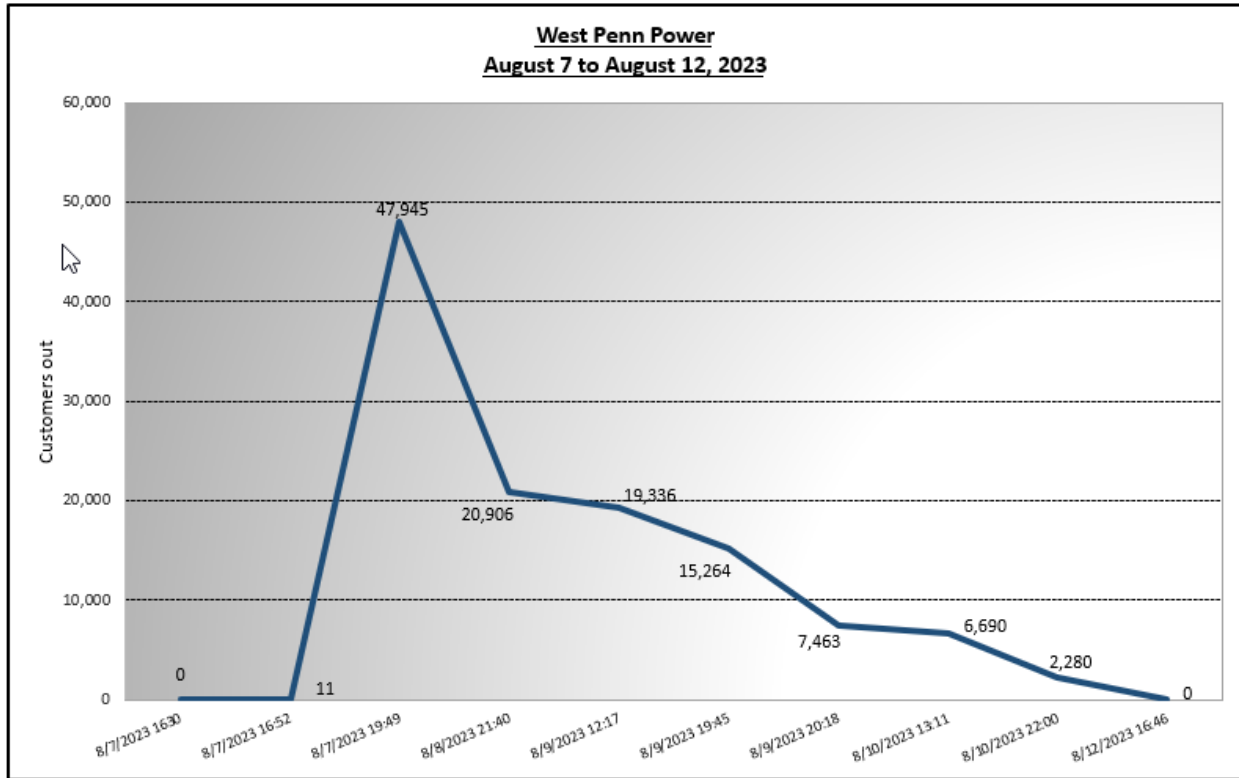

**Attachment D: Order Restoration Graphs**

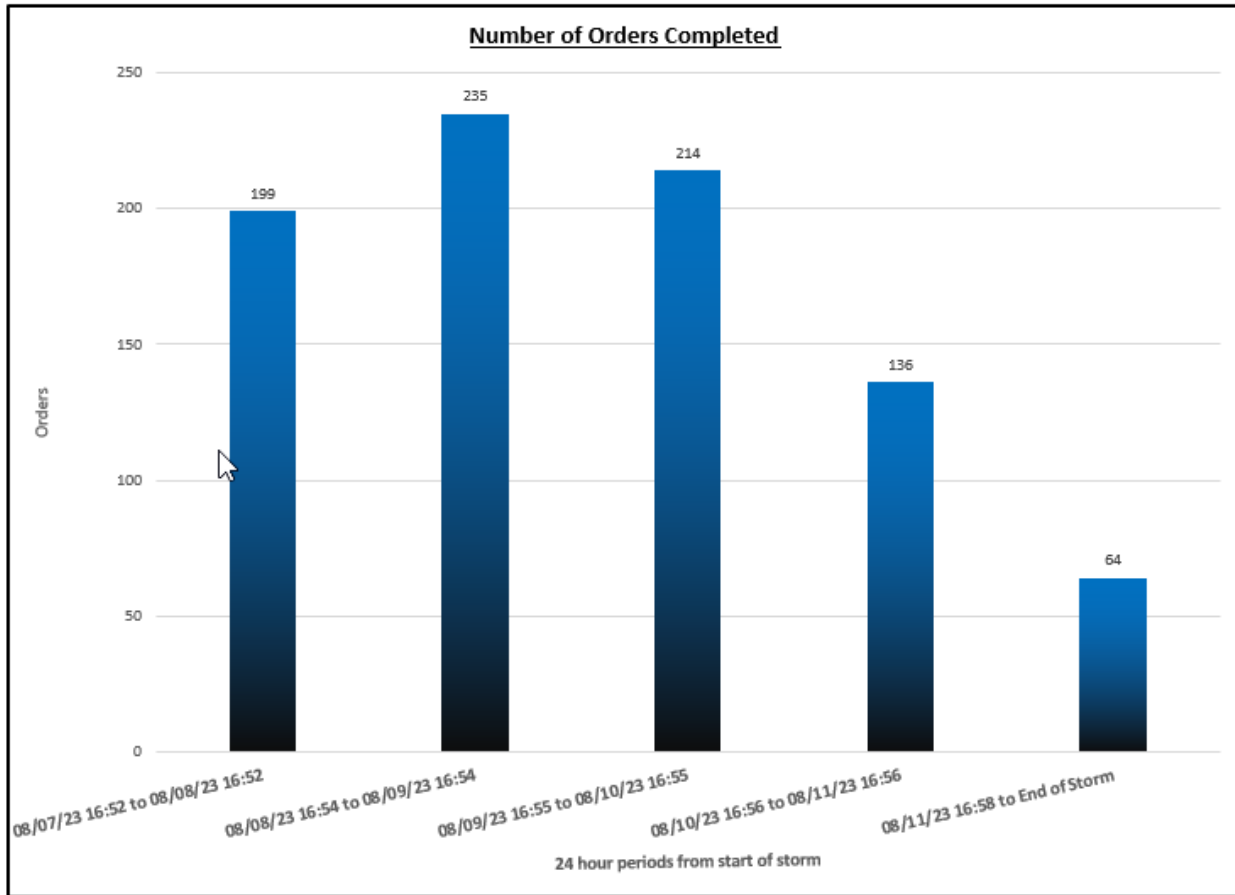

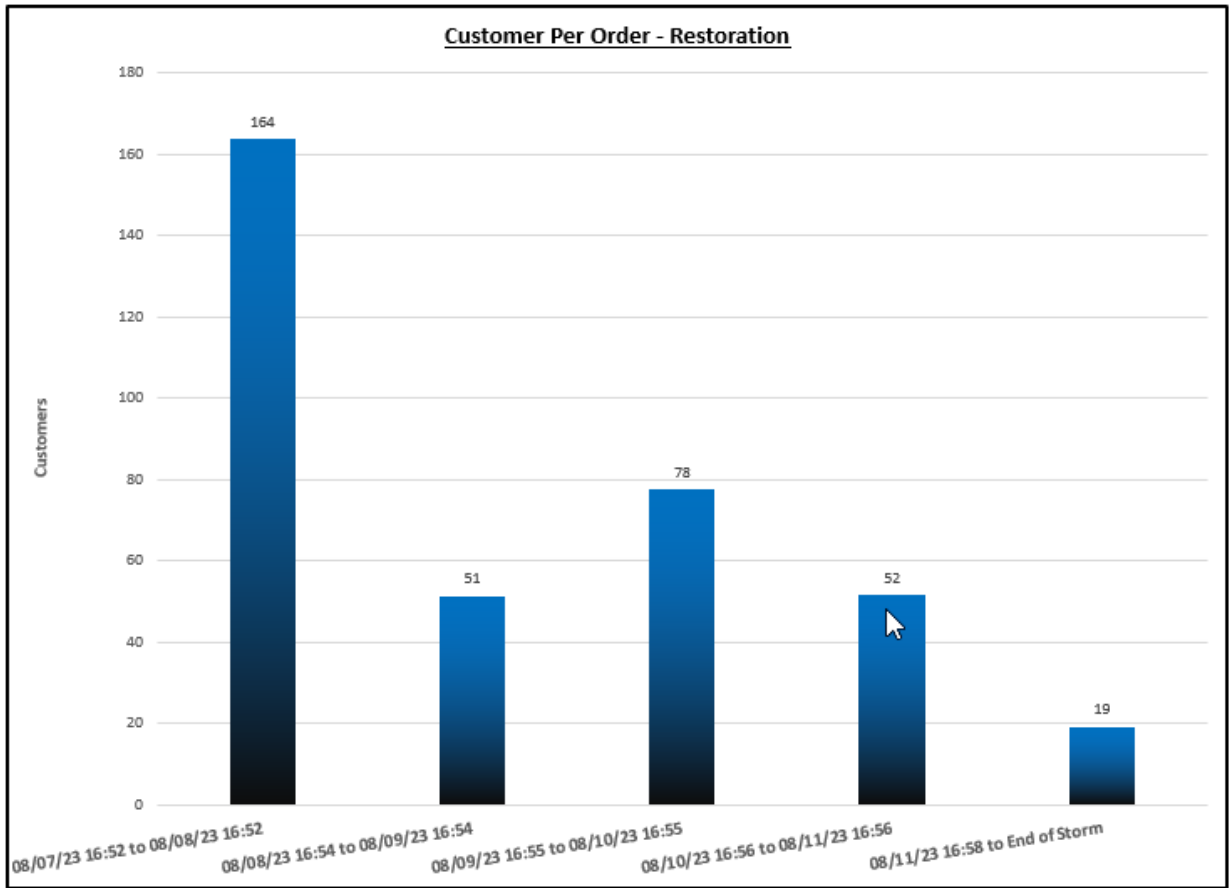


**Attachment E: Meteorologist Reports**

**Saturday, August 5, 2023 @ 0828**

**New Issuance:** Confidence is above normal cells will form, expanse of threat area, and general timing. However confidence is slightly below normal for widespread will be cells strong enough to produce damage and perhaps how far east the cells will traverse into the evening.

Note – we will also be adding new risk areas for Monday in the next update.

See graphic below for further information.

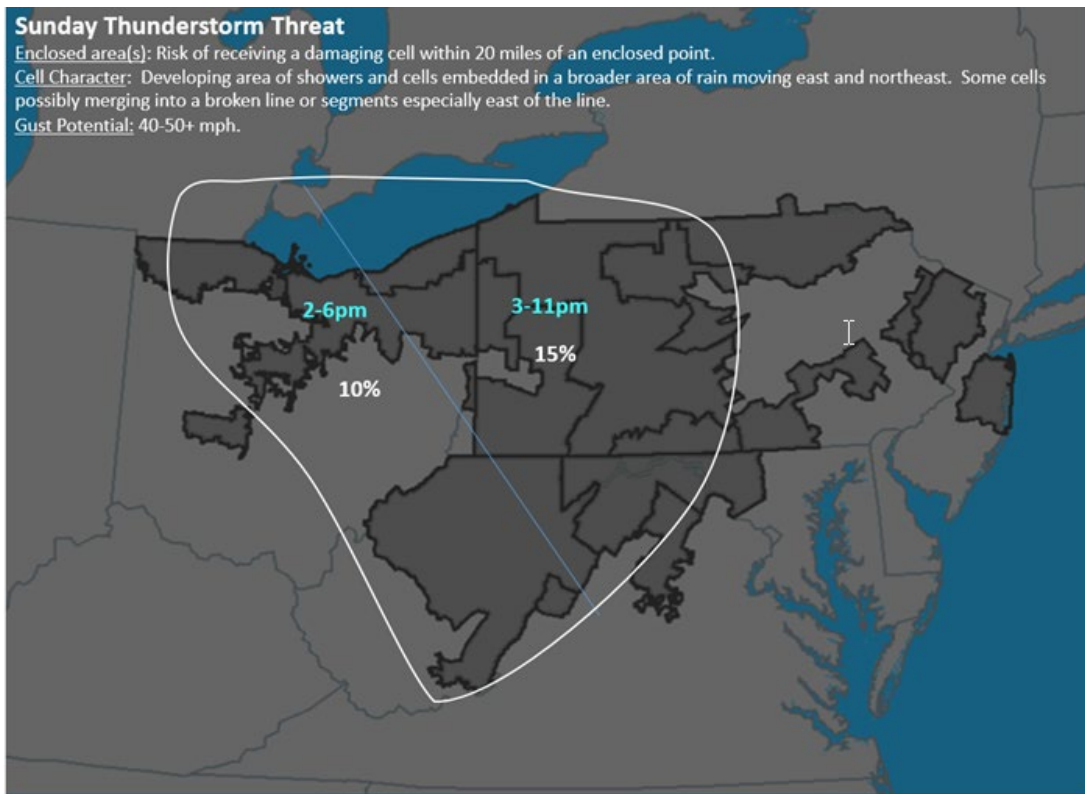


**Sunday, August 6, 2023 @ 0801**

**Changes.**

1. Today: Fine-tuned area, timing, and risk area. Confidence is above normal cells will form, expanse of threat area, and general timing. However confidence remains slightly below normal for wide spread will be cells strong enough to produce damage. Note – although the threat for damaging cells ends in central PA late this evening, an area of rain with some lightning is expected to move east overnight into NJ by dawn tomorrow (but damaging winds are not expected).

2. Added threat for tomorrow. Confidence is above normal cells will form, expanse of the threat area, relative risk levels, and multiple rounds being likely. Overlap in timing of the three distinct timing areas by a couple of hours is likely as well.

See graphics below for further information.

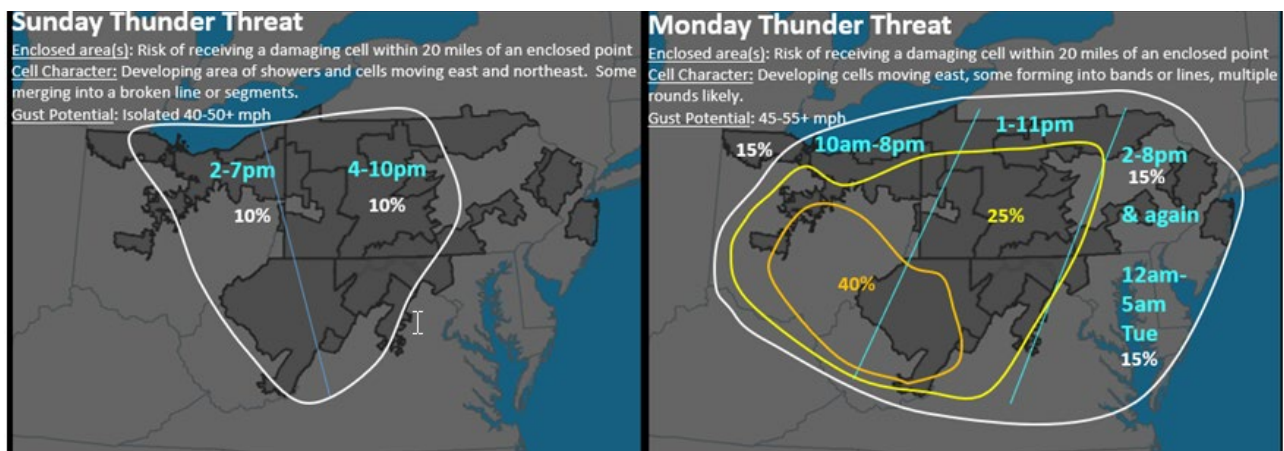


**Sunday, August 6, 2023 @ 1938**

**Changes.**

1. This evening (bottom right panel): Updated for residual cells moving through along the lakeshore. Confidence is normal with this panel.
2. Tomorrow. Three separate rounds/areas with some overlap to each other. Regardless – it should be a busy day with storms.
  - a. Top left panel: Confidence is slightly below normal that this band will form.
  - b. Top right panel: Confidence is above normal for cells to develop and produce damaging wind gusts in the outlined area.
  - c. Bottom left panel: Confidence is normal for a line to form and head east, especially after 2pm.

See graphics below for further information.

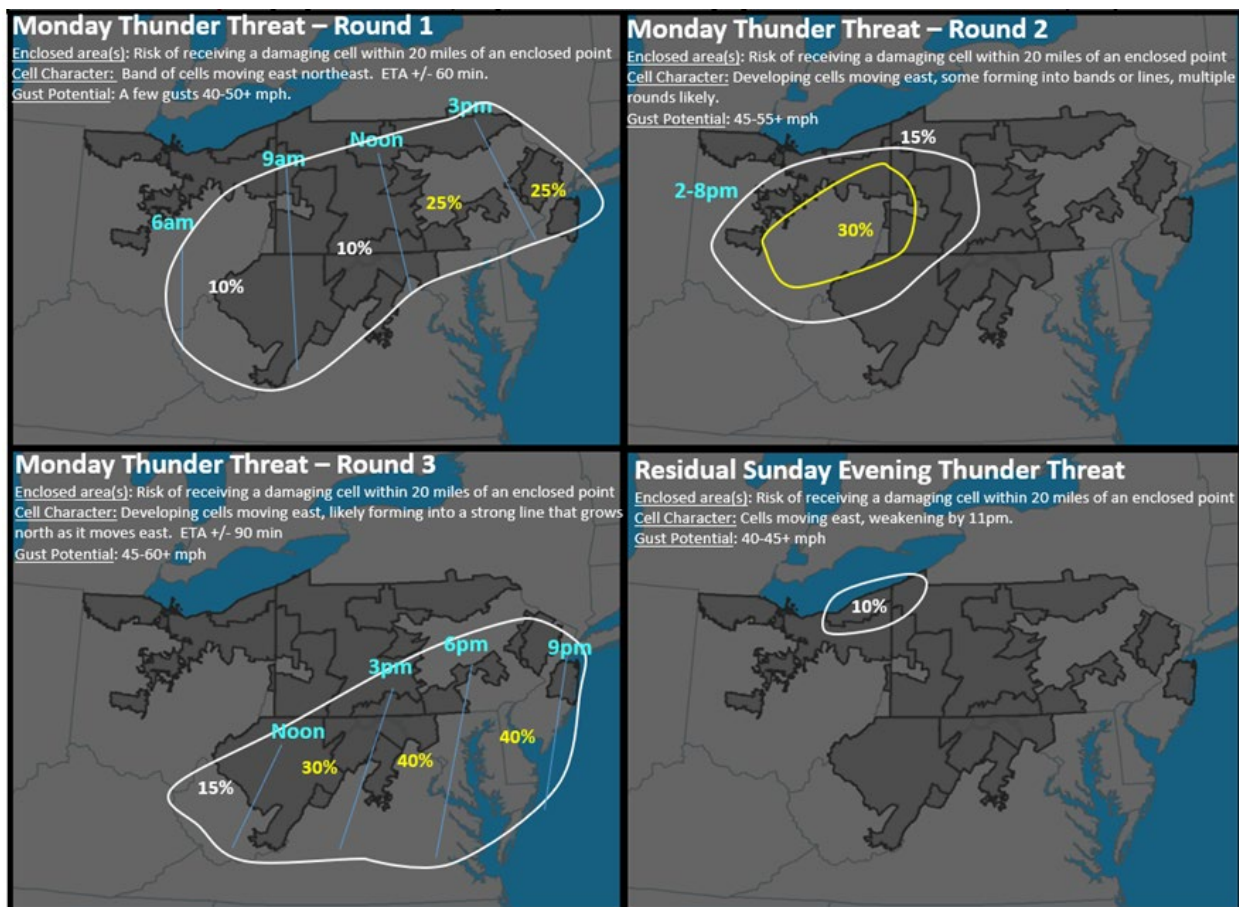

**Monday, August 7, 2023 @ 1206**

**Changes**

1. Region 1: Left panel (numerous scattered cells) – fine-tuned timing and risk levels, added mention of tornado and increased max gust speed potential. Confidence is above normal.
2. Region 2: Right panel (line of storms) - fine-tuned risk levels, added mention of tornado and increased max gust speed potential. Confidence is above normal.

See graphics below for further information.

**Final Update Unless Changes Needed**

