
Alexander Argentina
v.
Pennsylvania-American
Water Company

Docket No.:
C-2023-3044235

Initial Call-In
Telephonic Hearing

Pages 1 - 108

Judge's Chambers
Piatt Place
301 5th Avenue
Suite 220
Pittsburgh, PA

Tuesday, February 20, 2024
Commencing at 10:15 a.m.

INDEX TO EXHIBITS

Docket No. C-2023-3044235

Hearing Date: February 20, 2024

<u>NUMBER</u>	<u>FOR IDENTIFICATION</u>	<u>IN EVIDENCE</u>
Complainant's Exhibit 1	49	50
Image of Sidewalk		
Complainant's Exhibit 2	50	51
Email from Joseph Patrick		

Complainant's Exhibit 3	51	52
Water Meter Inspection		
Completion		
Complainant's Exhibit 4	52	52
Photograph		
Complainant's Exhibit 5	53	53
Bill		
PAWC Exhibit 1	58	106
Account Statement and		
Payment History		
PAWC Exhibit 2	67	106
Data Logger Report		
PAWC Exhibit 3	74	106
Meter Test Results		
PAWC Exhibit 4	61	106
Service Orders		



Complainant's
Exhibit

1

LS 2/20/2024

pleasure to serve you! Σ Inbox x

nt Info <AppointmentInfo@amwater.com>

Thu, Dec 7, 2023, 2:03 PM

PENNSYLVANIA
AMERICAN WATER

ed Customer,

pleasure to serve you today!

service representative has completed the following service: **Water Meter Inspection**

re unable to speak to the field service representative directly, look for a doorhanger with a summary of the work completed.

re questions or concerns regarding this appointment, please call us at 1-800-565-7292.

Complainant's
Exhibit

3

LS 2/20/2024



Complainant's
Exhibit

4

LS 2/20/2024



WE KEEP LIFE FLOWING™

Service Address:

ALEXANDER ARGENTINA
114 FREMONT ST
PITTSBURGH, PA 15210-2106

THANK YOU FOR BEING OUR CUSTOMER

Important Account Messages

- Your billing has been adjusted to offset some of the additional charges incurred as a result of the recent leak at your property. Please see the detailed billing charges for additional information.
- This bill reflects an extended or partial billing period. As a result, a portion of your charges may be prorated accordingly to represent actual days of service received. Please refer to Account Detail for more information.

For more information, visit www.pennsylvaniaamwater.com

Statement

Account No. **1024-210032542353**

Total Amount Due:	\$72.29
Payment Due By:	June 5, 2023

Billing Date: May 12, 2023
Service Period:

Account Summary – See page 3 for Account Detail

Prior Billing:	\$121.62
Payments:	-\$0.00
Balance Forward:	=\$121.62
Fees and Adjustments:	-\$30.00
Service Related Charges:	-\$19.33
Total Amount Due:	=\$72.29

View your account information or pay your bill anytime at: www.amwater.com/MyAccount

Pay by Phone*: Pay anytime at 1-855-748-6066

Customer Service: 1-800-565-7292
M-F 7:00am to 7:00pm – Emergencies 24/7

PENNSYLVANIA AMERICAN WATER
PO BOX 371412
PITTSBURGH, PA. 15250-7412

Please return bottom portion with your payment. DO NOT send cash. Retain upper portion for your records.

Account No. **1024-210032542353**

Total Amount Due:	\$72.29
Payment Due By:	June 5, 2023



P.O. BOX 91623
RANTOUL, IL 61866-8623

Service to: 114 FREMONT ST
PITTSBURGH, PA 15210-2106

ALEXANDER ARGENTINA
114 FREMONT ST
PITTSBURGH, PA 15210-2106

Amount Enclosed \$

PENNSYLVANIA AMERICAN W
PO BOX 371412
PITTSBURGH, PA. 15250-7412



Messages from Pennsylvania American Water

- *****IMPORTANT WATER QUALITY MESSAGE:** Your annual Water Quality Report can be viewed electronically at www.amwater.com/ccr/greaterpgh.pdf. If you prefer a paper copy to be sent to you, please contact our Customer Service Center at 800-565-7292.
- Effective April 1, 2023, the Water Distribution System Improvement Charge increased from 0.00% to 0.02%. This charge funds the replacement of water distribution system facilities.
- The PA Public Utility Commission recently approved a water rate increase for Pennsylvania American Water, effective Jan. 28, 2023. The average monthly residential water bill increased by \$8.76 (14.5%).

What's the best way to reach you

IN CASE OF AN EMERGENCY



We use a high-speed notification system to quickly alert customers via phone, text and email when water emergencies occur. Visit **My Account** at www.amwater.com/myaccount to choose how you want to be notified and enter your contact information.



CUSTOMER SERVICE: 1-800-565-7292

HOURS: M-F, 7am-7pm ▪ Emergencies: 24/7

TTY/TDD FOR THE HEARING IMPAIRED: 711

(and then reference Customer Service number listed above)

SERVICES

 **Go Paperless:** Save time. Save money. Sign up for **Paperless Billing** and **Auto Pay** on MyWater at amwater.com/mywater. Not registered? Log in and be sure to have your account number handy.

 **Water Quality:** We take water quality seriously. When it comes to complying with federal drinking water standards, we consistently score better than the industry average. For a copy of the annual water quality report for your area, visit pennsylvaniaamwater.com. Under Water Quality, select Water Quality Reports.

 **H2O Help To Others:** This program helps low-income customers who qualify with their water bills. For more information, contact our program administrator, the Dollar Energy Fund, at 1-888-282-6816.

EXPLANATION OF FEES AND OTHER TERMS

 **Distribution System Improvement Charge (DSIC):** A charge to replace aging facilities, such as mains, meters, fire hydrants, valves, etc. This charge, as approved by the Pennsylvania Public Utility Commission (PUC), will change every three months based on work completed. It will not exceed 7.5% of your bill.

 **Payment by Check:** Paying by check authorizes American Water to send the information from your check electronically to your bank for payment. The transaction will appear on your bank statement. The physical check will not be presented to your financial institution or returned to you.



State Tax Surcharges: This PUC-approved charge allows the company to recover costs specific to state taxes.



Estimated Bill: This occurs when we are unable to read the water meter. Your usage from the same billing period the prior year is used to calculate the estimated bill. The next actual meter reading corrects any over or under estimates.



Inquiries/Disputes: For inquiries about your bill, please register any question or complaint about the bill prior to the due date. Contact customer service Monday–Friday from 7 a.m. to 7 p.m. by calling 1-800-565-7292. To register your complaint by mail, send written correspondence to PO Box 2798, Camden, NJ 08101.



Rates: A detailed listing of charges that make up your bill is available upon request by contacting Customer Service or visiting us online at pennsylvaniaamwater.com. Under Customer Service & Billing, select Your Water and Wastewater Rates.



Protection programs for water, sewer and in-home plumbing are offered by American Water Resources. Charges for these services are not regulated by the Pennsylvania Public Utility Commission. Regulated services will not be disconnected as a result of non-payment of protection program charges. Customers with protection program charges will not be assessed a late payment charge for late or unpaid protection plan charges. For inquiries about protection programs, please contact American Water Resources at 1-888-378-4458.



Correspondence: Please send written correspondence to PO Box 2798, Camden, NJ 08101. Be sure to include your name, account number, service address, mailing address and phone number including area code. Please do not send correspondence with your payment, as it may delay processing your payment and correspondence.

H2O HELP TO OTHERS PROGRAM - lend a hand to customers in need

- I'm adding a one time contribution of \$_____ with my payment.
- I'd like to add a recurring contribution to each bill of \$_____. I understand this amount will be added to each bill.

Address Change(s)

Name _____

Address _____

City _____

State _____ Zip Code _____

(_____) _____
Phone Number Mobile Number

E-mail Address _____

Other ways to pay your bill



Auto Pay



Online



In Person

Save time and money. Enroll in Auto Pay, and your bill will be paid on time, every time, directly from your bank account on the due date. No stamps required!

With My Account, you can pay your bill anytime, anywhere. Registration is fast and easy. Visit www.amwater.com/MyAccount or pay without registration at www.amwater.com/billpay (fee may apply).

We have agreements with several authorized payment locations in our service areas. Visit our website to find one near you.

Account Detail

Account No. 1024-210032542353

Service To: 114 FREMONT ST PITTSBURGH, PA 15210-2106

Prior Billing	121.62
Payments	0.00
<hr/>	
Balance Forward	121.62
 Fees and Adjustments	-30.00
Courtesy Adjustment	-30.00
<hr/>	
Service Related Charges - 00/00/00 to 00/00/00	
<hr/>	
Leak Adjustment with consumption - 02/28/23 to 03/30/23 - 1,200 gallons adjusted	
 Water Service	-19.33
Water Usage Charge	-19.33
Total Service Related Charges	-19.33
Total Current Period Charges	-49.33

Total Amount Due

\$72.29
Understanding Your Bill

The information below defines some of the new terms you may find on your bill:

- **Service Related Charges:** This section includes charges for services related to water, wastewater and fire protection. If applicable, credits and debits for correction to previously billed charges are itemized in this section.
- **Fees and Adjustments:** This section provides details related to additional charges or adjustments for the service period referenced. Fees, when applicable, would include items such as service activation and late payment charges.
- **Billing Units:** One billing unit equals 100 gallons of water used. If the meter serving your property measures your water use in cubic feet or a different unit of measure, we convert the usage to gallons to make it easier to understand.
- **Average Daily Use:** The gallons shown in the water droplet above represent your average daily water use for the current billing period. Tracking the amount of water you use can help you manage your overall water use from month to month.
- **Protection programs for water, sewer and in-home plumbing** are offered by American Water Resources. Charges for these services are not regulated by the Pennsylvania Public Utility Commission. Regulated services will not be disconnected as a result of non-payment of protection program charges. Customers with protection program charges will not be assessed a late payment charge for late or unpaid protection plan charges. For inquiries about protection programs, please contact American Water Resources at 888-378-4458.
- **Still have questions?** We are here to help. Our customer service representatives are available M–F, 7 a.m. to 7 p.m. More information on understanding your bill and charges can also be found on our website. See the link below.

Para obtener asistencia de traducción en la lectura de su factura, comuníquese con nuestro Centro de Atención al Cliente al 1-800-565-7292 de lunes a viernes de 7 a. m. a 7 p. m.

PA.01.22

For more information about your charges and rates, please visit:
<https://amwater.com/paaw/rates>

- Approximately 3.64 percent, or -\$1.80 of state taxes are included in your current bill.

Bill Inserts and Important Notices

We encourage you to click the link(s) below to view any bill inserts and other important notices you would have received with your printed bill.

<https://amwater.com/files/OAPASB.pdf>

<https://amwater.com/files/OAPA44.pdf>

<https://amwater.com/files/OAPA45.pdf>

PENNSYLVANIA AMERICAN WATER ACCOUNT STATEMENT

Customer: Alexander Argentina
 Address: 114 Fremont St , Pittsburgh , PA
 Acct. No.: 210032542353

Connect Date: 10/01/2013 water

SVC TO	DAYS	MTR RDG	TYPE	CONS	ADC	WATER AMT	WLPP	DUE DATE	LPC	PAYMENT	DATE	BALANCE	COMMENTS
												-\$53.84	
1/30/2024	33	368	A	600	18.18	\$27.12		2/23/2024				-\$53.84	
										\$119.00	1/18/2024	-\$80.96	
12/28/2023	29	362	A	500	17.24	\$25.55	\$12.49	1/24/2024				\$38.04	
										\$33.21	12/26/2023	\$0.00	
11/29/2023	30	357	A	200	6.67	\$20.72	\$12.49	12/26/2023				\$33.21	
										\$46.10	11/27/2023	\$0.00	
10/30/2023	32	355	A	1,000	31.25	\$33.61	\$12.49	11/27/2023				\$46.10	
										\$149.19	10/25/2023	\$0.00	
9/28/2023	29	345	A	7,400	255.17	\$136.70	\$12.49	10/24/2023				\$149.19	
										\$141.53	9/20/2023	\$0.00	
8/30/2023	33	271	A	7,700	233.33	\$141.53		9/25/2023				\$141.53	
										\$117.37	8/23/2023	\$0.00	
7/28/2023	29	194	A	6,200	213.79	\$117.37		8/23/2023				\$117.37	
										\$117.39	7/26/2023	\$0.00	
6/29/2023	30	132	A	6,200	206.67	\$117.39		7/27/2023				\$117.39	
										\$104.50	6/28/2023	\$0.00	
5/30/2023	32	70	A	5,400	168.75	\$104.50		6/27/2023				\$104.50	
										\$72.29	6/2/2023	\$0.00	
5/12/2023						-\$19.33		6/5/2023				\$72.29	Leak Adjustment 02/28/2023 - 03/30/2023
									-\$30.00			\$91.62	Courtesy Adjustment
4/28/2023	29	16 / 2040	A	4,600	158.62	\$91.62		5/24/2023				\$121.62	Meter change In @0A out @2040A
									\$30.00		5/2/2023	\$30.00	Reconnection after repairs
										\$91.60	4/12/2023	\$0.00	
3/30/2023	31	2010	A	4,600	148.39	\$91.60		4/25/2023				\$91.60	
										\$77.10	3/17/2023	\$0.00	
2/27/2023	28	1964	A	3,700	132.14	\$77.10		3/23/2023				\$77.10	
										\$68.72	2/23/2023	\$0.00	
1/30/2023	32	1927	A	3,900	121.88	\$68.72		2/24/2023				\$68.72	
										\$61.57	1/19/2023	\$0.00	
12/29/2022	30	1888	A	3,300	110.00	\$61.57		1/25/2023				\$61.57	
										\$58.66	12/20/2022	\$0.00	
11/29/2022	32	1855	A	3,100	96.88	\$58.66		12/23/2022				\$58.66	

TYPE CODES: A - ACTUAL C - CUSTOMER R - REMOTE READ
 E - ESTIMATE M - MANUAL
 K - ADJUSTED READING G - SERVICE ORDER D - RADIO FREQUENCY

FA - FINAL (ACTUAL)
 FE - FINAL (ESTIMATE)
 FM - FINAL (MANUAL)

PENNSYLVANIA AMERICAN WATER ACCOUNT STATEMENT

PG 2

Connect Date: 10/01/2013 water

Customer: Alexander Argentina

Address: 114 Fremont St , Pittsburgh , PA

Acct. No.: 210032542353

33.21


SVC TO	DAYS	MTR RDG	TYPE	CONS	ADC	WATER AMT	WLPP	DUE DATE	LPC	PAYMENT	DATE	BALANCE	COMMENTS
										\$45.44	11/17/2022	\$2.40	
10/28/2022	28	1824	A	2,100	75.00	\$45.44		11/23/2022				\$47.84	
										\$35.68	10/18/2022	\$2.40	
9/30/2022	31	1803	A	1,400	45.16	\$35.78		10/25/2022				\$38.08	
										\$35.88	9/21/2022	\$2.30	
8/30/2022	33	1789	A	1,400	42.42	\$35.78		9/23/2022				\$38.18	
										\$29.24	8/15/2022	\$2.40	
7/28/2022	29	1775	A	900	31.03	\$29.24		8/23/2022				\$31.64	
										\$44.39	7/25/2022	\$2.40	
6/29/2022	33	1766	A	2,100	63.64	\$44.39		7/28/2022				\$46.79	
										\$50.85	6/27/2022	\$2.40	
5/27/2022	29	1745	A	2,600	89.66	\$50.85		6/23/2022				\$53.25	
										\$74.10	5/24/2022	\$2.40	
4/28/2022	29	1719	A	4,400	151.72	\$74.10		5/24/2022				\$76.50	
										\$40.44	4/25/2022	\$2.40	
3/30/2022	33	1675	A	1,800	54.55	\$40.44		4/25/2022				\$42.84	
										\$38.58	3/28/2022	\$2.40	
2/25/2022	25	1657	A	1,900	76.00	\$38.66		3/23/2022				\$40.98	
									\$1.20		3/1/2022	\$2.32	
										\$75.75	2/17/2022	\$1.12	
1/31/2022	33	1638	A	1,700	51.52	\$39.11		2/24/2022				\$76.87	
									\$0.56		2/2/2022	\$37.76	
12/29/2021	30	1621	A	1,600	53.33	\$37.20		1/25/2022				\$37.20	
										\$40.41	12/22/2021	\$0.00	
11/29/2021	32	1605	A	1,800	56.25	\$39.77		12/23/2021				\$40.41	
									\$0.64		12/1/2021	\$0.64	
										\$42.55	11/29/2021	\$0.00	
												\$42.55	Prior Balance

TYPE CODES: A - ACTUAL C - CUSTOMER R - REMOTE READ
 E - ESTIMATE M - MANUAL
 K - ADJUSTED READING G - SERVICE ORDER D - RADIO FREQUENCY

FA - FINAL (ACTUAL)
 FE - FINAL (ESTIMATE)
 FM - FINAL (MANUAL)

PAWC Exhibit 2

E-Coder R900i Data Logging Report
MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

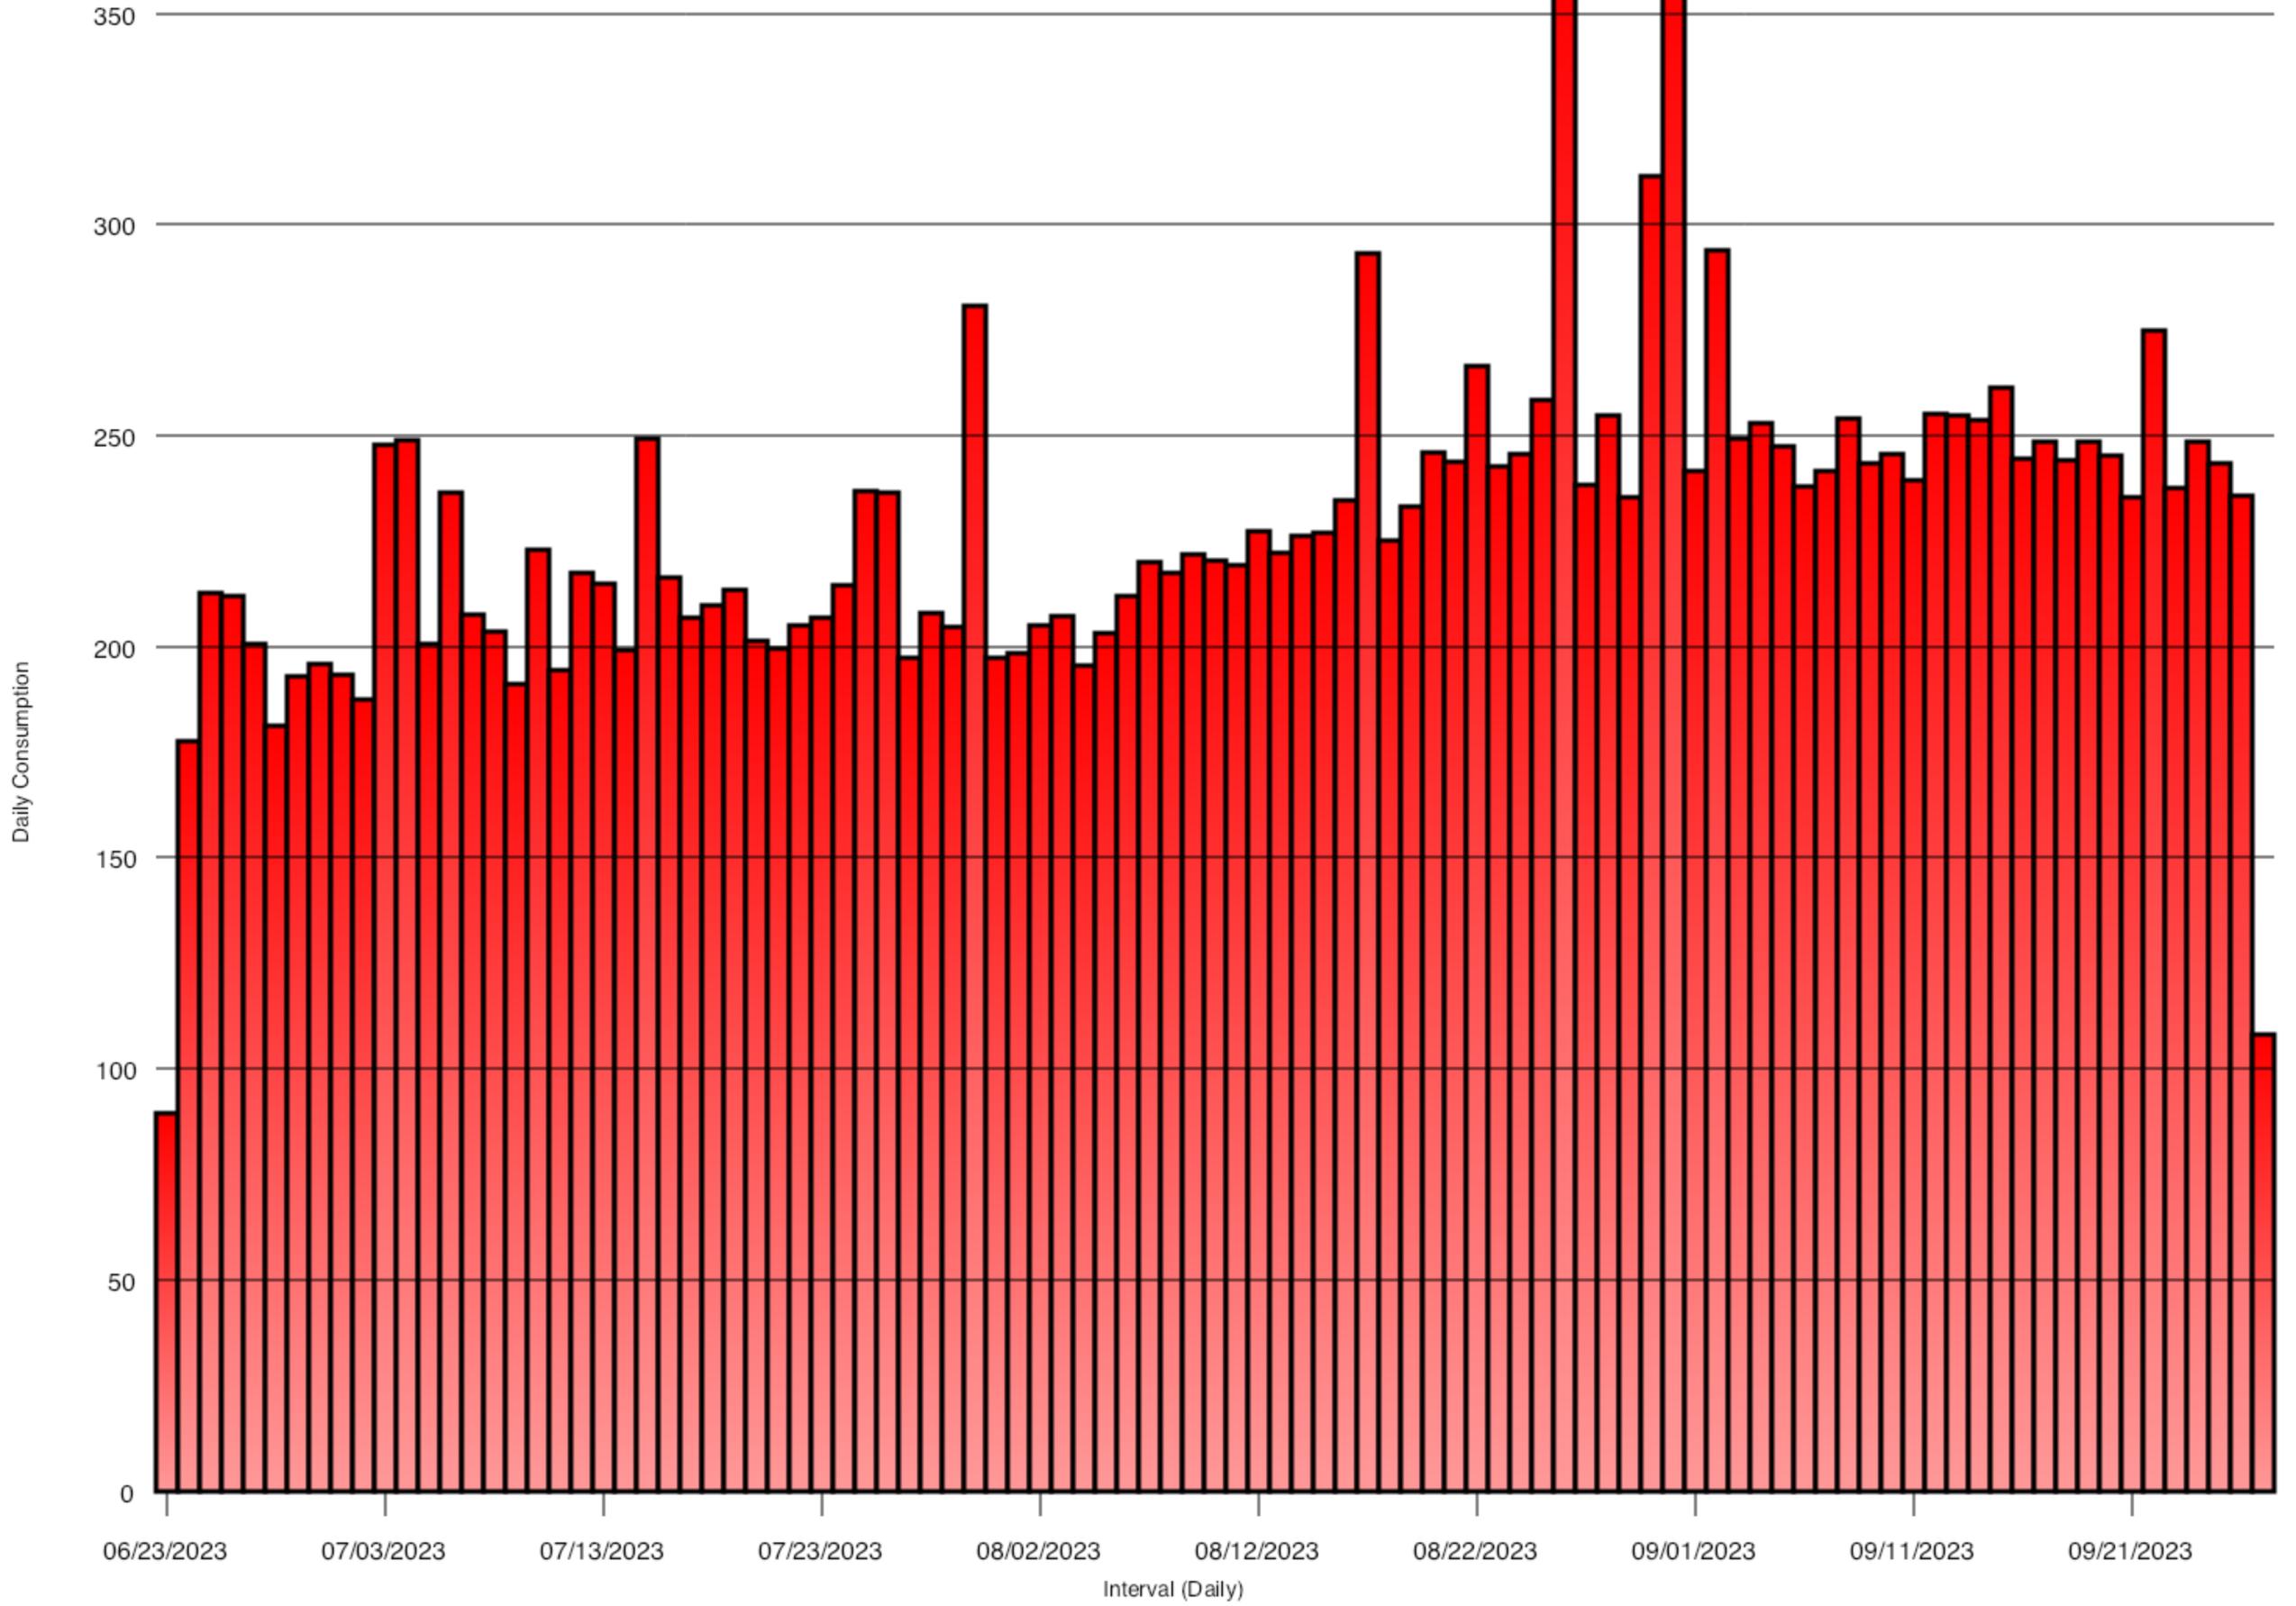

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
06/23/2023 11:05	12085.6		None	Continuous
06/23/2023 12:05	12092.9	7.3	None	Continuous
06/23/2023 13:05	12100.2	7.3	None	Continuous
06/23/2023 14:05	12107.5	7.3	None	Continuous
06/23/2023 15:05	12114.8	7.3	None	Continuous
06/23/2023 16:05	12122.1	7.3	None	Continuous
06/23/2023 17:05	12129.7	7.6	None	Continuous
06/23/2023 18:05	12137.0	7.3	None	Continuous
06/23/2023 19:05	12145.8	8.8	None	Continuous
06/23/2023 20:05	12153.1	7.3	None	Continuous
06/23/2023 21:05	12160.3	7.2	None	Continuous
06/23/2023 22:05	12167.5	7.2	None	Continuous
06/23/2023 23:05	12174.9	7.4	None	Continuous
06/24/2023 00:05	12182.6	7.7	None	Continuous
06/24/2023 01:05	12190.0	7.4	None	Continuous
06/24/2023 02:05	12197.3	7.3	None	Continuous
06/24/2023 03:05	12204.8	7.5	None	Continuous
06/24/2023 04:05	12212.1	7.3	None	Continuous
06/24/2023 05:05	12219.5	7.4	None	Continuous
06/24/2023 06:05	12227.0	7.5	None	Continuous
06/24/2023 07:05	12234.8	7.8	None	Continuous
06/24/2023 08:05	12242.3	7.5	None	Continuous
06/24/2023 09:05	12249.7	7.4	None	Continuous
06/24/2023 10:05	12257.5	7.8	None	Continuous
06/24/2023 11:05	12264.9	7.4	None	Continuous
06/24/2023 12:05	12272.2	7.3	None	Continuous
06/24/2023 13:05	12279.6	7.4	None	Continuous
06/24/2023 14:05	12286.8	7.2	None	Continuous
06/24/2023 15:05	12294.0	7.2	None	Continuous
06/24/2023 16:05	12301.2	7.2	None	Continuous
06/24/2023 17:05	12308.4	7.2	None	Continuous
06/24/2023 18:05	12315.6	7.2	None	Continuous
06/24/2023 19:05	12322.8	7.2	None	Continuous
06/24/2023 20:05	12330.2	7.4	None	Continuous
06/24/2023 21:05	12337.4	7.2	None	Continuous
06/24/2023 22:05	12344.9	7.5	None	Continuous
06/24/2023 23:05	12352.4	7.5	None	Continuous
06/25/2023 00:05	12359.6	7.2	None	Continuous
06/25/2023 01:05	12366.9	7.3	None	Continuous
06/25/2023 02:05	12374.3	7.4	None	Continuous
06/25/2023 03:05	12381.7	7.4	None	Continuous
06/25/2023 04:05	12389.1	7.4	None	Continuous
06/25/2023 05:05	12396.5	7.4	None	Continuous
06/25/2023 06:05	12404.0	7.5	None	Continuous
06/25/2023 07:05	12411.5	7.5	None	Continuous
06/25/2023 08:05	12419.0	7.5	None	Continuous
06/25/2023 09:05	12426.9	7.9	None	Continuous
06/25/2023 10:05	12434.3	7.4	None	Continuous
06/25/2023 11:05	12441.8	7.5	None	Continuous
06/25/2023 12:05	12450.6	8.8	None	Continuous
06/25/2023 13:05	12462.4	11.8	None	Continuous
06/25/2023 14:05	12500.3	37.9	None	Continuous
06/25/2023 15:05	12507.5	7.2	None	Continuous
06/25/2023 16:05	12514.6	7.1	None	Continuous
06/25/2023 17:05	12521.8	7.2	None	Continuous
06/25/2023 18:05	12529.0	7.2	None	Continuous
06/25/2023 19:05	12536.4	7.4	None	Continuous
06/25/2023 20:05	12543.6	7.2	None	Continuous
06/25/2023 21:05	12550.7	7.1	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
06/25/2023 22:05	12557.9	7.2	None	Continuous
06/25/2023 23:05	12565.2	7.3	None	Continuous
06/26/2023 00:05	12572.5	7.3	None	Continuous
06/26/2023 01:05	12579.8	7.3	None	Continuous
06/26/2023 02:05	12588.0	8.2	None	Continuous
06/26/2023 03:05	12595.5	7.5	None	Continuous
06/26/2023 04:05	12603.1	7.6	None	Continuous
06/26/2023 05:05	12610.6	7.5	None	Continuous
06/26/2023 06:05	12618.2	7.6	None	Continuous
06/26/2023 07:05	12625.7	7.5	None	Continuous
06/26/2023 08:05	12633.1	7.4	None	Continuous
06/26/2023 09:05	12640.6	7.5	None	Continuous
06/26/2023 10:05	12648.1	7.5	None	Continuous
06/26/2023 11:05	12655.6	7.5	None	Continuous
06/26/2023 12:05	12663.2	7.6	None	Continuous
06/26/2023 13:05	12670.8	7.6	None	Continuous
06/26/2023 14:05	12678.3	7.5	None	Continuous
06/26/2023 15:05	12685.6	7.3	None	Continuous
06/26/2023 16:05	12723.4	37.8	None	Continuous
06/26/2023 17:05	12730.5	7.1	None	Continuous
06/26/2023 18:05	12737.7	7.2	None	Continuous
06/26/2023 19:05	12746.2	8.5	None	Continuous
06/26/2023 20:05	12753.4	7.2	None	Continuous
06/26/2023 21:05	12760.6	7.2	None	Continuous
06/26/2023 22:05	12769.9	9.3	None	Continuous
06/26/2023 23:05	12777.2	7.3	None	Continuous
06/27/2023 00:05	12784.9	7.7	None	Continuous
06/27/2023 01:05	12792.3	7.4	None	Continuous
06/27/2023 02:05	12799.7	7.4	None	Continuous
06/27/2023 03:05	12807.1	7.4	None	Continuous
06/27/2023 04:05	12815.0	7.9	None	Continuous
06/27/2023 05:05	12822.5	7.5	None	Continuous
06/27/2023 06:05	12830.0	7.5	None	Continuous
06/27/2023 07:05	12837.6	7.6	None	Continuous
06/27/2023 08:05	12848.1	10.5	None	Continuous
06/27/2023 09:05	12855.6	7.5	None	Continuous
06/27/2023 10:05	12863.0	7.4	None	Continuous
06/27/2023 11:05	12870.4	7.4	None	Continuous
06/27/2023 12:05	12877.8	7.4	None	Continuous
06/27/2023 13:05	12885.5	7.7	None	Continuous
06/27/2023 14:05	12892.9	7.4	None	Continuous
06/27/2023 15:05	12900.3	7.4	None	Continuous
06/27/2023 16:05	12907.7	7.4	None	Continuous
06/27/2023 17:05	12915.1	7.4	None	Continuous
06/27/2023 18:05	12939.9	24.8	None	Continuous
06/27/2023 19:05	12947.2	7.3	None	Continuous
06/27/2023 20:05	12954.6	7.4	None	Continuous
06/27/2023 21:05	12962.0	7.4	None	Continuous
06/27/2023 22:05	12969.3	7.3	None	Continuous
06/27/2023 23:05	12977.9	8.6	None	Continuous
06/28/2023 00:05	12985.3	7.4	None	Continuous
06/28/2023 01:05	12992.7	7.4	None	Continuous
06/28/2023 02:05	13000.1	7.4	None	Continuous
06/28/2023 03:05	13007.7	7.6	None	Continuous
06/28/2023 04:05	13015.2	7.5	None	Continuous
06/28/2023 05:05	13022.8	7.6	None	Continuous
06/28/2023 06:05	13030.3	7.5	None	Continuous
06/28/2023 07:05	13037.8	7.5	None	Continuous
06/28/2023 08:05	13045.3	7.5	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
06/28/2023 09:05	13054.5	9.2	None	Continuous
06/28/2023 10:05	13062.2	7.7	None	Continuous
06/28/2023 11:05	13069.7	7.5	None	Continuous
06/28/2023 12:05	13077.1	7.4	None	Continuous
06/28/2023 13:05	13084.6	7.5	None	Continuous
06/28/2023 14:05	13092.4	7.8	None	Continuous
06/28/2023 15:05	13099.9	7.5	None	Continuous
06/28/2023 16:05	13107.3	7.4	None	Continuous
06/28/2023 17:05	13114.8	7.5	None	Continuous
06/28/2023 18:05	13122.1	7.3	None	Continuous
06/28/2023 19:05	13129.5	7.4	None	Continuous
06/28/2023 20:05	13136.9	7.4	None	Continuous
06/28/2023 21:05	13144.3	7.4	None	Continuous
06/28/2023 22:05	13151.9	7.6	None	Continuous
06/28/2023 23:05	13159.2	7.3	None	Continuous
06/29/2023 00:05	13166.7	7.5	None	Continuous
06/29/2023 01:05	13174.1	7.4	None	Continuous
06/29/2023 02:05	13181.7	7.6	None	Continuous
06/29/2023 03:05	13189.2	7.5	None	Continuous
06/29/2023 04:05	13196.8	7.6	None	Continuous
06/29/2023 05:05	13204.4	7.6	None	Continuous
06/29/2023 06:05	13213.1	8.7	None	Continuous
06/29/2023 07:05	13220.6	7.5	None	Continuous
06/29/2023 08:05	13228.2	7.6	None	Continuous
06/29/2023 09:05	13235.7	7.5	None	Continuous
06/29/2023 10:05	13243.4	7.7	None	Continuous
06/29/2023 11:05	13250.9	7.5	None	Continuous
06/29/2023 12:05	13258.4	7.5	None	Continuous
06/29/2023 13:05	13266.0	7.6	None	Continuous
06/29/2023 14:05	13284.1	18.1	None	Continuous
06/29/2023 15:05	13291.5	7.4	None	Continuous
06/29/2023 16:05	13298.9	7.4	None	Continuous
06/29/2023 17:05	13306.3	7.4	None	Continuous
06/29/2023 18:05	13313.7	7.4	None	Continuous
06/29/2023 19:05	13321.0	7.3	None	Continuous
06/29/2023 20:05	13328.3	7.3	None	Continuous
06/29/2023 21:05	13335.6	7.3	None	Continuous
06/29/2023 22:05	13343.2	7.6	None	Continuous
06/29/2023 23:05	13352.3	9.1	None	Continuous
06/30/2023 00:05	13359.7	7.4	None	Continuous
06/30/2023 01:05	13367.2	7.5	None	Continuous
06/30/2023 02:05	13374.9	7.7	None	Continuous
06/30/2023 03:05	13382.6	7.7	None	Continuous
06/30/2023 04:05	13390.3	7.7	None	Continuous
06/30/2023 05:05	13397.9	7.6	None	Continuous
06/30/2023 06:05	13405.6	7.7	None	Continuous
06/30/2023 07:05	13413.2	7.6	None	Continuous
06/30/2023 08:05	13421.7	8.5	None	Continuous
06/30/2023 09:05	13442.6	20.9	None	Continuous
06/30/2023 10:05	13450.4	7.8	None	Continuous
06/30/2023 11:05	13457.7	7.3	None	Continuous
06/30/2023 12:05	13465.1	7.4	None	Continuous
06/30/2023 13:05	13472.5	7.4	None	Continuous
06/30/2023 14:05	13480.8	8.3	None	Continuous
06/30/2023 15:05	13488.2	7.4	None	Continuous
06/30/2023 16:05	13495.6	7.4	None	Continuous
06/30/2023 17:05	13503.0	7.4	None	Continuous
06/30/2023 18:05	13510.4	7.4	None	Continuous
06/30/2023 19:05	13517.8	7.4	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
06/30/2023 20:05	13525.2	7.4	None	Continuous
06/30/2023 21:05	13533.3	8.1	None	Continuous
06/30/2023 22:05	13540.7	7.4	None	Continuous
06/30/2023 23:05	13548.1	7.4	None	Continuous
07/01/2023 00:05	13555.6	7.5	None	Continuous
07/01/2023 01:05	13563.1	7.5	None	Continuous
07/01/2023 02:05	13570.7	7.6	None	Continuous
07/01/2023 03:05	13578.3	7.6	None	Continuous
07/01/2023 04:05	13585.9	7.6	None	Continuous
07/01/2023 05:05	13593.6	7.7	None	Continuous
07/01/2023 06:05	13601.3	7.7	None	Continuous
07/01/2023 07:05	13609.0	7.7	None	Continuous
07/01/2023 08:05	13618.9	9.9	None	Continuous
07/01/2023 09:05	13628.8	9.9	None	Continuous
07/01/2023 10:05	13643.0	14.2	None	Continuous
07/01/2023 11:05	13650.5	7.5	None	Continuous
07/01/2023 12:05	13658.6	8.1	None	Continuous
07/01/2023 13:05	13666.3	7.7	None	Continuous
07/01/2023 14:05	13673.8	7.5	None	Continuous
07/01/2023 15:05	13681.4	7.6	None	Continuous
07/01/2023 16:05	13688.9	7.5	None	Continuous
07/01/2023 17:05	13696.4	7.5	None	Continuous
07/01/2023 18:05	13703.9	7.5	None	Continuous
07/01/2023 19:05	13711.4	7.5	None	Continuous
07/01/2023 20:05	13718.8	7.4	None	Continuous
07/01/2023 21:05	13726.3	7.5	None	Continuous
07/01/2023 22:05	13733.8	7.5	None	Continuous
07/01/2023 23:05	13741.3	7.5	None	Continuous
07/02/2023 00:05	13748.8	7.5	None	Continuous
07/02/2023 01:05	13756.4	7.6	None	Continuous
07/02/2023 02:05	13764.0	7.6	None	Continuous
07/02/2023 03:05	13771.8	7.8	None	Continuous
07/02/2023 04:05	13779.5	7.7	None	Continuous
07/02/2023 05:05	13787.2	7.7	None	Continuous
07/02/2023 06:05	13794.9	7.7	None	Continuous
07/02/2023 07:05	13804.2	9.3	None	Continuous
07/02/2023 08:05	13812.0	7.8	None	Continuous
07/02/2023 09:05	13820.1	8.1	None	Continuous
07/02/2023 10:05	13828.0	7.9	None	Continuous
07/02/2023 11:05	13836.3	8.3	None	Continuous
07/02/2023 12:05	13844.3	8.0	None	Continuous
07/02/2023 13:05	13852.2	7.9	None	Continuous
07/02/2023 14:05	13859.9	7.7	None	Continuous
07/02/2023 15:05	13867.8	7.9	None	Continuous
07/02/2023 16:05	13875.4	7.6	None	Continuous
07/02/2023 17:05	13883.3	7.9	None	Continuous
07/02/2023 18:05	13890.8	7.5	None	Continuous
07/02/2023 19:05	13898.5	7.7	None	Continuous
07/02/2023 20:05	13905.9	7.4	None	Continuous
07/02/2023 21:05	13913.4	7.5	None	Continuous
07/02/2023 22:05	13921.0	7.6	None	Continuous
07/02/2023 23:05	13928.7	7.7	None	Continuous
07/03/2023 00:05	13936.3	7.6	None	Continuous
07/03/2023 01:05	13943.8	7.5	None	Continuous
07/03/2023 02:05	13951.4	7.6	None	Continuous
07/03/2023 03:05	13959.1	7.7	None	Continuous
07/03/2023 04:05	13966.7	7.6	None	Continuous
07/03/2023 05:05	13974.4	7.7	None	Continuous
07/03/2023 06:05	13982.0	7.6	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/03/2023 07:05	13990.8	8.8	None	Continuous
07/03/2023 08:05	13999.2	8.4	None	Continuous
07/03/2023 09:05	14007.8	8.6	None	Continuous
07/03/2023 10:05	14015.4	7.6	None	Continuous
07/03/2023 11:05	14048.7	33.3	None	Continuous
07/03/2023 12:05	14089.9	41.2	None	Continuous
07/03/2023 13:05	14097.7	7.8	None	Continuous
07/03/2023 14:05	14105.3	7.6	None	Continuous
07/03/2023 15:05	14112.8	7.5	None	Continuous
07/03/2023 16:05	14120.4	7.6	None	Continuous
07/03/2023 17:05	14127.8	7.4	None	Continuous
07/03/2023 18:05	14135.4	7.6	None	Continuous
07/03/2023 19:05	14146.5	11.1	None	Continuous
07/03/2023 20:05	14153.9	7.4	None	Continuous
07/03/2023 21:05	14161.5	7.6	None	Continuous
07/03/2023 22:05	14169.0	7.5	None	Continuous
07/03/2023 23:05	14176.6	7.6	None	Continuous
07/04/2023 00:05	14184.3	7.7	None	Continuous
07/04/2023 01:05	14191.8	7.5	None	Continuous
07/04/2023 02:05	14199.4	7.6	None	Continuous
07/04/2023 03:05	14206.9	7.5	None	Continuous
07/04/2023 04:05	14214.6	7.7	None	Continuous
07/04/2023 05:05	14225.4	10.8	None	Continuous
07/04/2023 06:05	14233.1	7.7	None	Continuous
07/04/2023 07:05	14293.6	60.5	None	Continuous
07/04/2023 08:05	14301.4	7.8	None	Continuous
07/04/2023 09:05	14309.0	7.6	None	Continuous
07/04/2023 10:05	14316.6	7.6	None	Continuous
07/04/2023 11:05	14324.5	7.9	None	Continuous
07/04/2023 12:05	14332.1	7.6	None	Continuous
07/04/2023 13:05	14339.7	7.6	None	Continuous
07/04/2023 14:05	14347.5	7.8	None	Continuous
07/04/2023 15:05	14355.1	7.6	None	Continuous
07/04/2023 16:05	14362.6	7.5	None	Continuous
07/04/2023 17:05	14377.2	14.6	None	Continuous
07/04/2023 18:05	14384.8	7.6	None	Continuous
07/04/2023 19:05	14394.4	9.6	None	Continuous
07/04/2023 20:05	14401.8	7.4	None	Continuous
07/04/2023 21:05	14409.3	7.5	None	Continuous
07/04/2023 22:05	14416.8	7.5	None	Continuous
07/04/2023 23:05	14425.6	8.8	None	Continuous
07/05/2023 00:05	14433.1	7.5	None	Continuous
07/05/2023 01:05	14440.7	7.6	None	Continuous
07/05/2023 02:05	14448.4	7.7	None	Continuous
07/05/2023 03:05	14456.1	7.7	None	Continuous
07/05/2023 04:05	14463.8	7.7	None	Continuous
07/05/2023 05:05	14471.4	7.6	None	Continuous
07/05/2023 06:05	14479.1	7.7	None	Continuous
07/05/2023 07:05	14486.8	7.7	None	Continuous
07/05/2023 08:05	14499.6	12.8	None	Continuous
07/05/2023 09:05	14520.4	20.8	None	Continuous
07/05/2023 10:05	14528.0	7.6	None	Continuous
07/05/2023 11:05	14535.6	7.6	None	Continuous
07/05/2023 12:05	14543.2	7.6	None	Continuous
07/05/2023 13:05	14550.7	7.5	None	Continuous
07/05/2023 14:05	14558.3	7.6	None	Continuous
07/05/2023 15:05	14565.8	7.5	None	Continuous
07/05/2023 16:05	14573.5	7.7	None	Continuous
07/05/2023 17:05	14581.0	7.5	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/05/2023 18:05	14588.4	7.4	None	Continuous
07/05/2023 19:05	14596.2	7.8	None	Continuous
07/05/2023 20:05	14603.7	7.5	None	Continuous
07/05/2023 21:05	14611.2	7.5	None	Continuous
07/05/2023 22:05	14618.7	7.5	None	Continuous
07/05/2023 23:05	14626.2	7.5	None	Continuous
07/06/2023 00:05	14634.3	8.1	None	Continuous
07/06/2023 01:05	14642.0	7.7	None	Continuous
07/06/2023 02:05	14649.8	7.8	None	Continuous
07/06/2023 03:05	14657.5	7.7	None	Continuous
07/06/2023 04:05	14665.3	7.8	None	Continuous
07/06/2023 05:05	14673.1	7.8	None	Continuous
07/06/2023 06:05	14680.8	7.7	None	Continuous
07/06/2023 07:05	14688.6	7.8	None	Continuous
07/06/2023 08:05	14696.4	7.8	None	Continuous
07/06/2023 09:05	14704.1	7.7	None	Continuous
07/06/2023 10:05	14715.0	10.9	None	Continuous
07/06/2023 11:05	14723.0	8.0	None	Continuous
07/06/2023 12:05	14734.0	11.0	None	Continuous
07/06/2023 13:05	14742.7	8.7	None	Continuous
07/06/2023 14:05	14793.8	51.1	None	Continuous
07/06/2023 15:05	14801.3	7.5	None	Continuous
07/06/2023 16:05	14809.1	7.8	None	Continuous
07/06/2023 17:05	14816.6	7.5	None	Continuous
07/06/2023 18:05	14824.9	8.3	None	Continuous
07/06/2023 19:05	14832.4	7.5	None	Continuous
07/06/2023 20:05	14840.0	7.6	None	Continuous
07/06/2023 21:05	14847.5	7.5	None	Continuous
07/06/2023 22:05	14855.0	7.5	None	Continuous
07/06/2023 23:05	14862.6	7.6	None	Continuous
07/07/2023 00:05	14870.2	7.6	None	Continuous
07/07/2023 01:05	14877.9	7.7	None	Continuous
07/07/2023 02:05	14885.5	7.6	None	Continuous
07/07/2023 03:05	14894.3	8.8	None	Continuous
07/07/2023 04:05	14902.5	8.2	None	Continuous
07/07/2023 05:05	14910.2	7.7	None	Continuous
07/07/2023 06:05	14921.0	10.8	None	Continuous
07/07/2023 07:05	14928.7	7.7	None	Continuous
07/07/2023 08:05	14936.4	7.7	None	Continuous
07/07/2023 09:05	14964.2	27.8	None	Continuous
07/07/2023 10:05	14971.7	7.5	None	Continuous
07/07/2023 11:05	14979.2	7.5	None	Continuous
07/07/2023 12:05	14987.3	8.1	None	Continuous
07/07/2023 13:05	14994.9	7.6	None	Continuous
07/07/2023 14:05	15002.7	7.8	None	Continuous
07/07/2023 15:05	15010.4	7.7	None	Continuous
07/07/2023 16:05	15017.9	7.5	None	Continuous
07/07/2023 17:05	15025.4	7.5	None	Continuous
07/07/2023 18:05	15032.9	7.5	None	Continuous
07/07/2023 19:05	15040.3	7.4	None	Continuous
07/07/2023 20:05	15047.8	7.5	None	Continuous
07/07/2023 21:05	15055.3	7.5	None	Continuous
07/07/2023 22:05	15062.7	7.4	None	Continuous
07/07/2023 23:05	15070.1	7.4	None	Continuous
07/08/2023 00:05	15077.7	7.6	None	Continuous
07/08/2023 01:05	15085.2	7.5	None	Continuous
07/08/2023 02:05	15092.8	7.6	None	Continuous
07/08/2023 03:05	15100.4	7.6	None	Continuous
07/08/2023 04:05	15108.1	7.7	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/08/2023 05:05	15115.7	7.6	None	Continuous
07/08/2023 06:05	15123.5	7.8	None	Continuous
07/08/2023 07:05	15132.3	8.8	None	Continuous
07/08/2023 08:05	15140.2	7.9	None	Continuous
07/08/2023 09:05	15147.9	7.7	None	Continuous
07/08/2023 10:05	15156.1	8.2	None	Continuous
07/08/2023 11:05	15163.8	7.7	None	Continuous
07/08/2023 12:05	15171.4	7.6	None	Continuous
07/08/2023 13:05	15179.0	7.6	None	Continuous
07/08/2023 14:05	15186.7	7.7	None	Continuous
07/08/2023 15:05	15194.6	7.9	None	Continuous
07/08/2023 16:05	15202.3	7.7	None	Continuous
07/08/2023 17:05	15210.5	8.2	None	Continuous
07/08/2023 18:05	15218.3	7.8	None	Continuous
07/08/2023 19:05	15226.9	8.6	None	Continuous
07/08/2023 20:05	15234.5	7.6	None	Continuous
07/08/2023 21:05	15242.5	8.0	None	Continuous
07/08/2023 22:05	15266.1	23.6	None	Continuous
07/08/2023 23:05	15273.5	7.4	None	Continuous
07/09/2023 00:05	15281.2	7.7	None	Continuous
07/09/2023 01:05	15289.0	7.8	None	Continuous
07/09/2023 02:05	15296.8	7.8	None	Continuous
07/09/2023 03:05	15304.6	7.8	None	Continuous
07/09/2023 04:05	15312.3	7.7	None	Continuous
07/09/2023 05:05	15320.1	7.8	None	Continuous
07/09/2023 06:05	15329.0	8.9	None	Continuous
07/09/2023 07:05	15338.9	9.9	None	Continuous
07/09/2023 08:05	15347.2	8.3	None	Continuous
07/09/2023 09:05	15355.0	7.8	None	Continuous
07/09/2023 10:05	15362.8	7.8	None	Continuous
07/09/2023 11:05	15370.6	7.8	None	Continuous
07/09/2023 12:05	15378.3	7.7	None	Continuous
07/09/2023 13:05	15387.4	9.1	None	Continuous
07/09/2023 14:05	15395.1	7.7	None	Continuous
07/09/2023 15:05	15402.7	7.6	None	Continuous
07/09/2023 16:05	15410.3	7.6	None	Continuous
07/09/2023 17:05	15417.9	7.6	None	Continuous
07/09/2023 18:05	15425.5	7.6	None	Continuous
07/09/2023 19:05	15433.1	7.6	None	Continuous
07/09/2023 20:05	15440.8	7.7	None	Continuous
07/09/2023 21:05	15449.0	8.2	None	Continuous
07/09/2023 22:05	15456.8	7.8	None	Continuous
07/09/2023 23:05	15464.5	7.7	None	Continuous
07/10/2023 00:05	15472.1	7.6	None	Continuous
07/10/2023 01:05	15479.9	7.8	None	Continuous
07/10/2023 02:05	15488.0	8.1	None	Continuous
07/10/2023 03:05	15495.9	7.9	None	Continuous
07/10/2023 04:05	15503.7	7.8	None	Continuous
07/10/2023 05:05	15511.6	7.9	None	Continuous
07/10/2023 06:05	15519.6	8.0	None	Continuous
07/10/2023 07:05	15528.6	9.0	None	Continuous
07/10/2023 08:05	15536.9	8.3	None	Continuous
07/10/2023 09:05	15544.7	7.8	None	Continuous
07/10/2023 10:05	15552.5	7.8	None	Continuous
07/10/2023 11:05	15560.2	7.7	None	Continuous
07/10/2023 12:05	15590.7	30.5	None	Continuous
07/10/2023 13:05	15598.3	7.6	None	Continuous
07/10/2023 14:05	15606.1	7.8	None	Continuous
07/10/2023 15:05	15614.0	7.9	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/10/2023 16:05	15622.0	8.0	None	Continuous
07/10/2023 17:05	15630.3	8.3	None	Continuous
07/10/2023 18:05	15646.0	15.7	None	Continuous
07/10/2023 19:05	15654.6	8.6	None	Continuous
07/10/2023 20:05	15662.4	7.8	None	Continuous
07/10/2023 21:05	15670.9	8.5	None	Continuous
07/10/2023 22:05	15679.3	8.4	None	Continuous
07/10/2023 23:05	15687.4	8.1	None	Continuous
07/11/2023 00:05	15695.5	8.1	None	Continuous
07/11/2023 01:05	15703.6	8.1	None	Continuous
07/11/2023 02:05	15711.9	8.3	None	Continuous
07/11/2023 03:05	15719.9	8.0	None	Continuous
07/11/2023 04:05	15728.2	8.3	None	Continuous
07/11/2023 05:05	15736.3	8.1	None	Continuous
07/11/2023 06:05	15745.1	8.8	None	Continuous
07/11/2023 07:05	15753.1	8.0	None	Continuous
07/11/2023 08:05	15761.1	8.0	None	Continuous
07/11/2023 09:05	15769.4	8.3	None	Continuous
07/11/2023 10:05	15777.4	8.0	None	Continuous
07/11/2023 11:05	15785.4	8.0	None	Continuous
07/11/2023 12:05	15793.4	8.0	None	Continuous
07/11/2023 13:05	15801.3	7.9	None	Continuous
07/11/2023 14:05	15809.3	8.0	None	Continuous
07/11/2023 15:05	15818.3	9.0	None	Continuous
07/11/2023 16:05	15826.2	7.9	None	Continuous
07/11/2023 17:05	15834.1	7.9	None	Continuous
07/11/2023 18:05	15841.9	7.8	None	Continuous
07/11/2023 19:05	15849.8	7.9	None	Continuous
07/11/2023 20:05	15857.5	7.7	None	Continuous
07/11/2023 21:05	15865.3	7.8	None	Continuous
07/11/2023 22:05	15873.8	8.5	None	Continuous
07/11/2023 23:05	15881.7	7.9	None	Continuous
07/12/2023 00:05	15889.8	8.1	None	Continuous
07/12/2023 01:05	15898.0	8.2	None	Continuous
07/12/2023 02:05	15906.1	8.1	None	Continuous
07/12/2023 03:05	15914.2	8.1	None	Continuous
07/12/2023 04:05	15922.3	8.1	None	Continuous
07/12/2023 05:05	15930.5	8.2	None	Continuous
07/12/2023 06:05	15938.6	8.1	None	Continuous
07/12/2023 07:05	15948.2	9.6	None	Continuous
07/12/2023 08:05	15957.1	8.9	None	Continuous
07/12/2023 09:05	15965.9	8.8	None	Continuous
07/12/2023 10:05	15974.0	8.1	None	Continuous
07/12/2023 11:05	15981.9	7.9	None	Continuous
07/12/2023 12:05	15989.9	8.0	None	Continuous
07/12/2023 13:05	15997.8	7.9	None	Continuous
07/12/2023 14:05	16005.7	7.9	None	Continuous
07/12/2023 15:05	16013.7	8.0	None	Continuous
07/12/2023 16:05	16021.6	7.9	None	Continuous
07/12/2023 17:05	16049.9	28.3	None	Continuous
07/12/2023 18:05	16057.7	7.8	None	Continuous
07/12/2023 19:05	16065.5	7.8	None	Continuous
07/12/2023 20:05	16074.6	9.1	None	Continuous
07/12/2023 21:05	16082.6	8.0	None	Continuous
07/12/2023 22:05	16090.4	7.8	None	Continuous
07/12/2023 23:05	16099.3	8.9	None	Continuous
07/13/2023 00:05	16107.3	8.0	None	Continuous
07/13/2023 01:05	16115.3	8.0	None	Continuous
07/13/2023 02:05	16123.4	8.1	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/13/2023 03:05	16131.5	8.1	None	Continuous
07/13/2023 04:05	16139.5	8.0	None	Continuous
07/13/2023 05:05	16147.6	8.1	None	Continuous
07/13/2023 06:05	16156.4	8.8	None	Continuous
07/13/2023 07:05	16164.4	8.0	None	Continuous
07/13/2023 08:05	16172.5	8.1	None	Continuous
07/13/2023 09:05	16181.2	8.7	None	Continuous
07/13/2023 10:05	16190.0	8.8	None	Continuous
07/13/2023 11:05	16197.9	7.9	None	Continuous
07/13/2023 12:05	16205.9	8.0	None	Continuous
07/13/2023 13:05	16213.9	8.0	None	Continuous
07/13/2023 14:05	16221.9	8.0	None	Continuous
07/13/2023 15:05	16251.3	29.4	None	Continuous
07/13/2023 16:05	16259.1	7.8	None	Continuous
07/13/2023 17:05	16266.9	7.8	None	Continuous
07/13/2023 18:05	16274.9	8.0	None	Continuous
07/13/2023 19:05	16282.6	7.7	None	Continuous
07/13/2023 20:05	16290.4	7.8	None	Continuous
07/13/2023 21:05	16298.3	7.9	None	Continuous
07/13/2023 22:05	16306.2	7.9	None	Continuous
07/13/2023 23:05	16314.1	7.9	None	Continuous
07/14/2023 00:05	16322.1	8.0	None	Continuous
07/14/2023 01:05	16330.5	8.4	None	Continuous
07/14/2023 02:05	16338.6	8.1	None	Continuous
07/14/2023 03:05	16346.8	8.2	None	Continuous
07/14/2023 04:05	16355.0	8.2	None	Continuous
07/14/2023 05:05	16363.2	8.2	None	Continuous
07/14/2023 06:05	16371.5	8.3	None	Continuous
07/14/2023 07:05	16379.8	8.3	None	Continuous
07/14/2023 08:05	16387.9	8.1	None	Continuous
07/14/2023 09:05	16396.1	8.2	None	Continuous
07/14/2023 10:05	16405.4	9.3	None	Continuous
07/14/2023 11:05	16413.5	8.1	None	Continuous
07/14/2023 12:05	16421.5	8.0	None	Continuous
07/14/2023 13:05	16429.5	8.0	None	Continuous
07/14/2023 14:05	16437.5	8.0	None	Continuous
07/14/2023 15:05	16445.4	7.9	None	Continuous
07/14/2023 16:05	16454.2	8.8	None	Continuous
07/14/2023 17:05	16462.1	7.9	None	Continuous
07/14/2023 18:05	16474.2	12.1	None	Continuous
07/14/2023 19:05	16482.1	7.9	None	Continuous
07/14/2023 20:05	16489.8	7.7	None	Continuous
07/14/2023 21:05	16497.6	7.8	None	Continuous
07/14/2023 22:05	16505.4	7.8	None	Continuous
07/14/2023 23:05	16513.2	7.8	None	Continuous
07/15/2023 00:05	16521.1	7.9	None	Continuous
07/15/2023 01:05	16529.1	8.0	None	Continuous
07/15/2023 02:05	16537.1	8.0	None	Continuous
07/15/2023 03:05	16545.1	8.0	None	Continuous
07/15/2023 04:05	16553.2	8.1	None	Continuous
07/15/2023 05:05	16562.4	9.2	None	Continuous
07/15/2023 06:05	16570.6	8.2	None	Continuous
07/15/2023 07:05	16578.7	8.1	None	Continuous
07/15/2023 08:05	16587.0	8.3	None	Continuous
07/15/2023 09:05	16595.1	8.1	None	Continuous
07/15/2023 10:05	16603.2	8.1	None	Continuous
07/15/2023 11:05	16611.7	8.5	None	Continuous
07/15/2023 12:05	16619.7	8.0	None	Continuous
07/15/2023 13:05	16677.8	58.1	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/15/2023 14:05	16688.7	10.9	None	Continuous
07/15/2023 15:05	16696.4	7.7	None	Continuous
07/15/2023 16:05	16704.3	7.9	None	Continuous
07/15/2023 17:05	16712.9	8.6	None	Continuous
07/15/2023 18:05	16720.7	7.8	None	Continuous
07/15/2023 19:05	16729.9	9.2	None	Continuous
07/15/2023 20:05	16737.6	7.7	None	Continuous
07/15/2023 21:05	16746.6	9.0	None	Continuous
07/15/2023 22:05	16754.4	7.8	None	Continuous
07/15/2023 23:05	16762.3	7.9	None	Continuous
07/16/2023 00:05	16770.2	7.9	None	Continuous
07/16/2023 01:05	16778.2	8.0	None	Continuous
07/16/2023 02:05	16786.2	8.0	None	Continuous
07/16/2023 03:05	16794.3	8.1	None	Continuous
07/16/2023 04:05	16802.3	8.0	None	Continuous
07/16/2023 05:05	16814.9	12.6	None	Continuous
07/16/2023 06:05	16823.1	8.2	None	Continuous
07/16/2023 07:05	16848.9	25.8	None	Continuous
07/16/2023 08:05	16856.9	8.0	None	Continuous
07/16/2023 09:05	16864.9	8.0	None	Continuous
07/16/2023 10:05	16872.8	7.9	None	Continuous
07/16/2023 11:05	16880.7	7.9	None	Continuous
07/16/2023 12:05	16892.3	11.6	None	Continuous
07/16/2023 13:05	16900.1	7.8	None	Continuous
07/16/2023 14:05	16907.9	7.8	None	Continuous
07/16/2023 15:05	16915.8	7.9	None	Continuous
07/16/2023 16:05	16923.6	7.8	None	Continuous
07/16/2023 17:05	16931.5	7.9	None	Continuous
07/16/2023 18:05	16939.5	8.0	None	Continuous
07/16/2023 19:05	16947.4	7.9	None	Continuous
07/16/2023 20:05	16955.2	7.8	None	Continuous
07/16/2023 21:05	16963.0	7.8	None	Continuous
07/16/2023 22:05	16970.8	7.8	None	Continuous
07/16/2023 23:05	16978.7	7.9	None	Continuous
07/17/2023 00:05	16986.7	8.0	None	Continuous
07/17/2023 01:05	16994.8	8.1	None	Continuous
07/17/2023 02:05	17003.0	8.2	None	Continuous
07/17/2023 03:05	17010.9	7.9	None	Continuous
07/17/2023 04:05	17018.9	8.0	None	Continuous
07/17/2023 05:05	17027.3	8.4	None	Continuous
07/17/2023 06:05	17035.5	8.2	None	Continuous
07/17/2023 07:05	17043.6	8.1	None	Continuous
07/17/2023 08:05	17051.7	8.1	None	Continuous
07/17/2023 09:05	17059.7	8.0	None	Continuous
07/17/2023 10:05	17067.6	7.9	None	Continuous
07/17/2023 11:05	17075.5	7.9	None	Continuous
07/17/2023 12:05	17084.1	8.6	None	Continuous
07/17/2023 13:05	17092.3	8.2	None	Continuous
07/17/2023 14:05	17114.0	21.7	None	Continuous
07/17/2023 15:05	17121.9	7.9	None	Continuous
07/17/2023 16:05	17129.7	7.8	None	Continuous
07/17/2023 17:05	17137.6	7.9	None	Continuous
07/17/2023 18:05	17145.5	7.9	None	Continuous
07/17/2023 19:05	17153.3	7.8	None	Continuous
07/17/2023 20:05	17161.0	7.7	None	Continuous
07/17/2023 21:05	17170.0	9.0	None	Continuous
07/17/2023 22:05	17177.7	7.7	None	Continuous
07/17/2023 23:05	17185.5	7.8	None	Continuous
07/18/2023 00:05	17193.5	8.0	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/18/2023 01:05	17203.0	9.5	None	Continuous
07/18/2023 02:05	17211.1	8.1	None	Continuous
07/18/2023 03:05	17219.1	8.0	None	Continuous
07/18/2023 04:05	17227.2	8.1	None	Continuous
07/18/2023 05:05	17235.2	8.0	None	Continuous
07/18/2023 06:05	17243.3	8.1	None	Continuous
07/18/2023 07:05	17251.3	8.0	None	Continuous
07/18/2023 08:05	17259.3	8.0	None	Continuous
07/18/2023 09:05	17267.2	7.9	None	Continuous
07/18/2023 10:05	17276.1	8.9	None	Continuous
07/18/2023 11:05	17284.0	7.9	None	Continuous
07/18/2023 12:05	17292.0	8.0	None	Continuous
07/18/2023 13:05	17300.8	8.8	None	Continuous
07/18/2023 14:05	17308.7	7.9	None	Continuous
07/18/2023 15:05	17317.0	8.3	None	Continuous
07/18/2023 16:05	17325.7	8.7	None	Continuous
07/18/2023 17:05	17333.8	8.1	None	Continuous
07/18/2023 18:05	17341.6	7.8	None	Continuous
07/18/2023 19:05	17363.4	21.8	None	Continuous
07/18/2023 20:05	17371.8	8.4	None	Continuous
07/18/2023 21:05	17379.6	7.8	None	Continuous
07/18/2023 22:05	17387.4	7.8	None	Continuous
07/18/2023 23:05	17395.2	7.8	None	Continuous
07/19/2023 00:05	17403.1	7.9	None	Continuous
07/19/2023 01:05	17411.2	8.1	None	Continuous
07/19/2023 02:05	17419.3	8.1	None	Continuous
07/19/2023 03:05	17427.3	8.0	None	Continuous
07/19/2023 04:05	17435.3	8.0	None	Continuous
07/19/2023 05:05	17443.4	8.1	None	Continuous
07/19/2023 06:05	17451.5	8.1	None	Continuous
07/19/2023 07:05	17460.1	8.6	None	Continuous
07/19/2023 08:05	17468.2	8.1	None	Continuous
07/19/2023 09:05	17476.0	7.8	None	Continuous
07/19/2023 10:05	17484.0	8.0	None	Continuous
07/19/2023 11:05	17497.1	13.1	None	Continuous
07/19/2023 12:05	17522.3	25.2	None	Continuous
07/19/2023 13:05	17530.1	7.8	None	Continuous
07/19/2023 14:05	17538.0	7.9	None	Continuous
07/19/2023 15:05	17545.8	7.8	None	Continuous
07/19/2023 16:05	17553.8	8.0	None	Continuous
07/19/2023 17:05	17561.6	7.8	None	Continuous
07/19/2023 18:05	17569.4	7.8	None	Continuous
07/19/2023 19:05	17577.2	7.8	None	Continuous
07/19/2023 20:05	17585.0	7.8	None	Continuous
07/19/2023 21:05	17592.8	7.8	None	Continuous
07/19/2023 22:05	17600.7	7.9	None	Continuous
07/19/2023 23:05	17608.5	7.8	None	Continuous
07/20/2023 00:05	17616.9	8.4	None	Continuous
07/20/2023 01:05	17624.9	8.0	None	Continuous
07/20/2023 02:05	17632.9	8.0	None	Continuous
07/20/2023 03:05	17640.9	8.0	None	Continuous
07/20/2023 04:05	17648.9	8.0	None	Continuous
07/20/2023 05:05	17657.8	8.9	None	Continuous
07/20/2023 06:05	17665.9	8.1	None	Continuous
07/20/2023 07:05	17674.2	8.3	None	Continuous
07/20/2023 08:05	17682.6	8.4	None	Continuous
07/20/2023 09:05	17690.7	8.1	None	Continuous
07/20/2023 10:05	17698.7	8.0	None	Continuous
07/20/2023 11:05	17706.7	8.0	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/20/2023 12:05	17714.8	8.1	None	Continuous
07/20/2023 13:05	17723.0	8.2	None	Continuous
07/20/2023 14:05	17731.0	8.0	None	Continuous
07/20/2023 15:05	17739.1	8.1	None	Continuous
07/20/2023 16:05	17747.2	8.1	None	Continuous
07/20/2023 17:05	17759.9	12.7	None	Continuous
07/20/2023 18:05	17769.6	9.7	None	Continuous
07/20/2023 19:05	17777.5	7.9	None	Continuous
07/20/2023 20:05	17786.1	8.6	None	Continuous
07/20/2023 21:05	17793.9	7.8	None	Continuous
07/20/2023 22:05	17802.1	8.2	None	Continuous
07/20/2023 23:05	17810.0	7.9	None	Continuous
07/21/2023 00:05	17819.3	9.3	None	Continuous
07/21/2023 01:05	17827.6	8.3	None	Continuous
07/21/2023 02:05	17835.8	8.2	None	Continuous
07/21/2023 03:05	17843.9	8.1	None	Continuous
07/21/2023 04:05	17852.0	8.1	None	Continuous
07/21/2023 05:05	17860.2	8.2	None	Continuous
07/21/2023 06:05	17868.3	8.1	None	Continuous
07/21/2023 07:05	17876.4	8.1	None	Continuous
07/21/2023 08:05	17884.5	8.1	None	Continuous
07/21/2023 09:05	17892.5	8.0	None	Continuous
07/21/2023 10:05	17900.8	8.3	None	Continuous
07/21/2023 11:05	17908.9	8.1	None	Continuous
07/21/2023 12:05	17916.9	8.0	None	Continuous
07/21/2023 13:05	17924.9	8.0	None	Continuous
07/21/2023 14:05	17934.6	9.7	None	Continuous
07/21/2023 15:05	17942.6	8.0	None	Continuous
07/21/2023 16:05	17950.6	8.0	None	Continuous
07/21/2023 17:05	17960.2	9.6	None	Continuous
07/21/2023 18:05	17968.2	8.0	None	Continuous
07/21/2023 19:05	17976.2	8.0	None	Continuous
07/21/2023 20:05	17984.2	8.0	None	Continuous
07/21/2023 21:05	17993.1	8.9	None	Continuous
07/21/2023 22:05	18000.9	7.8	None	Continuous
07/21/2023 23:05	18009.5	8.6	None	Continuous
07/22/2023 00:05	18017.8	8.3	None	Continuous
07/22/2023 01:05	18025.9	8.1	None	Continuous
07/22/2023 02:05	18034.0	8.1	None	Continuous
07/22/2023 03:05	18042.1	8.1	None	Continuous
07/22/2023 04:05	18050.2	8.1	None	Continuous
07/22/2023 05:05	18058.3	8.1	None	Continuous
07/22/2023 06:05	18066.5	8.2	None	Continuous
07/22/2023 07:05	18074.6	8.1	None	Continuous
07/22/2023 08:05	18086.0	11.4	None	Continuous
07/22/2023 09:05	18094.4	8.4	None	Continuous
07/22/2023 10:05	18102.5	8.1	None	Continuous
07/22/2023 11:05	18110.4	7.9	None	Continuous
07/22/2023 12:05	18118.3	7.9	None	Continuous
07/22/2023 13:05	18126.2	7.9	None	Continuous
07/22/2023 14:05	18134.1	7.9	None	Continuous
07/22/2023 15:05	18142.0	7.9	None	Continuous
07/22/2023 16:05	18158.8	16.8	None	Continuous
07/22/2023 17:05	18167.2	8.4	None	Continuous
07/22/2023 18:05	18175.4	8.2	None	Continuous
07/22/2023 19:05	18183.2	7.8	None	Continuous
07/22/2023 20:05	18191.0	7.8	None	Continuous
07/22/2023 21:05	18198.8	7.8	None	Continuous
07/22/2023 22:05	18206.7	7.9	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/22/2023 23:05	18214.5	7.8	None	Continuous
07/23/2023 00:05	18222.6	8.1	None	Continuous
07/23/2023 01:05	18230.6	8.0	None	Continuous
07/23/2023 02:05	18238.6	8.0	None	Continuous
07/23/2023 03:05	18246.6	8.0	None	Continuous
07/23/2023 04:05	18254.6	8.0	None	Continuous
07/23/2023 05:05	18262.7	8.1	None	Continuous
07/23/2023 06:05	18271.4	8.7	None	Continuous
07/23/2023 07:05	18280.5	9.1	None	Continuous
07/23/2023 08:05	18293.5	13.0	None	Continuous
07/23/2023 09:05	18306.1	12.6	None	Continuous
07/23/2023 10:05	18314.2	8.1	None	Continuous
07/23/2023 11:05	18322.3	8.1	None	Continuous
07/23/2023 12:05	18330.2	7.9	None	Continuous
07/23/2023 13:05	18339.0	8.8	None	Continuous
07/23/2023 14:05	18350.5	11.5	None	Continuous
07/23/2023 15:05	18358.5	8.0	None	Continuous
07/23/2023 16:05	18366.3	7.8	None	Continuous
07/23/2023 17:05	18374.3	8.0	None	Continuous
07/23/2023 18:05	18382.3	8.0	None	Continuous
07/23/2023 19:05	18390.1	7.8	None	Continuous
07/23/2023 20:05	18398.0	7.9	None	Continuous
07/23/2023 21:05	18405.8	7.8	None	Continuous
07/23/2023 22:05	18413.6	7.8	None	Continuous
07/23/2023 23:05	18421.5	7.9	None	Continuous
07/24/2023 00:05	18430.1	8.6	None	Continuous
07/24/2023 01:05	18438.2	8.1	None	Continuous
07/24/2023 02:05	18446.3	8.1	None	Continuous
07/24/2023 03:05	18454.4	8.1	None	Continuous
07/24/2023 04:05	18462.6	8.2	None	Continuous
07/24/2023 05:05	18470.7	8.1	None	Continuous
07/24/2023 06:05	18479.0	8.3	None	Continuous
07/24/2023 07:05	18487.2	8.2	None	Continuous
07/24/2023 08:05	18495.3	8.1	None	Continuous
07/24/2023 09:05	18503.4	8.1	None	Continuous
07/24/2023 10:05	18511.4	8.0	None	Continuous
07/24/2023 11:05	18537.8	26.4	None	Continuous
07/24/2023 12:05	18547.3	9.5	None	Continuous
07/24/2023 13:05	18555.3	8.0	None	Continuous
07/24/2023 14:05	18563.3	8.0	None	Continuous
07/24/2023 15:05	18571.4	8.1	None	Continuous
07/24/2023 16:05	18579.5	8.1	None	Continuous
07/24/2023 17:05	18587.5	8.0	None	Continuous
07/24/2023 18:05	18595.7	8.2	None	Continuous
07/24/2023 19:05	18604.1	8.4	None	Continuous
07/24/2023 20:05	18612.0	7.9	None	Continuous
07/24/2023 21:05	18619.9	7.9	None	Continuous
07/24/2023 22:05	18627.8	7.9	None	Continuous
07/24/2023 23:05	18635.9	8.1	None	Continuous
07/25/2023 00:05	18644.7	8.8	None	Continuous
07/25/2023 01:05	18652.8	8.1	None	Continuous
07/25/2023 02:05	18661.0	8.2	None	Continuous
07/25/2023 03:05	18669.2	8.2	None	Continuous
07/25/2023 04:05	18677.8	8.6	None	Continuous
07/25/2023 05:05	18686.1	8.3	None	Continuous
07/25/2023 06:05	18694.6	8.5	None	Continuous
07/25/2023 07:05	18702.9	8.3	None	Continuous
07/25/2023 08:05	18711.3	8.4	None	Continuous
07/25/2023 09:05	18719.7	8.4	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/25/2023 10:05	18728.5	8.8	None	Continuous
07/25/2023 11:05	18736.9	8.4	None	Continuous
07/25/2023 12:05	18745.1	8.2	None	Continuous
07/25/2023 13:05	18753.0	7.9	None	Continuous
07/25/2023 14:05	18766.1	13.1	None	Continuous
07/25/2023 15:05	18774.0	7.9	None	Continuous
07/25/2023 16:05	18782.1	8.1	None	Continuous
07/25/2023 17:05	18790.1	8.0	None	Continuous
07/25/2023 18:05	18798.0	7.9	None	Continuous
07/25/2023 19:05	18805.9	7.9	None	Continuous
07/25/2023 20:05	18813.7	7.8	None	Continuous
07/25/2023 21:05	18821.5	7.8	None	Continuous
07/25/2023 22:05	18829.5	8.0	None	Continuous
07/25/2023 23:05	18872.8	43.3	None	Continuous
07/26/2023 00:05	18880.9	8.1	None	Continuous
07/26/2023 01:05	18889.7	8.8	None	Continuous
07/26/2023 02:05	18898.0	8.3	None	Continuous
07/26/2023 03:05	18906.2	8.2	None	Continuous
07/26/2023 04:05	18914.4	8.2	None	Continuous
07/26/2023 05:05	18922.6	8.2	None	Continuous
07/26/2023 06:05	18930.9	8.3	None	Continuous
07/26/2023 07:05	18939.3	8.4	None	Continuous
07/26/2023 08:05	18948.1	8.8	None	Continuous
07/26/2023 09:05	18956.6	8.5	None	Continuous
07/26/2023 10:05	18964.9	8.3	None	Continuous
07/26/2023 11:05	18972.3	7.4	None	Continuous
07/26/2023 12:05	18979.7	7.4	None	Continuous
07/26/2023 13:05	18987.3	7.6	None	Continuous
07/26/2023 14:05	18995.2	7.9	None	Continuous
07/26/2023 15:05	19045.1	49.9	None	Continuous
07/26/2023 16:05	19053.0	7.9	None	Continuous
07/26/2023 17:05	19061.0	8.0	None	Continuous
07/26/2023 18:05	19068.9	7.9	None	Continuous
07/26/2023 19:05	19076.9	8.0	None	Continuous
07/26/2023 20:05	19084.8	7.9	None	Continuous
07/26/2023 21:05	19093.2	8.4	None	Continuous
07/26/2023 22:05	19101.2	8.0	None	Continuous
07/26/2023 23:05	19109.3	8.1	None	Continuous
07/27/2023 00:05	19117.5	8.2	None	Continuous
07/27/2023 01:05	19125.6	8.1	None	Continuous
07/27/2023 02:05	19133.7	8.1	None	Continuous
07/27/2023 03:05	19141.8	8.1	None	Continuous
07/27/2023 04:05	19149.9	8.1	None	Continuous
07/27/2023 05:05	19158.1	8.2	None	Continuous
07/27/2023 06:05	19166.3	8.2	None	Continuous
07/27/2023 07:05	19174.5	8.2	None	Continuous
07/27/2023 08:05	19183.9	9.4	None	Continuous
07/27/2023 09:05	19192.1	8.2	None	Continuous
07/27/2023 10:05	19200.3	8.2	None	Continuous
07/27/2023 11:05	19208.5	8.2	None	Continuous
07/27/2023 12:05	19216.9	8.4	None	Continuous
07/27/2023 13:05	19225.5	8.6	None	Continuous
07/27/2023 14:05	19233.8	8.3	None	Continuous
07/27/2023 15:05	19242.1	8.3	None	Continuous
07/27/2023 16:05	19250.2	8.1	None	Continuous
07/27/2023 17:05	19258.2	8.0	None	Continuous
07/27/2023 18:05	19266.2	8.0	None	Continuous
07/27/2023 19:05	19274.1	7.9	None	Continuous
07/27/2023 20:05	19282.3	8.2	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/27/2023 21:05	19290.3	8.0	None	Continuous
07/27/2023 22:05	19298.4	8.1	None	Continuous
07/27/2023 23:05	19306.5	8.1	None	Continuous
07/28/2023 00:05	19314.8	8.3	None	Continuous
07/28/2023 01:05	19324.4	9.6	None	Continuous
07/28/2023 02:05	19332.7	8.3	None	Continuous
07/28/2023 03:05	19341.2	8.5	None	Continuous
07/28/2023 04:05	19349.5	8.3	None	Continuous
07/28/2023 05:05	19357.8	8.3	None	Continuous
07/28/2023 06:05	19366.2	8.4	None	Continuous
07/28/2023 07:05	19374.5	8.3	None	Continuous
07/28/2023 08:05	19382.8	8.3	None	Continuous
07/28/2023 09:05	19391.1	8.3	None	Continuous
07/28/2023 10:05	19402.1	11.0	None	Continuous
07/28/2023 11:05	19410.3	8.2	None	Continuous
07/28/2023 12:05	19418.6	8.3	None	Continuous
07/28/2023 13:05	19431.3	12.7	None	Continuous
07/28/2023 14:05	19439.5	8.2	None	Continuous
07/28/2023 15:05	19448.0	8.5	None	Continuous
07/28/2023 16:05	19456.1	8.1	None	Continuous
07/28/2023 17:05	19464.2	8.1	None	Continuous
07/28/2023 18:05	19472.2	8.0	None	Continuous
07/28/2023 19:05	19480.2	8.0	None	Continuous
07/28/2023 20:05	19489.8	9.6	None	Continuous
07/28/2023 21:05	19498.0	8.2	None	Continuous
07/28/2023 22:05	19506.2	8.2	None	Continuous
07/28/2023 23:05	19514.4	8.2	None	Continuous
07/29/2023 00:05	19522.7	8.3	None	Continuous
07/29/2023 01:05	19531.0	8.3	None	Continuous
07/29/2023 02:05	19540.1	9.1	None	Continuous
07/29/2023 03:05	19548.4	8.3	None	Continuous
07/29/2023 04:05	19556.7	8.3	None	Continuous
07/29/2023 05:05	19564.9	8.2	None	Continuous
07/29/2023 06:05	19573.2	8.3	None	Continuous
07/29/2023 07:05	19581.5	8.3	None	Continuous
07/29/2023 08:05	19589.7	8.2	None	Continuous
07/29/2023 09:05	19598.9	9.2	None	Continuous
07/29/2023 10:05	19607.0	8.1	None	Continuous
07/29/2023 11:05	19617.0	10.0	None	Continuous
07/29/2023 12:05	19625.0	8.0	None	Continuous
07/29/2023 13:05	19633.1	8.1	None	Continuous
07/29/2023 14:05	19641.6	8.5	None	Continuous
07/29/2023 15:05	19652.5	10.9	None	Continuous
07/29/2023 16:05	19662.1	9.6	None	Continuous
07/29/2023 17:05	19670.1	8.0	None	Continuous
07/29/2023 18:05	19678.1	8.0	None	Continuous
07/29/2023 19:05	19686.0	7.9	None	Continuous
07/29/2023 20:05	19695.4	9.4	None	Continuous
07/29/2023 21:05	19703.3	7.9	None	Continuous
07/29/2023 22:05	19711.2	7.9	None	Continuous
07/29/2023 23:05	19719.2	8.0	None	Continuous
07/30/2023 00:05	19727.1	7.9	None	Continuous
07/30/2023 01:05	19735.7	8.6	None	Continuous
07/30/2023 02:05	19743.8	8.1	None	Continuous
07/30/2023 03:05	19751.9	8.1	None	Continuous
07/30/2023 04:05	19760.1	8.2	None	Continuous
07/30/2023 05:05	19768.9	8.8	None	Continuous
07/30/2023 06:05	19777.1	8.2	None	Continuous
07/30/2023 07:05	19785.3	8.2	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
07/30/2023 08:05	19796.0	10.7	None	Continuous
07/30/2023 09:05	19805.6	9.6	None	Continuous
07/30/2023 10:05	19813.7	8.1	None	Continuous
07/30/2023 11:05	19821.7	8.0	None	Continuous
07/30/2023 12:05	19829.7	8.0	None	Continuous
07/30/2023 13:05	19839.5	9.8	None	Continuous
07/30/2023 14:05	19847.6	8.1	None	Continuous
07/30/2023 15:05	19856.0	8.4	None	Continuous
07/30/2023 16:05	19864.0	8.0	None	Continuous
07/30/2023 17:05	19903.0	39.0	None	Continuous
07/30/2023 18:05	19959.6	56.6	None	Continuous
07/30/2023 19:05	19967.5	7.9	None	Continuous
07/30/2023 20:05	19975.5	8.0	None	Continuous
07/30/2023 21:05	19983.5	8.0	None	Continuous
07/30/2023 22:05	19991.7	8.2	None	Continuous
07/30/2023 23:05	19999.9	8.2	None	Continuous
07/31/2023 00:05	20007.9	8.0	None	Continuous
07/31/2023 01:05	20016.0	8.1	None	Continuous
07/31/2023 02:05	20024.1	8.1	None	Continuous
07/31/2023 03:05	20032.3	8.2	None	Continuous
07/31/2023 04:05	20040.4	8.1	None	Continuous
07/31/2023 05:05	20048.5	8.1	None	Continuous
07/31/2023 06:05	20057.8	9.3	None	Continuous
07/31/2023 07:05	20066.3	8.5	None	Continuous
07/31/2023 08:05	20074.5	8.2	None	Continuous
07/31/2023 09:05	20082.5	8.0	None	Continuous
07/31/2023 10:05	20090.6	8.1	None	Continuous
07/31/2023 11:05	20098.8	8.2	None	Continuous
07/31/2023 12:05	20107.0	8.2	None	Continuous
07/31/2023 13:05	20115.2	8.2	None	Continuous
07/31/2023 14:05	20123.4	8.2	None	Continuous
07/31/2023 15:05	20131.7	8.3	None	Continuous
07/31/2023 16:05	20139.8	8.1	None	Continuous
07/31/2023 17:05	20147.9	8.1	None	Continuous
07/31/2023 18:05	20155.9	8.0	None	Continuous
07/31/2023 19:05	20164.5	8.6	None	Continuous
07/31/2023 20:05	20173.0	8.5	None	Continuous
07/31/2023 21:05	20181.0	8.0	None	Continuous
07/31/2023 22:05	20189.1	8.1	None	Continuous
07/31/2023 23:05	20197.3	8.2	None	Continuous
08/01/2023 00:05	20205.4	8.1	None	Continuous
08/01/2023 01:05	20213.7	8.3	None	Continuous
08/01/2023 02:05	20222.0	8.3	None	Continuous
08/01/2023 03:05	20230.3	8.3	None	Continuous
08/01/2023 04:05	20238.5	8.2	None	Continuous
08/01/2023 05:05	20246.8	8.3	None	Continuous
08/01/2023 06:05	20256.3	9.5	None	Continuous
08/01/2023 07:05	20264.5	8.2	None	Continuous
08/01/2023 08:05	20272.7	8.2	None	Continuous
08/01/2023 09:05	20280.9	8.2	None	Continuous
08/01/2023 10:05	20289.8	8.9	None	Continuous
08/01/2023 11:05	20297.9	8.1	None	Continuous
08/01/2023 12:05	20306.0	8.1	None	Continuous
08/01/2023 13:05	20314.0	8.0	None	Continuous
08/01/2023 14:05	20322.1	8.1	None	Continuous
08/01/2023 15:05	20330.2	8.1	None	Continuous
08/01/2023 16:05	20338.2	8.0	None	Continuous
08/01/2023 17:05	20346.2	8.0	None	Continuous
08/01/2023 18:05	20354.1	7.9	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/01/2023 19:05	20363.6	9.5	None	Continuous
08/01/2023 20:05	20371.7	8.1	None	Continuous
08/01/2023 21:05	20379.8	8.1	None	Continuous
08/01/2023 22:05	20387.7	7.9	None	Continuous
08/01/2023 23:05	20395.8	8.1	None	Continuous
08/02/2023 00:05	20404.3	8.5	None	Continuous
08/02/2023 01:05	20412.6	8.3	None	Continuous
08/02/2023 02:05	20420.8	8.2	None	Continuous
08/02/2023 03:05	20429.0	8.2	None	Continuous
08/02/2023 04:05	20437.2	8.2	None	Continuous
08/02/2023 05:05	20445.4	8.2	None	Continuous
08/02/2023 06:05	20453.5	8.1	None	Continuous
08/02/2023 07:05	20461.7	8.2	None	Continuous
08/02/2023 08:05	20473.1	11.4	None	Continuous
08/02/2023 09:05	20484.0	10.9	None	Continuous
08/02/2023 10:05	20493.5	9.5	None	Continuous
08/02/2023 11:05	20501.5	8.0	None	Continuous
08/02/2023 12:05	20513.2	11.7	None	Continuous
08/02/2023 13:05	20521.3	8.1	None	Continuous
08/02/2023 14:05	20529.3	8.0	None	Continuous
08/02/2023 15:05	20537.3	8.0	None	Continuous
08/02/2023 16:05	20545.2	7.9	None	Continuous
08/02/2023 17:05	20553.2	8.0	None	Continuous
08/02/2023 18:05	20561.1	7.9	None	Continuous
08/02/2023 19:05	20569.0	7.9	None	Continuous
08/02/2023 20:05	20577.2	8.2	None	Continuous
08/02/2023 21:05	20585.1	7.9	None	Continuous
08/02/2023 22:05	20592.9	7.8	None	Continuous
08/02/2023 23:05	20600.9	8.0	None	Continuous
08/03/2023 00:05	20609.0	8.1	None	Continuous
08/03/2023 01:05	20618.1	9.1	None	Continuous
08/03/2023 02:05	20627.3	9.2	None	Continuous
08/03/2023 03:05	20635.5	8.2	None	Continuous
08/03/2023 04:05	20643.8	8.3	None	Continuous
08/03/2023 05:05	20652.0	8.2	None	Continuous
08/03/2023 06:05	20660.2	8.2	None	Continuous
08/03/2023 07:05	20668.4	8.2	None	Continuous
08/03/2023 08:05	20676.5	8.1	None	Continuous
08/03/2023 09:05	20684.5	8.0	None	Continuous
08/03/2023 10:05	20694.3	9.8	None	Continuous
08/03/2023 11:05	20702.3	8.0	None	Continuous
08/03/2023 12:05	20710.2	7.9	None	Continuous
08/03/2023 13:05	20728.7	18.5	None	Continuous
08/03/2023 14:05	20736.7	8.0	None	Continuous
08/03/2023 15:05	20744.6	7.9	None	Continuous
08/03/2023 16:05	20752.5	7.9	None	Continuous
08/03/2023 17:05	20760.4	7.9	None	Continuous
08/03/2023 18:05	20768.3	7.9	None	Continuous
08/03/2023 19:05	20776.3	8.0	None	Continuous
08/03/2023 20:05	20784.2	7.9	None	Continuous
08/03/2023 21:05	20792.1	7.9	None	Continuous
08/03/2023 22:05	20800.0	7.9	None	Continuous
08/03/2023 23:05	20808.0	8.0	None	Continuous
08/04/2023 00:05	20816.0	8.0	None	Continuous
08/04/2023 01:05	20824.2	8.2	None	Continuous
08/04/2023 02:05	20832.3	8.1	None	Continuous
08/04/2023 03:05	20840.4	8.1	None	Continuous
08/04/2023 04:05	20848.6	8.2	None	Continuous
08/04/2023 05:05	20856.7	8.1	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/04/2023 06:05	20864.8	8.1	None	Continuous
08/04/2023 07:05	20873.0	8.2	None	Continuous
08/04/2023 08:05	20881.1	8.1	None	Continuous
08/04/2023 09:05	20889.1	8.0	None	Continuous
08/04/2023 10:05	20897.3	8.2	None	Continuous
08/04/2023 11:05	20905.3	8.0	None	Continuous
08/04/2023 12:05	20913.2	7.9	None	Continuous
08/04/2023 13:05	20921.6	8.4	None	Continuous
08/04/2023 14:05	20929.5	7.9	None	Continuous
08/04/2023 15:05	20937.4	7.9	None	Continuous
08/04/2023 16:05	20945.6	8.2	None	Continuous
08/04/2023 17:05	20953.5	7.9	None	Continuous
08/04/2023 18:05	20961.5	8.0	None	Continuous
08/04/2023 19:05	20969.4	7.9	None	Continuous
08/04/2023 20:05	20977.4	8.0	None	Continuous
08/04/2023 21:05	20987.3	9.9	None	Continuous
08/04/2023 22:05	20995.4	8.1	None	Continuous
08/04/2023 23:05	21003.5	8.1	None	Continuous
08/05/2023 00:05	21011.5	8.0	None	Continuous
08/05/2023 01:05	21019.8	8.3	None	Continuous
08/05/2023 02:05	21027.9	8.1	None	Continuous
08/05/2023 03:05	21036.0	8.1	None	Continuous
08/05/2023 04:05	21044.1	8.1	None	Continuous
08/05/2023 05:05	21052.2	8.1	None	Continuous
08/05/2023 06:05	21060.3	8.1	None	Continuous
08/05/2023 07:05	21068.5	8.2	None	Continuous
08/05/2023 08:05	21076.5	8.0	None	Continuous
08/05/2023 09:05	21084.9	8.4	None	Continuous
08/05/2023 10:05	21093.3	8.4	None	Continuous
08/05/2023 11:05	21101.8	8.5	None	Continuous
08/05/2023 12:05	21110.4	8.6	None	Continuous
08/05/2023 13:05	21119.0	8.6	None	Continuous
08/05/2023 14:05	21127.6	8.6	None	Continuous
08/05/2023 15:05	21136.2	8.6	None	Continuous
08/05/2023 16:05	21144.9	8.7	None	Continuous
08/05/2023 17:05	21155.2	10.3	None	Continuous
08/05/2023 18:05	21163.9	8.7	None	Continuous
08/05/2023 19:05	21172.4	8.5	None	Continuous
08/05/2023 20:05	21181.0	8.6	None	Continuous
08/05/2023 21:05	21189.5	8.5	None	Continuous
08/05/2023 22:05	21198.0	8.5	None	Continuous
08/05/2023 23:05	21206.6	8.6	None	Continuous
08/06/2023 00:05	21216.2	9.6	None	Continuous
08/06/2023 01:05	21225.1	8.9	None	Continuous
08/06/2023 02:05	21233.8	8.7	None	Continuous
08/06/2023 03:05	21242.5	8.7	None	Continuous
08/06/2023 04:05	21251.3	8.8	None	Continuous
08/06/2023 05:05	21260.0	8.7	None	Continuous
08/06/2023 06:05	21268.7	8.7	None	Continuous
08/06/2023 07:05	21277.4	8.7	None	Continuous
08/06/2023 08:05	21286.1	8.7	None	Continuous
08/06/2023 09:05	21294.8	8.7	None	Continuous
08/06/2023 10:05	21303.5	8.7	None	Continuous
08/06/2023 11:05	21312.8	9.3	None	Continuous
08/06/2023 12:05	21321.2	8.4	None	Continuous
08/06/2023 13:05	21329.6	8.4	None	Continuous
08/06/2023 14:05	21338.6	9.0	None	Continuous
08/06/2023 15:05	21347.6	9.0	None	Continuous
08/06/2023 16:05	21356.3	8.7	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/06/2023 17:05	21365.0	8.7	None	Continuous
08/06/2023 18:05	21373.7	8.7	None	Continuous
08/06/2023 19:05	21383.7	10.0	None	Continuous
08/06/2023 20:05	21392.3	8.6	None	Continuous
08/06/2023 21:05	21401.0	8.7	None	Continuous
08/06/2023 22:05	21409.6	8.6	None	Continuous
08/06/2023 23:05	21418.4	8.8	None	Continuous
08/07/2023 00:05	21427.3	8.9	None	Continuous
08/07/2023 01:05	21436.2	8.9	None	Continuous
08/07/2023 02:05	21446.7	10.5	None	Continuous
08/07/2023 03:05	21455.7	9.0	None	Continuous
08/07/2023 04:05	21464.7	9.0	None	Continuous
08/07/2023 05:05	21473.7	9.0	None	Continuous
08/07/2023 06:05	21482.9	9.2	None	Continuous
08/07/2023 07:05	21491.9	9.0	None	Continuous
08/07/2023 08:05	21500.8	8.9	None	Continuous
08/07/2023 09:05	21509.7	8.9	None	Continuous
08/07/2023 10:05	21521.3	11.6	None	Continuous
08/07/2023 11:05	21531.9	10.6	None	Continuous
08/07/2023 12:05	21540.7	8.8	None	Continuous
08/07/2023 13:05	21549.6	8.9	None	Continuous
08/07/2023 14:05	21558.5	8.9	None	Continuous
08/07/2023 15:05	21567.3	8.8	None	Continuous
08/07/2023 16:05	21576.1	8.8	None	Continuous
08/07/2023 17:05	21584.8	8.7	None	Continuous
08/07/2023 18:05	21593.5	8.7	None	Continuous
08/07/2023 19:05	21602.2	8.7	None	Continuous
08/07/2023 20:05	21610.9	8.7	None	Continuous
08/07/2023 21:05	21619.6	8.7	None	Continuous
08/07/2023 22:05	21629.6	10.0	None	Continuous
08/07/2023 23:05	21638.5	8.9	None	Continuous
08/08/2023 00:05	21647.5	9.0	None	Continuous
08/08/2023 01:05	21656.6	9.1	None	Continuous
08/08/2023 02:05	21665.7	9.1	None	Continuous
08/08/2023 03:05	21674.7	9.0	None	Continuous
08/08/2023 04:05	21683.8	9.1	None	Continuous
08/08/2023 05:05	21692.9	9.1	None	Continuous
08/08/2023 06:05	21702.0	9.1	None	Continuous
08/08/2023 07:05	21711.1	9.1	None	Continuous
08/08/2023 08:05	21720.1	9.0	None	Continuous
08/08/2023 09:05	21729.1	9.0	None	Continuous
08/08/2023 10:05	21738.0	8.9	None	Continuous
08/08/2023 11:05	21746.9	8.9	None	Continuous
08/08/2023 12:05	21755.9	9.0	None	Continuous
08/08/2023 13:05	21765.7	9.8	None	Continuous
08/08/2023 14:05	21776.0	10.3	None	Continuous
08/08/2023 15:05	21784.8	8.8	None	Continuous
08/08/2023 16:05	21793.6	8.8	None	Continuous
08/08/2023 17:05	21802.4	8.8	None	Continuous
08/08/2023 18:05	21811.7	9.3	None	Continuous
08/08/2023 19:05	21820.5	8.8	None	Continuous
08/08/2023 20:05	21829.3	8.8	None	Continuous
08/08/2023 21:05	21838.3	9.0	None	Continuous
08/08/2023 22:05	21847.1	8.8	None	Continuous
08/08/2023 23:05	21856.0	8.9	None	Continuous
08/09/2023 00:05	21865.0	9.0	None	Continuous
08/09/2023 01:05	21874.5	9.5	None	Continuous
08/09/2023 02:05	21883.6	9.1	None	Continuous
08/09/2023 03:05	21892.8	9.2	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/09/2023 04:05	21902.1	9.3	None	Continuous
08/09/2023 05:05	21911.3	9.2	None	Continuous
08/09/2023 06:05	21920.6	9.3	None	Continuous
08/09/2023 07:05	21929.7	9.1	None	Continuous
08/09/2023 08:05	21939.6	9.9	None	Continuous
08/09/2023 09:05	21949.5	9.9	None	Continuous
08/09/2023 10:05	21958.5	9.0	None	Continuous
08/09/2023 11:05	21967.4	8.9	None	Continuous
08/09/2023 12:05	21976.3	8.9	None	Continuous
08/09/2023 13:05	21985.2	8.9	None	Continuous
08/09/2023 14:05	21997.6	12.4	None	Continuous
08/09/2023 15:05	22006.4	8.8	None	Continuous
08/09/2023 16:05	22015.3	8.9	None	Continuous
08/09/2023 17:05	22024.2	8.9	None	Continuous
08/09/2023 18:05	22033.1	8.9	None	Continuous
08/09/2023 19:05	22041.9	8.8	None	Continuous
08/09/2023 20:05	22050.8	8.9	None	Continuous
08/09/2023 21:05	22059.6	8.8	None	Continuous
08/09/2023 22:05	22069.0	9.4	None	Continuous
08/09/2023 23:05	22078.0	9.0	None	Continuous
08/10/2023 00:05	22088.4	10.4	None	Continuous
08/10/2023 01:05	22097.5	9.1	None	Continuous
08/10/2023 02:05	22106.7	9.2	None	Continuous
08/10/2023 03:05	22115.9	9.2	None	Continuous
08/10/2023 04:05	22125.1	9.2	None	Continuous
08/10/2023 05:05	22134.3	9.2	None	Continuous
08/10/2023 06:05	22144.2	9.9	None	Continuous
08/10/2023 07:05	22153.3	9.1	None	Continuous
08/10/2023 08:05	22162.4	9.1	None	Continuous
08/10/2023 09:05	22171.4	9.0	None	Continuous
08/10/2023 10:05	22181.8	10.4	None	Continuous
08/10/2023 11:05	22191.0	9.2	None	Continuous
08/10/2023 12:05	22199.9	8.9	None	Continuous
08/10/2023 13:05	22208.8	8.9	None	Continuous
08/10/2023 14:05	22217.8	9.0	None	Continuous
08/10/2023 15:05	22226.7	8.9	None	Continuous
08/10/2023 16:05	22235.7	9.0	None	Continuous
08/10/2023 17:05	22244.6	8.9	None	Continuous
08/10/2023 18:05	22253.5	8.9	None	Continuous
08/10/2023 19:05	22262.5	9.0	None	Continuous
08/10/2023 20:05	22271.3	8.8	None	Continuous
08/10/2023 21:05	22280.1	8.8	None	Continuous
08/10/2023 22:05	22289.0	8.9	None	Continuous
08/10/2023 23:05	22298.5	9.5	None	Continuous
08/11/2023 00:05	22308.5	10.0	None	Continuous
08/11/2023 01:05	22317.7	9.2	None	Continuous
08/11/2023 02:05	22326.8	9.1	None	Continuous
08/11/2023 03:05	22335.9	9.1	None	Continuous
08/11/2023 04:05	22345.0	9.1	None	Continuous
08/11/2023 05:05	22354.5	9.5	None	Continuous
08/11/2023 06:05	22364.8	10.3	None	Continuous
08/11/2023 07:05	22373.9	9.1	None	Continuous
08/11/2023 08:05	22382.8	8.9	None	Continuous
08/11/2023 09:05	22391.7	8.9	None	Continuous
08/11/2023 10:05	22400.6	8.9	None	Continuous
08/11/2023 11:05	22409.6	9.0	None	Continuous
08/11/2023 12:05	22418.4	8.8	None	Continuous
08/11/2023 13:05	22427.3	8.9	None	Continuous
08/11/2023 14:05	22436.3	9.0	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/11/2023 15:05	22445.2	8.9	None	Continuous
08/11/2023 16:05	22454.1	8.9	None	Continuous
08/11/2023 17:05	22463.1	9.0	None	Continuous
08/11/2023 18:05	22472.0	8.9	None	Continuous
08/11/2023 19:05	22480.9	8.9	None	Continuous
08/11/2023 20:05	22490.9	10.0	None	Continuous
08/11/2023 21:05	22499.8	8.9	None	Continuous
08/11/2023 22:05	22508.7	8.9	None	Continuous
08/11/2023 23:05	22517.7	9.0	None	Continuous
08/12/2023 00:05	22527.2	9.5	None	Continuous
08/12/2023 01:05	22539.1	11.9	None	Continuous
08/12/2023 02:05	22548.3	9.2	None	Continuous
08/12/2023 03:05	22557.5	9.2	None	Continuous
08/12/2023 04:05	22566.7	9.2	None	Continuous
08/12/2023 05:05	22575.9	9.2	None	Continuous
08/12/2023 06:05	22585.9	10.0	None	Continuous
08/12/2023 07:05	22595.1	9.2	None	Continuous
08/12/2023 08:05	22604.3	9.2	None	Continuous
08/12/2023 09:05	22614.5	10.2	None	Continuous
08/12/2023 10:05	22623.8	9.3	None	Continuous
08/12/2023 11:05	22632.8	9.0	None	Continuous
08/12/2023 12:05	22641.8	9.0	None	Continuous
08/12/2023 13:05	22652.6	10.8	None	Continuous
08/12/2023 14:05	22661.5	8.9	None	Continuous
08/12/2023 15:05	22672.2	10.7	None	Continuous
08/12/2023 16:05	22681.3	9.1	None	Continuous
08/12/2023 17:05	22690.4	9.1	None	Continuous
08/12/2023 18:05	22699.4	9.0	None	Continuous
08/12/2023 19:05	22708.5	9.1	None	Continuous
08/12/2023 20:05	22717.4	8.9	None	Continuous
08/12/2023 21:05	22727.2	9.8	None	Continuous
08/12/2023 22:05	22736.2	9.0	None	Continuous
08/12/2023 23:05	22745.1	8.9	None	Continuous
08/13/2023 00:05	22754.2	9.1	None	Continuous
08/13/2023 01:05	22763.3	9.1	None	Continuous
08/13/2023 02:05	22772.4	9.1	None	Continuous
08/13/2023 03:05	22781.5	9.1	None	Continuous
08/13/2023 04:05	22790.5	9.0	None	Continuous
08/13/2023 05:05	22800.3	9.8	None	Continuous
08/13/2023 06:05	22809.7	9.4	None	Continuous
08/13/2023 07:05	22818.9	9.2	None	Continuous
08/13/2023 08:05	22828.0	9.1	None	Continuous
08/13/2023 09:05	22838.1	10.1	None	Continuous
08/13/2023 10:05	22848.3	10.2	None	Continuous
08/13/2023 11:05	22857.7	9.4	None	Continuous
08/13/2023 12:05	22868.7	11.0	None	Continuous
08/13/2023 13:05	22877.9	9.2	None	Continuous
08/13/2023 14:05	22886.8	8.9	None	Continuous
08/13/2023 15:05	22895.8	9.0	None	Continuous
08/13/2023 16:05	22904.8	9.0	None	Continuous
08/13/2023 17:05	22913.8	9.0	None	Continuous
08/13/2023 18:05	22922.6	8.8	None	Continuous
08/13/2023 19:05	22931.5	8.9	None	Continuous
08/13/2023 20:05	22940.4	8.9	None	Continuous
08/13/2023 21:05	22949.4	9.0	None	Continuous
08/13/2023 22:05	22958.4	9.0	None	Continuous
08/13/2023 23:05	22967.4	9.0	None	Continuous
08/14/2023 00:05	22976.6	9.2	None	Continuous
08/14/2023 01:05	22985.9	9.3	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/14/2023 02:05	22995.1	9.2	None	Continuous
08/14/2023 03:05	23004.2	9.1	None	Continuous
08/14/2023 04:05	23015.9	11.7	None	Continuous
08/14/2023 05:05	23025.2	9.3	None	Continuous
08/14/2023 06:05	23034.5	9.3	None	Continuous
08/14/2023 07:05	23043.8	9.3	None	Continuous
08/14/2023 08:05	23054.7	10.9	None	Continuous
08/14/2023 09:05	23063.8	9.1	None	Continuous
08/14/2023 10:05	23072.7	8.9	None	Continuous
08/14/2023 11:05	23081.8	9.1	None	Continuous
08/14/2023 12:05	23091.9	10.1	None	Continuous
08/14/2023 13:05	23102.5	10.6	None	Continuous
08/14/2023 14:05	23111.6	9.1	None	Continuous
08/14/2023 15:05	23120.6	9.0	None	Continuous
08/14/2023 16:05	23131.0	10.4	None	Continuous
08/14/2023 17:05	23140.0	9.0	None	Continuous
08/14/2023 18:05	23149.0	9.0	None	Continuous
08/14/2023 19:05	23158.0	9.0	None	Continuous
08/14/2023 20:05	23166.9	8.9	None	Continuous
08/14/2023 21:05	23175.8	8.9	None	Continuous
08/14/2023 22:05	23184.7	8.9	None	Continuous
08/14/2023 23:05	23193.6	8.9	None	Continuous
08/15/2023 00:05	23203.6	10.0	None	Continuous
08/15/2023 01:05	23212.7	9.1	None	Continuous
08/15/2023 02:05	23221.9	9.2	None	Continuous
08/15/2023 03:05	23231.0	9.1	None	Continuous
08/15/2023 04:05	23240.8	9.8	None	Continuous
08/15/2023 05:05	23250.3	9.5	None	Continuous
08/15/2023 06:05	23259.5	9.2	None	Continuous
08/15/2023 07:05	23269.9	10.4	None	Continuous
08/15/2023 08:05	23279.0	9.1	None	Continuous
08/15/2023 09:05	23288.1	9.1	None	Continuous
08/15/2023 10:05	23297.2	9.1	None	Continuous
08/15/2023 11:05	23306.3	9.1	None	Continuous
08/15/2023 12:05	23315.3	9.0	None	Continuous
08/15/2023 13:05	23324.3	9.0	None	Continuous
08/15/2023 14:05	23333.4	9.1	None	Continuous
08/15/2023 15:05	23342.4	9.0	None	Continuous
08/15/2023 16:05	23351.5	9.1	None	Continuous
08/15/2023 17:05	23361.9	10.4	None	Continuous
08/15/2023 18:05	23371.1	9.2	None	Continuous
08/15/2023 19:05	23380.0	8.9	None	Continuous
08/15/2023 20:05	23388.9	8.9	None	Continuous
08/15/2023 21:05	23397.9	9.0	None	Continuous
08/15/2023 22:05	23411.4	13.5	None	Continuous
08/15/2023 23:05	23420.4	9.0	None	Continuous
08/16/2023 00:05	23441.4	21.0	None	Continuous
08/16/2023 01:05	23450.5	9.1	None	Continuous
08/16/2023 02:05	23459.8	9.3	None	Continuous
08/16/2023 03:05	23469.0	9.2	None	Continuous
08/16/2023 04:05	23478.2	9.2	None	Continuous
08/16/2023 05:05	23488.2	10.0	None	Continuous
08/16/2023 06:05	23497.5	9.3	None	Continuous
08/16/2023 07:05	23506.8	9.3	None	Continuous
08/16/2023 08:05	23516.0	9.2	None	Continuous
08/16/2023 09:05	23526.1	10.1	None	Continuous
08/16/2023 10:05	23535.2	9.1	None	Continuous
08/16/2023 11:05	23544.4	9.2	None	Continuous
08/16/2023 12:05	23553.6	9.2	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/16/2023 13:05	23562.7	9.1	None	Continuous
08/16/2023 14:05	23571.7	9.0	None	Continuous
08/16/2023 15:05	23580.8	9.1	None	Continuous
08/16/2023 16:05	23589.8	9.0	None	Continuous
08/16/2023 17:05	23598.8	9.0	None	Continuous
08/16/2023 18:05	23609.7	10.9	None	Continuous
08/16/2023 19:05	23619.2	9.5	None	Continuous
08/16/2023 20:05	23628.1	8.9	None	Continuous
08/16/2023 21:05	23637.1	9.0	None	Continuous
08/16/2023 22:05	23646.1	9.0	None	Continuous
08/16/2023 23:05	23655.1	9.0	None	Continuous
08/17/2023 00:05	23665.1	10.0	None	Continuous
08/17/2023 01:05	23674.4	9.3	None	Continuous
08/17/2023 02:05	23684.6	10.2	None	Continuous
08/17/2023 03:05	23693.8	9.2	None	Continuous
08/17/2023 04:05	23703.1	9.3	None	Continuous
08/17/2023 05:05	23712.3	9.2	None	Continuous
08/17/2023 06:05	23721.6	9.3	None	Continuous
08/17/2023 07:05	23731.6	10.0	None	Continuous
08/17/2023 08:05	23740.8	9.2	None	Continuous
08/17/2023 09:05	23750.0	9.2	None	Continuous
08/17/2023 10:05	23759.1	9.1	None	Continuous
08/17/2023 11:05	23768.2	9.1	None	Continuous
08/17/2023 12:05	23778.0	9.8	None	Continuous
08/17/2023 13:05	23787.1	9.1	None	Continuous
08/17/2023 14:05	23867.2	80.1	None	Continuous
08/17/2023 15:05	23876.2	9.0	None	Continuous
08/17/2023 16:05	23885.2	9.0	None	Continuous
08/17/2023 17:05	23894.2	9.0	None	Continuous
08/17/2023 18:05	23903.2	9.0	None	Continuous
08/17/2023 19:05	23912.1	8.9	None	Continuous
08/17/2023 20:05	23921.1	9.0	None	Continuous
08/17/2023 21:05	23930.1	9.0	None	Continuous
08/17/2023 22:05	23939.0	8.9	None	Continuous
08/17/2023 23:05	23948.1	9.1	None	Continuous
08/18/2023 00:05	23958.1	10.0	None	Continuous
08/18/2023 01:05	23967.5	9.4	None	Continuous
08/18/2023 02:05	23976.9	9.4	None	Continuous
08/18/2023 03:05	23986.1	9.2	None	Continuous
08/18/2023 04:05	23995.3	9.2	None	Continuous
08/18/2023 05:05	24004.5	9.2	None	Continuous
08/18/2023 06:05	24013.8	9.3	None	Continuous
08/18/2023 07:05	24023.4	9.6	None	Continuous
08/18/2023 08:05	24032.6	9.2	None	Continuous
08/18/2023 09:05	24041.7	9.1	None	Continuous
08/18/2023 10:05	24050.9	9.2	None	Continuous
08/18/2023 11:05	24062.0	11.1	None	Continuous
08/18/2023 12:05	24071.0	9.0	None	Continuous
08/18/2023 13:05	24080.0	9.0	None	Continuous
08/18/2023 14:05	24089.0	9.0	None	Continuous
08/18/2023 15:05	24098.0	9.0	None	Continuous
08/18/2023 16:05	24110.0	12.0	None	Continuous
08/18/2023 17:05	24119.2	9.2	None	Continuous
08/18/2023 18:05	24128.2	9.0	None	Continuous
08/18/2023 19:05	24137.2	9.0	None	Continuous
08/18/2023 20:05	24146.1	8.9	None	Continuous
08/18/2023 21:05	24155.0	8.9	None	Continuous
08/18/2023 22:05	24164.0	9.0	None	Continuous
08/18/2023 23:05	24173.1	9.1	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/19/2023 00:05	24182.4	9.3	None	Continuous
08/19/2023 01:05	24192.3	9.9	None	Continuous
08/19/2023 02:05	24201.6	9.3	None	Continuous
08/19/2023 03:05	24211.1	9.5	None	Continuous
08/19/2023 04:05	24220.3	9.2	None	Continuous
08/19/2023 05:05	24229.6	9.3	None	Continuous
08/19/2023 06:05	24238.9	9.3	None	Continuous
08/19/2023 07:05	24248.3	9.4	None	Continuous
08/19/2023 08:05	24257.6	9.3	None	Continuous
08/19/2023 09:05	24267.2	9.6	None	Continuous
08/19/2023 10:05	24276.3	9.1	None	Continuous
08/19/2023 11:05	24285.4	9.1	None	Continuous
08/19/2023 12:05	24294.4	9.0	None	Continuous
08/19/2023 13:05	24305.4	11.0	None	Continuous
08/19/2023 14:05	24318.5	13.1	None	Continuous
08/19/2023 15:05	24327.7	9.2	None	Continuous
08/19/2023 16:05	24336.7	9.0	None	Continuous
08/19/2023 17:05	24345.8	9.1	None	Continuous
08/19/2023 18:05	24354.9	9.1	None	Continuous
08/19/2023 19:05	24369.7	14.8	None	Continuous
08/19/2023 20:05	24378.8	9.1	None	Continuous
08/19/2023 21:05	24387.9	9.1	None	Continuous
08/19/2023 22:05	24396.9	9.0	None	Continuous
08/19/2023 23:05	24406.1	9.2	None	Continuous
08/20/2023 00:05	24415.3	9.2	None	Continuous
08/20/2023 01:05	24425.2	9.9	None	Continuous
08/20/2023 02:05	24434.5	9.3	None	Continuous
08/20/2023 03:05	24443.8	9.3	None	Continuous
08/20/2023 04:05	24456.9	13.1	None	Continuous
08/20/2023 05:05	24466.2	9.3	None	Continuous
08/20/2023 06:05	24475.5	9.3	None	Continuous
08/20/2023 07:05	24484.8	9.3	None	Continuous
08/20/2023 08:05	24494.1	9.3	None	Continuous
08/20/2023 09:05	24503.3	9.2	None	Continuous
08/20/2023 10:05	24512.5	9.2	None	Continuous
08/20/2023 11:05	24525.8	13.3	None	Continuous
08/20/2023 12:05	24535.0	9.2	None	Continuous
08/20/2023 13:05	24547.5	12.5	None	Continuous
08/20/2023 14:05	24556.6	9.1	None	Continuous
08/20/2023 15:05	24565.7	9.1	None	Continuous
08/20/2023 16:05	24574.8	9.1	None	Continuous
08/20/2023 17:05	24584.5	9.7	None	Continuous
08/20/2023 18:05	24593.7	9.2	None	Continuous
08/20/2023 19:05	24606.7	13.0	None	Continuous
08/20/2023 20:05	24618.9	12.2	None	Continuous
08/20/2023 21:05	24628.1	9.2	None	Continuous
08/20/2023 22:05	24640.1	12.0	None	Continuous
08/20/2023 23:05	24652.1	12.0	None	Continuous
08/21/2023 00:05	24661.4	9.3	None	Continuous
08/21/2023 01:05	24670.9	9.5	None	Continuous
08/21/2023 02:05	24683.1	12.2	None	Continuous
08/21/2023 03:05	24695.2	12.1	None	Continuous
08/21/2023 04:05	24704.6	9.4	None	Continuous
08/21/2023 05:05	24713.9	9.3	None	Continuous
08/21/2023 06:05	24723.4	9.5	None	Continuous
08/21/2023 07:05	24732.8	9.4	None	Continuous
08/21/2023 08:05	24742.1	9.3	None	Continuous
08/21/2023 09:05	24751.4	9.3	None	Continuous
08/21/2023 10:05	24760.6	9.2	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/21/2023 11:05	24774.2	13.6	None	Continuous
08/21/2023 12:05	24786.2	12.0	None	Continuous
08/21/2023 13:05	24795.5	9.3	None	Continuous
08/21/2023 14:05	24804.6	9.1	None	Continuous
08/21/2023 15:05	24813.8	9.2	None	Continuous
08/21/2023 16:05	24825.8	12.0	None	Continuous
08/21/2023 17:05	24834.9	9.1	None	Continuous
08/21/2023 18:05	24845.6	10.7	None	Continuous
08/21/2023 19:05	24856.3	10.7	None	Continuous
08/21/2023 20:05	24865.4	9.1	None	Continuous
08/21/2023 21:05	24874.5	9.1	None	Continuous
08/21/2023 22:05	24886.8	12.3	None	Continuous
08/21/2023 23:05	24896.0	9.2	None	Continuous
08/22/2023 00:05	24905.4	9.4	None	Continuous
08/22/2023 01:05	24917.9	12.5	None	Continuous
08/22/2023 02:05	24930.2	12.3	None	Continuous
08/22/2023 03:05	24939.6	9.4	None	Continuous
08/22/2023 04:05	24949.0	9.4	None	Continuous
08/22/2023 05:05	24962.0	13.0	None	Continuous
08/22/2023 06:05	24974.4	12.4	None	Continuous
08/22/2023 07:05	24983.8	9.4	None	Continuous
08/22/2023 08:05	24996.0	12.2	None	Continuous
08/22/2023 09:05	25008.2	12.2	None	Continuous
08/22/2023 10:05	25020.3	12.1	None	Continuous
08/22/2023 11:05	25029.5	9.2	None	Continuous
08/22/2023 12:05	25058.5	29.0	None	Continuous
08/22/2023 13:05	25067.7	9.2	None	Continuous
08/22/2023 14:05	25076.9	9.2	None	Continuous
08/22/2023 15:05	25086.2	9.3	None	Continuous
08/22/2023 16:05	25095.4	9.2	None	Continuous
08/22/2023 17:05	25107.5	12.1	None	Continuous
08/22/2023 18:05	25116.6	9.1	None	Continuous
08/22/2023 19:05	25125.8	9.2	None	Continuous
08/22/2023 20:05	25135.0	9.2	None	Continuous
08/22/2023 21:05	25144.1	9.1	None	Continuous
08/22/2023 22:05	25153.3	9.2	None	Continuous
08/22/2023 23:05	25162.5	9.2	None	Continuous
08/23/2023 00:05	25171.9	9.4	None	Continuous
08/23/2023 01:05	25181.4	9.5	None	Continuous
08/23/2023 02:05	25190.7	9.3	None	Continuous
08/23/2023 03:05	25200.1	9.4	None	Continuous
08/23/2023 04:05	25209.6	9.5	None	Continuous
08/23/2023 05:05	25221.9	12.3	None	Continuous
08/23/2023 06:05	25231.4	9.5	None	Continuous
08/23/2023 07:05	25240.8	9.4	None	Continuous
08/23/2023 08:05	25250.2	9.4	None	Continuous
08/23/2023 09:05	25259.7	9.5	None	Continuous
08/23/2023 10:05	25272.0	12.3	None	Continuous
08/23/2023 11:05	25281.3	9.3	None	Continuous
08/23/2023 12:05	25291.7	10.4	None	Continuous
08/23/2023 13:05	25303.8	12.1	None	Continuous
08/23/2023 14:05	25313.2	9.4	None	Continuous
08/23/2023 15:05	25322.6	9.4	None	Continuous
08/23/2023 16:05	25331.9	9.3	None	Continuous
08/23/2023 17:05	25341.1	9.2	None	Continuous
08/23/2023 18:05	25350.7	9.6	None	Continuous
08/23/2023 19:05	25365.4	14.7	None	Continuous
08/23/2023 20:05	25374.5	9.1	None	Continuous
08/23/2023 21:05	25383.8	9.3	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/23/2023 22:05	25392.9	9.1	None	Continuous
08/23/2023 23:05	25405.1	12.2	None	Continuous
08/24/2023 00:05	25414.4	9.3	None	Continuous
08/24/2023 01:05	25424.5	10.1	None	Continuous
08/24/2023 02:05	25433.9	9.4	None	Continuous
08/24/2023 03:05	25443.3	9.4	None	Continuous
08/24/2023 04:05	25456.7	13.4	None	Continuous
08/24/2023 05:05	25466.3	9.6	None	Continuous
08/24/2023 06:05	25478.5	12.2	None	Continuous
08/24/2023 07:05	25490.7	12.2	None	Continuous
08/24/2023 08:05	25500.0	9.3	None	Continuous
08/24/2023 09:05	25512.0	12.0	None	Continuous
08/24/2023 10:05	25521.3	9.3	None	Continuous
08/24/2023 11:05	25530.5	9.2	None	Continuous
08/24/2023 12:05	25539.8	9.3	None	Continuous
08/24/2023 13:05	25552.3	12.5	None	Continuous
08/24/2023 14:05	25564.5	12.2	None	Continuous
08/24/2023 15:05	25573.8	9.3	None	Continuous
08/24/2023 16:05	25583.5	9.7	None	Continuous
08/24/2023 17:05	25592.6	9.1	None	Continuous
08/24/2023 18:05	25601.9	9.3	None	Continuous
08/24/2023 19:05	25611.2	9.3	None	Continuous
08/24/2023 20:05	25620.3	9.1	None	Continuous
08/24/2023 21:05	25632.2	11.9	None	Continuous
08/24/2023 22:05	25641.4	9.2	None	Continuous
08/24/2023 23:05	25650.6	9.2	None	Continuous
08/25/2023 00:05	25660.0	9.4	None	Continuous
08/25/2023 01:05	25669.4	9.4	None	Continuous
08/25/2023 02:05	25678.8	9.4	None	Continuous
08/25/2023 03:05	25690.9	12.1	None	Continuous
08/25/2023 04:05	25700.3	9.4	None	Continuous
08/25/2023 05:05	25712.6	12.3	None	Continuous
08/25/2023 06:05	25722.1	9.5	None	Continuous
08/25/2023 07:05	25731.5	9.4	None	Continuous
08/25/2023 08:05	25740.8	9.3	None	Continuous
08/25/2023 09:05	25755.5	14.7	None	Continuous
08/25/2023 10:05	25771.7	16.2	None	Continuous
08/25/2023 11:05	25780.9	9.2	None	Continuous
08/25/2023 12:05	25790.0	9.1	None	Continuous
08/25/2023 13:05	25799.2	9.2	None	Continuous
08/25/2023 14:05	25812.3	13.1	None	Continuous
08/25/2023 15:05	25821.6	9.3	None	Continuous
08/25/2023 16:05	25830.7	9.1	None	Continuous
08/25/2023 17:05	25839.8	9.1	None	Continuous
08/25/2023 18:05	25848.9	9.1	None	Continuous
08/25/2023 19:05	25858.0	9.1	None	Continuous
08/25/2023 20:05	25872.2	14.2	None	Continuous
08/25/2023 21:05	25890.3	18.1	None	Continuous
08/25/2023 22:05	25899.6	9.3	None	Continuous
08/25/2023 23:05	25908.9	9.3	None	Continuous
08/26/2023 00:05	25918.2	9.3	None	Continuous
08/26/2023 01:05	25927.6	9.4	None	Continuous
08/26/2023 02:05	25937.0	9.4	None	Continuous
08/26/2023 03:05	25946.5	9.5	None	Continuous
08/26/2023 04:05	25956.2	9.7	None	Continuous
08/26/2023 05:05	25969.8	13.6	None	Continuous
08/26/2023 06:05	25979.2	9.4	None	Continuous
08/26/2023 07:05	25988.6	9.4	None	Continuous
08/26/2023 08:05	25997.9	9.3	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/26/2023 09:05	26007.3	9.4	None	Continuous
08/26/2023 10:05	26016.6	9.3	None	Continuous
08/26/2023 11:05	26048.3	31.7	None	Continuous
08/26/2023 12:05	26134.3	86.0	None	Continuous
08/26/2023 13:05	26168.0	33.7	None	Continuous
08/26/2023 14:05	26178.1	10.1	None	Continuous
08/26/2023 15:05	26187.2	9.1	None	Continuous
08/26/2023 16:05	26200.7	13.5	None	Continuous
08/26/2023 17:05	26209.9	9.2	None	Continuous
08/26/2023 18:05	26219.0	9.1	None	Continuous
08/26/2023 19:05	26231.9	12.9	None	Continuous
08/26/2023 20:05	26241.4	9.5	None	Continuous
08/26/2023 21:05	26250.5	9.1	None	Continuous
08/26/2023 22:05	26259.6	9.1	None	Continuous
08/26/2023 23:05	26268.8	9.2	None	Continuous
08/27/2023 00:05	26278.1	9.3	None	Continuous
08/27/2023 01:05	26290.1	12.0	None	Continuous
08/27/2023 02:05	26299.4	9.3	None	Continuous
08/27/2023 03:05	26308.6	9.2	None	Continuous
08/27/2023 04:05	26318.0	9.4	None	Continuous
08/27/2023 05:05	26327.5	9.5	None	Continuous
08/27/2023 06:05	26336.9	9.4	None	Continuous
08/27/2023 07:05	26346.4	9.5	None	Continuous
08/27/2023 08:05	26355.9	9.5	None	Continuous
08/27/2023 09:05	26368.1	12.2	None	Continuous
08/27/2023 10:05	26377.4	9.3	None	Continuous
08/27/2023 11:05	26386.6	9.2	None	Continuous
08/27/2023 12:05	26400.5	13.9	None	Continuous
08/27/2023 13:05	26409.8	9.3	None	Continuous
08/27/2023 14:05	26419.0	9.2	None	Continuous
08/27/2023 15:05	26428.2	9.2	None	Continuous
08/27/2023 16:05	26441.3	13.1	None	Continuous
08/27/2023 17:05	26450.6	9.3	None	Continuous
08/27/2023 18:05	26459.9	9.3	None	Continuous
08/27/2023 19:05	26469.2	9.3	None	Continuous
08/27/2023 20:05	26479.5	10.3	None	Continuous
08/27/2023 21:05	26488.6	9.1	None	Continuous
08/27/2023 22:05	26497.8	9.2	None	Continuous
08/27/2023 23:05	26507.0	9.2	None	Continuous
08/28/2023 00:05	26516.3	9.3	None	Continuous
08/28/2023 01:05	26525.6	9.3	None	Continuous
08/28/2023 02:05	26535.0	9.4	None	Continuous
08/28/2023 03:05	26544.3	9.3	None	Continuous
08/28/2023 04:05	26553.6	9.3	None	Continuous
08/28/2023 05:05	26563.0	9.4	None	Continuous
08/28/2023 06:05	26572.5	9.5	None	Continuous
08/28/2023 07:05	26581.9	9.4	None	Continuous
08/28/2023 08:05	26591.2	9.3	None	Continuous
08/28/2023 09:05	26614.4	23.2	None	Continuous
08/28/2023 10:05	26625.0	10.6	None	Continuous
08/28/2023 11:05	26634.3	9.3	None	Continuous
08/28/2023 12:05	26643.5	9.2	None	Continuous
08/28/2023 13:05	26652.8	9.3	None	Continuous
08/28/2023 14:05	26674.7	21.9	None	Continuous
08/28/2023 15:05	26684.0	9.3	None	Continuous
08/28/2023 16:05	26693.2	9.2	None	Continuous
08/28/2023 17:05	26706.2	13.0	None	Continuous
08/28/2023 18:05	26715.5	9.3	None	Continuous
08/28/2023 19:05	26724.6	9.1	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/28/2023 20:05	26733.8	9.2	None	Continuous
08/28/2023 21:05	26742.9	9.1	None	Continuous
08/28/2023 22:05	26752.4	9.5	None	Continuous
08/28/2023 23:05	26761.6	9.2	None	Continuous
08/29/2023 00:05	26773.9	12.3	None	Continuous
08/29/2023 01:05	26783.3	9.4	None	Continuous
08/29/2023 02:05	26792.8	9.5	None	Continuous
08/29/2023 03:05	26802.4	9.6	None	Continuous
08/29/2023 04:05	26816.7	14.3	None	Continuous
08/29/2023 05:05	26826.1	9.4	None	Continuous
08/29/2023 06:05	26835.6	9.5	None	Continuous
08/29/2023 07:05	26845.0	9.4	None	Continuous
08/29/2023 08:05	26854.3	9.3	None	Continuous
08/29/2023 09:05	26863.6	9.3	None	Continuous
08/29/2023 10:05	26872.9	9.3	None	Continuous
08/29/2023 11:05	26885.6	12.7	None	Continuous
08/29/2023 12:05	26894.8	9.2	None	Continuous
08/29/2023 13:05	26904.1	9.3	None	Continuous
08/29/2023 14:05	26913.5	9.4	None	Continuous
08/29/2023 15:05	26922.7	9.2	None	Continuous
08/29/2023 16:05	26932.2	9.5	None	Continuous
08/29/2023 17:05	26941.4	9.2	None	Continuous
08/29/2023 18:05	26950.8	9.4	None	Continuous
08/29/2023 19:05	26960.0	9.2	None	Continuous
08/29/2023 20:05	26969.1	9.1	None	Continuous
08/29/2023 21:05	26978.3	9.2	None	Continuous
08/29/2023 22:05	26987.7	9.4	None	Continuous
08/29/2023 23:05	26997.1	9.4	None	Continuous
08/30/2023 00:05	27006.6	9.5	None	Continuous
08/30/2023 01:05	27016.1	9.5	None	Continuous
08/30/2023 02:05	27025.7	9.6	None	Continuous
08/30/2023 03:05	27038.2	12.5	None	Continuous
08/30/2023 04:05	27047.7	9.5	None	Continuous
08/30/2023 05:05	27073.3	25.6	None	Continuous
08/30/2023 06:05	27082.7	9.4	None	Continuous
08/30/2023 07:05	27092.1	9.4	None	Continuous
08/30/2023 08:05	27101.6	9.5	None	Continuous
08/30/2023 09:05	27111.0	9.4	None	Continuous
08/30/2023 10:05	27120.4	9.4	None	Continuous
08/30/2023 11:05	27129.8	9.4	None	Continuous
08/30/2023 12:05	27139.3	9.5	None	Continuous
08/30/2023 13:05	27176.3	37.0	None	Continuous
08/30/2023 14:05	27219.7	43.4	None	Continuous
08/30/2023 15:05	27229.0	9.3	None	Continuous
08/30/2023 16:05	27238.3	9.3	None	Continuous
08/30/2023 17:05	27247.7	9.4	None	Continuous
08/30/2023 18:05	27256.9	9.2	None	Continuous
08/30/2023 19:05	27266.2	9.3	None	Continuous
08/30/2023 20:05	27275.4	9.2	None	Continuous
08/30/2023 21:05	27284.5	9.1	None	Continuous
08/30/2023 22:05	27296.6	12.1	None	Continuous
08/30/2023 23:05	27308.7	12.1	None	Continuous
08/31/2023 00:05	27318.0	9.3	None	Continuous
08/31/2023 01:05	27327.3	9.3	None	Continuous
08/31/2023 02:05	27336.7	9.4	None	Continuous
08/31/2023 03:05	27346.0	9.3	None	Continuous
08/31/2023 04:05	27355.6	9.6	None	Continuous
08/31/2023 05:05	27371.0	15.4	None	Continuous
08/31/2023 06:05	27380.6	9.6	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
08/31/2023 07:05	27390.1	9.5	None	Continuous
08/31/2023 08:05	27399.6	9.5	None	Continuous
08/31/2023 09:05	27409.1	9.5	None	Continuous
08/31/2023 10:05	27421.8	12.7	None	Continuous
08/31/2023 11:05	27491.4	69.6	None	Continuous
08/31/2023 12:05	27502.6	11.2	None	Continuous
08/31/2023 13:05	27512.0	9.4	None	Continuous
08/31/2023 14:05	27521.5	9.5	None	Continuous
08/31/2023 15:05	27530.9	9.4	None	Continuous
08/31/2023 16:05	27540.5	9.6	None	Continuous
08/31/2023 17:05	27571.1	30.6	None	Continuous
08/31/2023 18:05	27612.3	41.2	None	Continuous
08/31/2023 19:05	27628.1	15.8	None	Continuous
08/31/2023 20:05	27637.4	9.3	None	Continuous
08/31/2023 21:05	27646.8	9.4	None	Continuous
08/31/2023 22:05	27656.2	9.4	None	Continuous
08/31/2023 23:05	27668.2	12.0	None	Continuous
09/01/2023 00:05	27677.6	9.4	None	Continuous
09/01/2023 01:05	27687.1	9.5	None	Continuous
09/01/2023 02:05	27696.5	9.4	None	Continuous
09/01/2023 03:05	27706.2	9.7	None	Continuous
09/01/2023 04:05	27715.7	9.5	None	Continuous
09/01/2023 05:05	27725.3	9.6	None	Continuous
09/01/2023 06:05	27734.9	9.6	None	Continuous
09/01/2023 07:05	27744.5	9.6	None	Continuous
09/01/2023 08:05	27757.0	12.5	None	Continuous
09/01/2023 09:05	27769.3	12.3	None	Continuous
09/01/2023 10:05	27778.8	9.5	None	Continuous
09/01/2023 11:05	27788.3	9.5	None	Continuous
09/01/2023 12:05	27797.7	9.4	None	Continuous
09/01/2023 13:05	27807.1	9.4	None	Continuous
09/01/2023 14:05	27816.5	9.4	None	Continuous
09/01/2023 15:05	27830.7	14.2	None	Continuous
09/01/2023 16:05	27840.1	9.4	None	Continuous
09/01/2023 17:05	27849.4	9.3	None	Continuous
09/01/2023 18:05	27858.7	9.3	None	Continuous
09/01/2023 19:05	27868.0	9.3	None	Continuous
09/01/2023 20:05	27881.4	13.4	None	Continuous
09/01/2023 21:05	27890.9	9.5	None	Continuous
09/01/2023 22:05	27900.2	9.3	None	Continuous
09/01/2023 23:05	27909.6	9.4	None	Continuous
09/02/2023 00:05	27919.0	9.4	None	Continuous
09/02/2023 01:05	27928.4	9.4	None	Continuous
09/02/2023 02:05	27937.8	9.4	None	Continuous
09/02/2023 03:05	27952.6	14.8	None	Continuous
09/02/2023 04:05	27962.1	9.5	None	Continuous
09/02/2023 05:05	27971.7	9.6	None	Continuous
09/02/2023 06:05	27981.3	9.6	None	Continuous
09/02/2023 07:05	27990.9	9.6	None	Continuous
09/02/2023 08:05	28000.5	9.6	None	Continuous
09/02/2023 09:05	28010.0	9.5	None	Continuous
09/02/2023 10:05	28022.9	12.9	None	Continuous
09/02/2023 11:05	28032.4	9.5	None	Continuous
09/02/2023 12:05	28092.5	60.1	None	Continuous
09/02/2023 13:05	28101.9	9.4	None	Continuous
09/02/2023 14:05	28113.6	11.7	None	Continuous
09/02/2023 15:05	28127.0	13.4	None	Continuous
09/02/2023 16:05	28136.5	9.5	None	Continuous
09/02/2023 17:05	28145.9	9.4	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/02/2023 18:05	28155.2	9.3	None	Continuous
09/02/2023 19:05	28165.4	10.2	None	Continuous
09/02/2023 20:05	28174.8	9.4	None	Continuous
09/02/2023 21:05	28184.2	9.4	None	Continuous
09/02/2023 22:05	28193.6	9.4	None	Continuous
09/02/2023 23:05	28203.3	9.7	None	Continuous
09/03/2023 00:05	28212.9	9.6	None	Continuous
09/03/2023 01:05	28222.5	9.6	None	Continuous
09/03/2023 02:05	28232.2	9.7	None	Continuous
09/03/2023 03:05	28241.8	9.6	None	Continuous
09/03/2023 04:05	28254.5	12.7	None	Continuous
09/03/2023 05:05	28267.8	13.3	None	Continuous
09/03/2023 06:05	28277.4	9.6	None	Continuous
09/03/2023 07:05	28287.1	9.7	None	Continuous
09/03/2023 08:05	28296.7	9.6	None	Continuous
09/03/2023 09:05	28306.3	9.6	None	Continuous
09/03/2023 10:05	28319.3	13.0	None	Continuous
09/03/2023 11:05	28328.9	9.6	None	Continuous
09/03/2023 12:05	28342.3	13.4	None	Continuous
09/03/2023 13:05	28351.7	9.4	None	Continuous
09/03/2023 14:05	28361.2	9.5	None	Continuous
09/03/2023 15:05	28370.7	9.5	None	Continuous
09/03/2023 16:05	28380.1	9.4	None	Continuous
09/03/2023 17:05	28392.4	12.3	None	Continuous
09/03/2023 18:05	28401.7	9.3	None	Continuous
09/03/2023 19:05	28411.2	9.5	None	Continuous
09/03/2023 20:05	28424.4	13.2	None	Continuous
09/03/2023 21:05	28433.7	9.3	None	Continuous
09/03/2023 22:05	28443.1	9.4	None	Continuous
09/03/2023 23:05	28452.5	9.4	None	Continuous
09/04/2023 00:05	28462.1	9.6	None	Continuous
09/04/2023 01:05	28474.7	12.6	None	Continuous
09/04/2023 02:05	28484.4	9.7	None	Continuous
09/04/2023 03:05	28494.5	10.1	None	Continuous
09/04/2023 04:05	28504.1	9.6	None	Continuous
09/04/2023 05:05	28513.8	9.7	None	Continuous
09/04/2023 06:05	28523.5	9.7	None	Continuous
09/04/2023 07:05	28533.3	9.8	None	Continuous
09/04/2023 08:05	28543.2	9.9	None	Continuous
09/04/2023 09:05	28556.6	13.4	None	Continuous
09/04/2023 10:05	28566.1	9.5	None	Continuous
09/04/2023 11:05	28575.7	9.6	None	Continuous
09/04/2023 12:05	28585.1	9.4	None	Continuous
09/04/2023 13:05	28597.2	12.1	None	Continuous
09/04/2023 14:05	28606.7	9.5	None	Continuous
09/04/2023 15:05	28619.2	12.5	None	Continuous
09/04/2023 16:05	28628.7	9.5	None	Continuous
09/04/2023 17:05	28638.1	9.4	None	Continuous
09/04/2023 18:05	28648.1	10.0	None	Continuous
09/04/2023 19:05	28657.6	9.5	None	Continuous
09/04/2023 20:05	28667.2	9.6	None	Continuous
09/04/2023 21:05	28676.7	9.5	None	Continuous
09/04/2023 22:05	28686.2	9.5	None	Continuous
09/04/2023 23:05	28705.5	19.3	None	Continuous
09/05/2023 00:05	28715.1	9.6	None	Continuous
09/05/2023 01:05	28724.8	9.7	None	Continuous
09/05/2023 02:05	28734.5	9.7	None	Continuous
09/05/2023 03:05	28745.1	10.6	None	Continuous
09/05/2023 04:05	28754.8	9.7	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/05/2023 05:05	28768.4	13.6	None	Continuous
09/05/2023 06:05	28785.3	16.9	None	Continuous
09/05/2023 07:05	28795.0	9.7	None	Continuous
09/05/2023 08:05	28804.8	9.8	None	Continuous
09/05/2023 09:05	28814.3	9.5	None	Continuous
09/05/2023 10:05	28823.8	9.5	None	Continuous
09/05/2023 11:05	28833.2	9.4	None	Continuous
09/05/2023 12:05	28842.6	9.4	None	Continuous
09/05/2023 13:05	28852.1	9.5	None	Continuous
09/05/2023 14:05	28862.6	10.5	None	Continuous
09/05/2023 15:05	28872.1	9.5	None	Continuous
09/05/2023 16:05	28881.9	9.8	None	Continuous
09/05/2023 17:05	28891.2	9.3	None	Continuous
09/05/2023 18:05	28900.6	9.4	None	Continuous
09/05/2023 19:05	28909.8	9.2	None	Continuous
09/05/2023 20:05	28919.2	9.4	None	Continuous
09/05/2023 21:05	28932.6	13.4	None	Continuous
09/05/2023 22:05	28942.3	9.7	None	Continuous
09/05/2023 23:05	28952.8	10.5	None	Continuous
09/06/2023 00:05	28962.4	9.6	None	Continuous
09/06/2023 01:05	28972.2	9.8	None	Continuous
09/06/2023 02:05	28981.9	9.7	None	Continuous
09/06/2023 03:05	28992.8	10.9	None	Continuous
09/06/2023 04:05	29002.6	9.8	None	Continuous
09/06/2023 05:05	29012.5	9.9	None	Continuous
09/06/2023 06:05	29022.4	9.9	None	Continuous
09/06/2023 07:05	29032.0	9.6	None	Continuous
09/06/2023 08:05	29041.6	9.6	None	Continuous
09/06/2023 09:05	29051.1	9.5	None	Continuous
09/06/2023 10:05	29060.6	9.5	None	Continuous
09/06/2023 11:05	29070.2	9.6	None	Continuous
09/06/2023 12:05	29082.9	12.7	None	Continuous
09/06/2023 13:05	29092.4	9.5	None	Continuous
09/06/2023 14:05	29102.0	9.6	None	Continuous
09/06/2023 15:05	29111.5	9.5	None	Continuous
09/06/2023 16:05	29121.1	9.6	None	Continuous
09/06/2023 17:05	29130.7	9.6	None	Continuous
09/06/2023 18:05	29140.2	9.5	None	Continuous
09/06/2023 19:05	29149.7	9.5	None	Continuous
09/06/2023 20:05	29162.0	12.3	None	Continuous
09/06/2023 21:05	29171.6	9.6	None	Continuous
09/06/2023 22:05	29181.2	9.6	None	Continuous
09/06/2023 23:05	29190.9	9.7	None	Continuous
09/07/2023 00:05	29200.8	9.9	None	Continuous
09/07/2023 01:05	29210.7	9.9	None	Continuous
09/07/2023 02:05	29221.3	10.6	None	Continuous
09/07/2023 03:05	29231.0	9.7	None	Continuous
09/07/2023 04:05	29240.7	9.7	None	Continuous
09/07/2023 05:05	29250.4	9.7	None	Continuous
09/07/2023 06:05	29264.0	13.6	None	Continuous
09/07/2023 07:05	29273.8	9.8	None	Continuous
09/07/2023 08:05	29283.5	9.7	None	Continuous
09/07/2023 09:05	29293.2	9.7	None	Continuous
09/07/2023 10:05	29302.9	9.7	None	Continuous
09/07/2023 11:05	29312.5	9.6	None	Continuous
09/07/2023 12:05	29322.2	9.7	None	Continuous
09/07/2023 13:05	29331.8	9.6	None	Continuous
09/07/2023 14:05	29341.5	9.7	None	Continuous
09/07/2023 15:05	29352.5	11.0	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/07/2023 16:05	29362.2	9.7	None	Continuous
09/07/2023 17:05	29371.9	9.7	None	Continuous
09/07/2023 18:05	29381.5	9.6	None	Continuous
09/07/2023 19:05	29390.9	9.4	None	Continuous
09/07/2023 20:05	29400.4	9.5	None	Continuous
09/07/2023 21:05	29409.7	9.3	None	Continuous
09/07/2023 22:05	29419.1	9.4	None	Continuous
09/07/2023 23:05	29432.4	13.3	None	Continuous
09/08/2023 00:05	29441.8	9.4	None	Continuous
09/08/2023 01:05	29451.8	10.0	None	Continuous
09/08/2023 02:05	29461.4	9.6	None	Continuous
09/08/2023 03:05	29477.4	16.0	None	Continuous
09/08/2023 04:05	29487.4	10.0	None	Continuous
09/08/2023 05:05	29497.4	10.0	None	Continuous
09/08/2023 06:05	29507.3	9.9	None	Continuous
09/08/2023 07:05	29517.3	10.0	None	Continuous
09/08/2023 08:05	29527.0	9.7	None	Continuous
09/08/2023 09:05	29539.8	12.8	None	Continuous
09/08/2023 10:05	29549.6	9.8	None	Continuous
09/08/2023 11:05	29559.7	10.1	None	Continuous
09/08/2023 12:05	29576.9	17.2	None	Continuous
09/08/2023 13:05	29586.6	9.7	None	Continuous
09/08/2023 14:05	29596.7	10.1	None	Continuous
09/08/2023 15:05	29606.4	9.7	None	Continuous
09/08/2023 16:05	29616.1	9.7	None	Continuous
09/08/2023 17:05	29625.7	9.6	None	Continuous
09/08/2023 18:05	29635.2	9.5	None	Continuous
09/08/2023 19:05	29644.7	9.5	None	Continuous
09/08/2023 20:05	29654.2	9.5	None	Continuous
09/08/2023 21:05	29663.8	9.6	None	Continuous
09/08/2023 22:05	29676.9	13.1	None	Continuous
09/08/2023 23:05	29686.3	9.4	None	Continuous
09/09/2023 00:05	29695.9	9.6	None	Continuous
09/09/2023 01:05	29705.4	9.5	None	Continuous
09/09/2023 02:05	29715.1	9.7	None	Continuous
09/09/2023 03:05	29725.6	10.5	None	Continuous
09/09/2023 04:05	29735.4	9.8	None	Continuous
09/09/2023 05:05	29745.1	9.7	None	Continuous
09/09/2023 06:05	29758.4	13.3	None	Continuous
09/09/2023 07:05	29768.1	9.7	None	Continuous
09/09/2023 08:05	29777.9	9.8	None	Continuous
09/09/2023 09:05	29787.5	9.6	None	Continuous
09/09/2023 10:05	29797.1	9.6	None	Continuous
09/09/2023 11:05	29807.9	10.8	None	Continuous
09/09/2023 12:05	29817.4	9.5	None	Continuous
09/09/2023 13:05	29827.0	9.6	None	Continuous
09/09/2023 14:05	29837.8	10.8	None	Continuous
09/09/2023 15:05	29847.6	9.8	None	Continuous
09/09/2023 16:05	29857.3	9.7	None	Continuous
09/09/2023 17:05	29867.1	9.8	None	Continuous
09/09/2023 18:05	29876.7	9.6	None	Continuous
09/09/2023 19:05	29886.3	9.6	None	Continuous
09/09/2023 20:05	29895.9	9.6	None	Continuous
09/09/2023 21:05	29910.7	14.8	None	Continuous
09/09/2023 22:05	29920.1	9.4	None	Continuous
09/09/2023 23:05	29929.7	9.6	None	Continuous
09/10/2023 00:05	29942.0	12.3	None	Continuous
09/10/2023 01:05	29953.8	11.8	None	Continuous
09/10/2023 02:05	29966.8	13.0	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/10/2023 03:05	29976.5	9.7	None	Continuous
09/10/2023 04:05	29986.2	9.7	None	Continuous
09/10/2023 05:05	29995.8	9.6	None	Continuous
09/10/2023 06:05	30005.6	9.8	None	Continuous
09/10/2023 07:05	30016.0	10.4	None	Continuous
09/10/2023 08:05	30026.0	10.0	None	Continuous
09/10/2023 09:05	30035.6	9.6	None	Continuous
09/10/2023 10:05	30048.1	12.5	None	Continuous
09/10/2023 11:05	30057.6	9.5	None	Continuous
09/10/2023 12:05	30067.0	9.4	None	Continuous
09/10/2023 13:05	30076.5	9.5	None	Continuous
09/10/2023 14:05	30086.0	9.5	None	Continuous
09/10/2023 15:05	30095.5	9.5	None	Continuous
09/10/2023 16:05	30104.9	9.4	None	Continuous
09/10/2023 17:05	30114.4	9.5	None	Continuous
09/10/2023 18:05	30123.8	9.4	None	Continuous
09/10/2023 19:05	30133.3	9.5	None	Continuous
09/10/2023 20:05	30146.7	13.4	None	Continuous
09/10/2023 21:05	30156.1	9.4	None	Continuous
09/10/2023 22:05	30165.7	9.6	None	Continuous
09/10/2023 23:05	30175.2	9.5	None	Continuous
09/11/2023 00:05	30186.3	11.1	None	Continuous
09/11/2023 01:05	30196.1	9.8	None	Continuous
09/11/2023 02:05	30205.9	9.8	None	Continuous
09/11/2023 03:05	30215.6	9.7	None	Continuous
09/11/2023 04:05	30225.3	9.7	None	Continuous
09/11/2023 05:05	30235.1	9.8	None	Continuous
09/11/2023 06:05	30244.9	9.8	None	Continuous
09/11/2023 07:05	30254.5	9.6	None	Continuous
09/11/2023 08:05	30264.2	9.7	None	Continuous
09/11/2023 09:05	30274.6	10.4	None	Continuous
09/11/2023 10:05	30284.3	9.7	None	Continuous
09/11/2023 11:05	30293.9	9.6	None	Continuous
09/11/2023 12:05	30303.7	9.8	None	Continuous
09/11/2023 13:05	30313.2	9.5	None	Continuous
09/11/2023 14:05	30322.9	9.7	None	Continuous
09/11/2023 15:05	30332.7	9.8	None	Continuous
09/11/2023 16:05	30342.6	9.9	None	Continuous
09/11/2023 17:05	30352.1	9.5	None	Continuous
09/11/2023 18:05	30361.6	9.5	None	Continuous
09/11/2023 19:05	30374.1	12.5	None	Continuous
09/11/2023 20:05	30383.6	9.5	None	Continuous
09/11/2023 21:05	30393.0	9.4	None	Continuous
09/11/2023 22:05	30402.5	9.5	None	Continuous
09/11/2023 23:05	30414.7	12.2	None	Continuous
09/12/2023 00:05	30424.3	9.6	None	Continuous
09/12/2023 01:05	30434.1*	9.8*	None*	Continuous*
09/12/2023 02:05	30443.9	9.8*	None	Continuous
09/12/2023 03:05	30453.8	9.9	None	Continuous
09/12/2023 04:05	30463.5	9.7	None	Continuous
09/12/2023 05:05	30479.8	16.3	None	Continuous
09/12/2023 06:05	30489.6	9.8	None	Continuous
09/12/2023 07:05	30499.2	9.6	None	Continuous
09/12/2023 08:05	30508.8	9.6	None	Continuous
09/12/2023 09:05	30518.4	9.6	None	Continuous
09/12/2023 10:05	30528.0	9.6	None	Continuous
09/12/2023 11:05	30543.7	15.7	None	Continuous
09/12/2023 12:05	30555.2	11.5	None	Continuous
09/12/2023 13:05	30564.8	9.6	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/12/2023 14:05	30575.7	10.9	None	Continuous
09/12/2023 15:05	30585.6	9.9	None	Continuous
09/12/2023 16:05	30595.2	9.6	None	Continuous
09/12/2023 17:05	30604.7	9.5	None	Continuous
09/12/2023 18:05	30614.3	9.6	None	Continuous
09/12/2023 19:05	30623.7	9.4	None	Continuous
09/12/2023 20:05	30633.2	9.5	None	Continuous
09/12/2023 21:05	30642.6	9.4	None	Continuous
09/12/2023 22:05	30652.6	10.0	None	Continuous
09/12/2023 23:05	30669.8	17.2	None	Continuous
09/13/2023 00:05	30685.3	15.5	None	Continuous
09/13/2023 01:05	30694.9	9.6	None	Continuous
09/13/2023 02:05	30704.6	9.7	None	Continuous
09/13/2023 03:05	30714.2	9.6	None	Continuous
09/13/2023 04:05	30723.9	9.7	None	Continuous
09/13/2023 05:05	30733.6	9.7	None	Continuous
09/13/2023 06:05	30743.3	9.7	None	Continuous
09/13/2023 07:05	30753.8	10.5	None	Continuous
09/13/2023 08:05	30769.2	15.4	None	Continuous
09/13/2023 09:05	30778.9	9.7	None	Continuous
09/13/2023 10:05	30788.5	9.6	None	Continuous
09/13/2023 11:05	30798.0	9.5	None	Continuous
09/13/2023 12:05	30807.6	9.6	None	Continuous
09/13/2023 13:05	30817.3	9.7	None	Continuous
09/13/2023 14:05	30829.7	12.4	None	Continuous
09/13/2023 15:05	30839.3	9.6	None	Continuous
09/13/2023 16:05	30849.1	9.8	None	Continuous
09/13/2023 17:05	30858.5	9.4	None	Continuous
09/13/2023 18:05	30870.5	12.0	None	Continuous
09/13/2023 19:05	30880.1	9.6	None	Continuous
09/13/2023 20:05	30891.0	10.9	None	Continuous
09/13/2023 21:05	30905.4	14.4	None	Continuous
09/13/2023 22:05	30915.1	9.7	None	Continuous
09/13/2023 23:05	30924.6	9.5	None	Continuous
09/14/2023 00:05	30934.2	9.6	None	Continuous
09/14/2023 01:05	30943.9	9.7	None	Continuous
09/14/2023 02:05	30953.8	9.9	None	Continuous
09/14/2023 03:05	30963.5	9.7	None	Continuous
09/14/2023 04:05	30973.4	9.9	None	Continuous
09/14/2023 05:05	30983.3	9.9	None	Continuous
09/14/2023 06:05	30993.0	9.7	None	Continuous
09/14/2023 07:05	31006.7	13.7	None	Continuous
09/14/2023 08:05	31016.8	10.1	None	Continuous
09/14/2023 09:05	31026.5	9.7	None	Continuous
09/14/2023 10:05	31036.6	10.1	None	Continuous
09/14/2023 11:05	31046.2	9.6	None	Continuous
09/14/2023 12:05	31056.4	10.2	None	Continuous
09/14/2023 13:05	31066.0	9.6	None	Continuous
09/14/2023 14:05	31075.7	9.7	None	Continuous
09/14/2023 15:05	31085.4	9.7	None	Continuous
09/14/2023 16:05	31095.7	10.3	None	Continuous
09/14/2023 17:05	31105.4	9.7	None	Continuous
09/14/2023 18:05	31114.9	9.5	None	Continuous
09/14/2023 19:05	31124.4	9.5	None	Continuous
09/14/2023 20:05	31141.8	17.4	None	Continuous
09/14/2023 21:05	31154.3	12.5	None	Continuous
09/14/2023 22:05	31163.9	9.6	None	Continuous
09/14/2023 23:05	31178.1	14.2	None	Continuous
09/15/2023 00:05	31198.2	20.1	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/15/2023 01:05	31207.9	9.7	None	Continuous
09/15/2023 02:05	31217.7	9.8	None	Continuous
09/15/2023 03:05	31227.6	9.9	None	Continuous
09/15/2023 04:05	31237.3	9.7	None	Continuous
09/15/2023 05:05	31247.1	9.8	None	Continuous
09/15/2023 06:05	31256.8	9.7	None	Continuous
09/15/2023 07:05	31271.1	14.3	None	Continuous
09/15/2023 08:05	31280.6	9.5	None	Continuous
09/15/2023 09:05	31290.4	9.8	None	Continuous
09/15/2023 10:05	31304.6	14.2	None	Continuous
09/15/2023 11:05	31314.3	9.7	None	Continuous
09/15/2023 12:05	31327.9	13.6	None	Continuous
09/15/2023 13:05	31337.8	9.9	None	Continuous
09/15/2023 14:05	31347.4	9.6	None	Continuous
09/15/2023 15:05	31360.4	13.0	None	Continuous
09/15/2023 16:05	31369.9	9.5	None	Continuous
09/15/2023 17:05	31379.5	9.6	None	Continuous
09/15/2023 18:05	31389.1	9.6	None	Continuous
09/15/2023 19:05	31401.4	12.3	None	Continuous
09/15/2023 20:05	31410.8	9.4	None	Continuous
09/15/2023 21:05	31420.3	9.5	None	Continuous
09/15/2023 22:05	31429.8	9.5	None	Continuous
09/15/2023 23:05	31439.4	9.6	None	Continuous
09/16/2023 00:05	31449.1	9.7	None	Continuous
09/16/2023 01:05	31459.0	9.9	None	Continuous
09/16/2023 02:05	31468.9	9.9	None	Continuous
09/16/2023 03:05	31478.6	9.7	None	Continuous
09/16/2023 04:05	31492.4	13.8	None	Continuous
09/16/2023 05:05	31502.5	10.1	None	Continuous
09/16/2023 06:05	31512.5	10.0	None	Continuous
09/16/2023 07:05	31522.3	9.8	None	Continuous
09/16/2023 08:05	31532.2	9.9	None	Continuous
09/16/2023 09:05	31542.0	9.8	None	Continuous
09/16/2023 10:05	31551.9	9.9	None	Continuous
09/16/2023 11:05	31561.6	9.7	None	Continuous
09/16/2023 12:05	31571.3	9.7	None	Continuous
09/16/2023 13:05	31584.8	13.5	None	Continuous
09/16/2023 14:05	31594.3	9.5	None	Continuous
09/16/2023 15:05	31603.9	9.6	None	Continuous
09/16/2023 16:05	31613.7*	9.8*	None*	Continuous*
09/16/2023 17:05	31623.5	9.8*	None	Continuous
09/16/2023 18:05	31633.7	10.2	None	Continuous
09/16/2023 19:05	31644.1	10.4	None	Continuous
09/16/2023 20:05	31654.1	10.0	None	Continuous
09/16/2023 21:05	31663.6	9.5	None	Continuous
09/16/2023 22:05	31673.5	9.9	None	Continuous
09/16/2023 23:05	31684.0	10.5	None	Continuous
09/17/2023 00:05	31693.7	9.7	None	Continuous
09/17/2023 01:05	31703.5	9.8	None	Continuous
09/17/2023 02:05	31713.4	9.9	None	Continuous
09/17/2023 03:05	31723.2	9.8	None	Continuous
09/17/2023 04:05	31733.0	9.8	None	Continuous
09/17/2023 05:05	31742.9	9.9	None	Continuous
09/17/2023 06:05	31752.8	9.9	None	Continuous
09/17/2023 07:05	31767.3	14.5	None	Continuous
09/17/2023 08:05	31780.0	12.7	None	Continuous
09/17/2023 09:05	31789.9	9.9	None	Continuous
09/17/2023 10:05	31803.4	13.5	None	Continuous
09/17/2023 11:05	31813.0	9.6	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/17/2023 12:05	31822.7	9.7	None	Continuous
09/17/2023 13:05	31832.3	9.6	None	Continuous
09/17/2023 14:05	31841.8	9.5	None	Continuous
09/17/2023 15:05	31851.4	9.6	None	Continuous
09/17/2023 16:05	31861.0	9.6	None	Continuous
09/17/2023 17:05	31870.7	9.7	None	Continuous
09/17/2023 18:05	31880.3	9.6	None	Continuous
09/17/2023 19:05	31889.9	9.6	None	Continuous
09/17/2023 20:05	31899.6	9.7	None	Continuous
09/17/2023 21:05	31913.0	13.4	None	Continuous
09/17/2023 22:05	31922.7	9.7	None	Continuous
09/17/2023 23:05	31932.5	9.8	None	Continuous
09/18/2023 00:05	31942.2	9.7	None	Continuous
09/18/2023 01:05	31952.1	9.9	None	Continuous
09/18/2023 02:05	31961.9	9.8	None	Continuous
09/18/2023 03:05	31971.8	9.9	None	Continuous
09/18/2023 04:05	31981.6	9.8	None	Continuous
09/18/2023 05:05	31992.8	11.2	None	Continuous
09/18/2023 06:05	32002.7	9.9	None	Continuous
09/18/2023 07:05	32012.6	9.9	None	Continuous
09/18/2023 08:05	32026.3	13.7	None	Continuous
09/18/2023 09:05	32037.1	10.8	None	Continuous
09/18/2023 10:05	32046.8	9.7	None	Continuous
09/18/2023 11:05	32056.6	9.8	None	Continuous
09/18/2023 12:05	32066.4	9.8	None	Continuous
09/18/2023 13:05	32076.4	10.0	None	Continuous
09/18/2023 14:05	32086.2	9.8	None	Continuous
09/18/2023 15:05	32095.9	9.7	None	Continuous
09/18/2023 16:05	32105.6	9.7	None	Continuous
09/18/2023 17:05	32115.2	9.6	None	Continuous
09/18/2023 18:05	32126.1	10.9	None	Continuous
09/18/2023 19:05	32136.5	10.4	None	Continuous
09/18/2023 20:05	32146.1	9.6	None	Continuous
09/18/2023 21:05	32155.7	9.6	None	Continuous
09/18/2023 22:05	32166.4	10.7	None	Continuous
09/18/2023 23:05	32176.5	10.1	None	Continuous
09/19/2023 00:05	32186.6	10.1	None	Continuous
09/19/2023 01:05	32196.6	10.0	None	Continuous
09/19/2023 02:05	32207.1	10.5	None	Continuous
09/19/2023 03:05	32217.1	10.0	None	Continuous
09/19/2023 04:05	32227.0	9.9	None	Continuous
09/19/2023 05:05	32237.5	10.5	None	Continuous
09/19/2023 06:05	32247.5	10.0	None	Continuous
09/19/2023 07:05	32257.4	9.9	None	Continuous
09/19/2023 08:05	32267.3	9.9	None	Continuous
09/19/2023 09:05	32277.2	9.9	None	Continuous
09/19/2023 10:05	32287.0	9.8	None	Continuous
09/19/2023 11:05	32299.5	12.5	None	Continuous
09/19/2023 12:05	32315.3	15.8	None	Continuous
09/19/2023 13:05	32324.9	9.6	None	Continuous
09/19/2023 14:05	32334.5	9.6	None	Continuous
09/19/2023 15:05	32346.2	11.7	None	Continuous
09/19/2023 16:05	32355.8	9.6	None	Continuous
09/19/2023 17:05	32365.4	9.6	None	Continuous
09/19/2023 18:05	32374.9	9.5	None	Continuous
09/19/2023 19:05	32385.4	10.5	None	Continuous
09/19/2023 20:05	32394.9	9.5	None	Continuous
09/19/2023 21:05	32404.4	9.5	None	Continuous
09/19/2023 22:05	32413.9	9.5	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/19/2023 23:05	32424.9	11.0	None	Continuous
09/20/2023 00:05	32434.5	9.6	None	Continuous
09/20/2023 01:05	32444.2	9.7	None	Continuous
09/20/2023 02:05	32454.0	9.8	None	Continuous
09/20/2023 03:05	32463.8	9.8	None	Continuous
09/20/2023 04:05	32473.7	9.9	None	Continuous
09/20/2023 05:05	32483.6	9.9	None	Continuous
09/20/2023 06:05	32496.8	13.2	None	Continuous
09/20/2023 07:05	32508.0	11.2	None	Continuous
09/20/2023 08:05	32517.9	9.9	None	Continuous
09/20/2023 09:05	32527.7	9.8	None	Continuous
09/20/2023 10:05	32537.4	9.7	None	Continuous
09/20/2023 11:05	32547.2	9.8	None	Continuous
09/20/2023 12:05	32556.9	9.7	None	Continuous
09/20/2023 13:05	32572.7	15.8	None	Continuous
09/20/2023 14:05	32582.3	9.6	None	Continuous
09/20/2023 15:05	32592.0	9.7	None	Continuous
09/20/2023 16:05	32601.6	9.6	None	Continuous
09/20/2023 17:05	32611.3	9.7	None	Continuous
09/20/2023 18:05	32620.9	9.6	None	Continuous
09/20/2023 19:05	32631.9	11.0	None	Continuous
09/20/2023 20:05	32641.4	9.5	None	Continuous
09/20/2023 21:05	32650.9	9.5	None	Continuous
09/20/2023 22:05	32660.5	9.6	None	Continuous
09/20/2023 23:05	32670.1	9.6	None	Continuous
09/21/2023 00:05	32680.0	9.9	None	Continuous
09/21/2023 01:05	32689.9	9.9	None	Continuous
09/21/2023 02:05	32699.7	9.8	None	Continuous
09/21/2023 03:05	32709.5	9.8	None	Continuous
09/21/2023 04:05	32719.4	9.9	None	Continuous
09/21/2023 05:05	32729.2	9.8	None	Continuous
09/21/2023 06:05	32739.1	9.9	None	Continuous
09/21/2023 07:05	32749.0	9.9	None	Continuous
09/21/2023 08:05	32758.8	9.8	None	Continuous
09/21/2023 09:05	32768.6	9.8	None	Continuous
09/21/2023 10:05	32778.3	9.7	None	Continuous
09/21/2023 11:05	32788.1	9.8	None	Continuous
09/21/2023 12:05	32797.8	9.7	None	Continuous
09/21/2023 13:05	32809.6	11.8	None	Continuous
09/21/2023 14:05	32819.2	9.6	None	Continuous
09/21/2023 15:05	32828.8	9.6	None	Continuous
09/21/2023 16:05	32838.4	9.6	None	Continuous
09/21/2023 17:05	32848.0	9.6	None	Continuous
09/21/2023 18:05	32857.6	9.6	None	Continuous
09/21/2023 19:05	32867.2	9.6	None	Continuous
09/21/2023 20:05	32876.7	9.5	None	Continuous
09/21/2023 21:05	32886.2	9.5	None	Continuous
09/21/2023 22:05	32895.7	9.5	None	Continuous
09/21/2023 23:05	32905.4	9.7	None	Continuous
09/22/2023 00:05	32915.0	9.6	None	Continuous
09/22/2023 01:05	32924.8	9.8	None	Continuous
09/22/2023 02:05	32934.7	9.9	None	Continuous
09/22/2023 03:05	32944.5	9.8	None	Continuous
09/22/2023 04:05	32954.3	9.8	None	Continuous
09/22/2023 05:05	32964.0	9.7	None	Continuous
09/22/2023 06:05	32973.9	9.9	None	Continuous
09/22/2023 07:05	32983.7	9.8	None	Continuous
09/22/2023 08:05	32993.4	9.7	None	Continuous
09/22/2023 09:05	33035.6	42.2	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/22/2023 10:05	33045.3	9.7	None	Continuous
09/22/2023 11:05	33054.9	9.6	None	Continuous
09/22/2023 12:05	33064.6	9.7	None	Continuous
09/22/2023 13:05	33074.3	9.7	None	Continuous
09/22/2023 14:05	33089.7	15.4	None	Continuous
09/22/2023 15:05	33099.3	9.6	None	Continuous
09/22/2023 16:05	33112.4	13.1	None	Continuous
09/22/2023 17:05	33123.1	10.7	None	Continuous
09/22/2023 18:05	33132.6	9.5	None	Continuous
09/22/2023 19:05	33142.2	9.6	None	Continuous
09/22/2023 20:05	33151.7	9.5	None	Continuous
09/22/2023 21:05	33161.1	9.4	None	Continuous
09/22/2023 22:05	33170.5	9.4	None	Continuous
09/22/2023 23:05	33180.2	9.7	None	Continuous
09/23/2023 00:05	33189.8	9.6	None	Continuous
09/23/2023 01:05	33199.5	9.7	None	Continuous
09/23/2023 02:05	33211.2	11.7	None	Continuous
09/23/2023 03:05	33220.9	9.7	None	Continuous
09/23/2023 04:05	33230.6	9.7	None	Continuous
09/23/2023 05:05	33240.4	9.8	None	Continuous
09/23/2023 06:05	33250.2	9.8	None	Continuous
09/23/2023 07:05	33260.0	9.8	None	Continuous
09/23/2023 08:05	33269.8	9.8	None	Continuous
09/23/2023 09:05	33279.6	9.8	None	Continuous
09/23/2023 10:05	33289.3	9.7	None	Continuous
09/23/2023 11:05	33299.0	9.7	None	Continuous
09/23/2023 12:05	33308.7	9.7	None	Continuous
09/23/2023 13:05	33319.5	10.8	None	Continuous
09/23/2023 14:05	33329.2	9.7	None	Continuous
09/23/2023 15:05	33338.9	9.7	None	Continuous
09/23/2023 16:05	33349.7	10.8	None	Continuous
09/23/2023 17:05	33359.4	9.7	None	Continuous
09/23/2023 18:05	33369.0	9.6	None	Continuous
09/23/2023 19:05	33378.6	9.6	None	Continuous
09/23/2023 20:05	33388.2	9.6	None	Continuous
09/23/2023 21:05	33397.8	9.6	None	Continuous
09/23/2023 22:05	33407.5	9.7	None	Continuous
09/23/2023 23:05	33417.8	10.3	None	Continuous
09/24/2023 00:05	33427.5	9.7	None	Continuous
09/24/2023 01:05	33437.3	9.8	None	Continuous
09/24/2023 02:05	33447.3	10.0	None	Continuous
09/24/2023 03:05	33457.4	10.1	None	Continuous
09/24/2023 04:05	33467.5	10.1	None	Continuous
09/24/2023 05:05	33477.6	10.1	None	Continuous
09/24/2023 06:05	33487.8	10.2	None	Continuous
09/24/2023 07:05	33498.1	10.3	None	Continuous
09/24/2023 08:05	33508.3	10.2	None	Continuous
09/24/2023 09:05	33518.3	10.0	None	Continuous
09/24/2023 10:05	33528.3	10.0	None	Continuous
09/24/2023 11:05	33538.3	10.0	None	Continuous
09/24/2023 12:05	33548.3	10.0	None	Continuous
09/24/2023 13:05	33558.2	9.9	None	Continuous
09/24/2023 14:05	33568.2	10.0	None	Continuous
09/24/2023 15:05	33578.2	10.0	None	Continuous
09/24/2023 16:05	33588.2	10.0	None	Continuous
09/24/2023 17:05	33598.1	9.9	None	Continuous
09/24/2023 18:05	33608.1	10.0	None	Continuous
09/24/2023 19:05	33618.0	9.9	None	Continuous
09/24/2023 20:05	33628.8	10.8	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/24/2023 21:05	33646.6	17.8	None	Continuous
09/24/2023 22:05	33656.4	9.8	None	Continuous
09/24/2023 23:05	33666.2	9.8	None	Continuous
09/25/2023 00:05	33676.1	9.9	None	Continuous
09/25/2023 01:05	33686.1	10.0	None	Continuous
09/25/2023 02:05	33696.0	9.9	None	Continuous
09/25/2023 03:05	33706.0	10.0	None	Continuous
09/25/2023 04:05	33716.0	10.0	None	Continuous
09/25/2023 05:05	33726.1	10.1	None	Continuous
09/25/2023 06:05	33736.2	10.1	None	Continuous
09/25/2023 07:05	33746.1	9.9	None	Continuous
09/25/2023 08:05	33756.0	9.9	None	Continuous
09/25/2023 09:05	33765.8	9.8	None	Continuous
09/25/2023 10:05	33775.6	9.8	None	Continuous
09/25/2023 11:05	33785.4	9.8	None	Continuous
09/25/2023 12:05	33795.2	9.8	None	Continuous
09/25/2023 13:05	33804.9	9.7	None	Continuous
09/25/2023 14:05	33814.7	9.8	None	Continuous
09/25/2023 15:05	33824.4	9.7	None	Continuous
09/25/2023 16:05	33834.1	9.7	None	Continuous
09/25/2023 17:05	33844.2	10.1	None	Continuous
09/25/2023 18:05	33853.9	9.7	None	Continuous
09/25/2023 19:05	33871.0	17.1	None	Continuous
09/25/2023 20:05	33880.6	9.6	None	Continuous
09/25/2023 21:05	33890.2	9.6	None	Continuous
09/25/2023 22:05	33899.9	9.7	None	Continuous
09/25/2023 23:05	33909.6	9.7	None	Continuous
09/26/2023 00:05	33919.9	10.3	None	Continuous
09/26/2023 01:05	33930.2	10.3	None	Continuous
09/26/2023 02:05	33940.0	9.8	None	Continuous
09/26/2023 03:05	33950.0	10.0	None	Continuous
09/26/2023 04:05	33959.9	9.9	None	Continuous
09/26/2023 05:05	33969.8*	9.9*	None*	Continuous*
09/26/2023 06:05	33979.6	9.8*	None	Continuous
09/26/2023 07:05	33989.4	9.8	None	Continuous
09/26/2023 08:05	33999.2	9.8	None	Continuous
09/26/2023 09:05	34009.1	9.9	None	Continuous
09/26/2023 10:05	34018.8	9.7	None	Continuous
09/26/2023 11:05	34028.6	9.8	None	Continuous
09/26/2023 12:05	34038.4	9.8	None	Continuous
09/26/2023 13:05	34048.2	9.8	None	Continuous
09/26/2023 14:05	34058.0	9.8	None	Continuous
09/26/2023 15:05	34067.8	9.8	None	Continuous
09/26/2023 16:05	34077.6	9.8	None	Continuous
09/26/2023 17:05	34087.5	9.9	None	Continuous
09/26/2023 18:05	34097.2	9.7	None	Continuous
09/26/2023 19:05	34106.8	9.6	None	Continuous
09/26/2023 20:05	34116.4	9.6	None	Continuous
09/26/2023 21:05	34126.0	9.6	None	Continuous
09/26/2023 22:05	34135.6	9.6	None	Continuous
09/26/2023 23:05	34145.3	9.7	None	Continuous
09/27/2023 00:05	34155.1	9.8	None	Continuous
09/27/2023 01:05	34164.8	9.7	None	Continuous
09/27/2023 02:05	34174.6	9.8	None	Continuous
09/27/2023 03:05	34184.4	9.8	None	Continuous
09/27/2023 04:05	34194.2	9.8	None	Continuous
09/27/2023 05:05	34204.1	9.9	None	Continuous
09/27/2023 06:05	34214.0	9.9	None	Continuous
09/27/2023 07:05	34223.9	9.9	None	Continuous

Data Log Report MIU#: 1573249004 for 06/23/2023 - 09/27/2023 - 5/8" - 1" T-10, GALLONS

Interval End Time	Interval Reading	Interval Consumption	Reverse Flow	Leak
09/27/2023 08:05	34233.8	9.9	None	Continuous
09/27/2023 09:05	34243.6	9.8	None	Continuous
09/27/2023 10:05	34253.5	9.9	None	Continuous

PAWC Exhibit 4

04/05/2023 16:23:06 EST (ZIELINM)Business Partner:1102996881Customer Name:Alexander ArgentinaSvc Notification Notes:911 called in for customer at 114 Fremont St MtOliver asking if we can respond to premise. Customer has a busted pipe inside property and can not shut their main valve off. Needsemerg turn off at street.

UpdateOrder_04/05/2023_1632_SWINGLLA sent info to jermaine las
[chatmaj] [04/05/2023 17:14 pm]

****Premise****:

- FSR Name : [chatmaj] [04/05/2023 17:13 pm]

- Meter Location : ,
- Meter Location changed to : Front Right, Lawn/Field
- Reading Location : ,
- Secure Access : Not Secure
- Heat Type : Non Hot Water

Meter

-#Meter# : H011274655

- MIU1# - 000000000011960483

Read Captured: No Read Obtained

****Activity****:

- Found Service FSR Selected : I05 ON at Pit
- Left Service FSR Selected : I06 OFF at Pit
- Point of Control Operated FSR Selected : C01 (Yes)
- Activities performed for Meter Maintain to : H011274655 : Unable toObtain Meter Read

****Inspection****:

- Service Line Material : None
- Customer Side Leak : None
- Premise pass sewer inspection : Did Not Inspect

****Complete****:

- Service Order was : COMP

- Notes Captured by FSR : Curbbox not working so turned water off insidemeter tile. Wrote up curbbox to be repaired.

Order Comments:

Check Meter, Verify Serial #, Read
we went out on 10/30 and notes say there might be a leak in service line . customer has protection and someone was sent out to check and he was told it was an am water issue . please recheck meter

[bujnowrj] [12/07/2023 14:01 pm]

****Premise****:

- FSR Name : [bujnowrj] [12/07/2023 14:01 pm]
- Meter Location : Front Right, Lawn/Field
- Reading Location : Front Right, Lawn/Field
- Secure Access : Not Secure
- Heat Type : Non Hot Water

****Meter****

-#Meter# : 000000000064907271
- MIU1# - 000000001573249004
Read Captured: No Read Obtained

****Activity****:

- Found Service FSR Selected : I05 ON at Pit
- Left Service FSR Selected : I05 ON at Pit
- Point of Control Operated FSR Selected : C01 (Yes)
- Activities performed for Meter Maintain to : 000000000064907271 :Checked Leak at Curb/Street

****Inspection****:

- Service Line Material : None
- Customer Side Leak : None

****Complete****:

- Service Order was : COMP
- Notes Captured by FSR : Leak in meter tile needs repaired.

Alexander Argentina / 210032542353
114 Fremont St., Pittsburgh, PA

Open PUC Complaint / Dispute
Outage / Roll order / Current Events

Hold | Retrieve | Hang Up | Transfer | Warm Transfer | Consult | Conference | Toggle | DTMF Pad | End

List of Service Orders

Technically Completed Orders can not be selected. Choose another one.

Mat Code	Description	Start Date	Service Order	User S...	User Status 1	End Date	Notifi...	SO Fee	SO Fee Waiver	Created By	Created On
ILK	Inspect for Leak, Hi/Lo U...	09/27/2023	527492004		Success	Field Complete	09/27/2023	32893...	0.00	CROUCHS	09/18/2023
CMT	Meter Test Customer Re...	04/18/2023	526251278		Success	Field Complete	04/18/2023	32733...	10.00	GRUBERRJ	04/14/2023
RPO	Turn ON Repairs Comple...	04/10/2023	526191453		Success	Field Complete	04/10/2023	32726...	30.00	FRAMES	04/05/2023

« Back 1 2 Forward »

Cancel Service Order | Change Appointment | Add Comment

Service Order Details

Mat Code: ILK
Order Status: TECO
Appt Start Time: 09:00

Description: Inspect for Leak, Hi/Lo Usage
Priority: 3. Customer Appt.
Appt End Time: 12:00

Order Comments:

Inspect for Leak/High-Low Usage
Have you found a leak, including a leaking toilet or faucet? No. Understanding More about your consumption, Customer Selected: none of these apply/No pets/hazards. Please check meter for leaks or to see if it is malfunctioning. Customer is concerned that the meter is not working correctly since the usage has went up every month since it was changed in April. Please let customer know your findings. Liability script offered and rejected.
[cadvalge] [09/27/2023 11:40 am]

****Premise****
- FSR Name : [cadvalge] [09/27/2023 11:33 am]
- Meter Location : Front Right, Lawn/Field
- Reading Location : Front Right, Lawn/Field
- Secure Access : Not Secure
- Heat Type : Non Hot Water

****Meter****
- #Meters : 00000000004907271
- MLI# : 000000001573249004
In Read: 00342
Read Captured: Typed

****Activity****
- Found Service FSR Selected : I01 ON at Curb Stop
- Left Service FSR Selected : I01 ON at Curb Stop
- Point of Control Operated FSR Selected : C01 (Yes)
- Activities performed for Meter Maintain to : 00000000004907271 : ReadMeter/Verified Movement on Meter

****Inspection****
- Service Line Material : None
- Customer Side Leak : None

****Complete****
- Service Order was : COMP
- Office Review : Yes
- Office Review Notes : Cust has service line leak please send leak letter
- Notes Captured by FSR : This Cust called about high water bill, upon arrival Cust stated his water was off at main in house was on at meter, data logged meter still shows usage, advised Cust he has service line leak between meter and valve, will not list wants old meter back, told him we cannot do that, asked why it was changed, told him it was most likely estimated, when looking at service orders, all reads were actual, Cust said why did they change it then? said PUC requires us to after so many years estimated like 15 years, wants old meter back called supervisor/guy is very argumentative, will not listen he has leak, offered to put new meter in and test that one, advised \$10 dollar fee REFUSED HAD SUPERVISOR CALL, Cust keeps threatening legislation, cause he want old meter in and we do not use them anymore after looking at old meter change order from 4-15-23, meter was pulled for testing for high bills, cust valve was off inside and still has movement meter, please send leak letter for service line leak. CUST REFUSES TO ACKNOWLEDGE HE HAS LEAK ON SERVICE YET WATER KEEPS RUNNING WITH VALVE IN HOUSE OFF

Alexander Argentina / 210032542353
114 Fremont St., Pittsburgh, PA

Open PUC Complaint / Dispute
Outage / Roll order / Current Events

Hold | Retrieve | Hang Up | Transfer | Warm Transfer | Consult | Conference | Toggle | DTMF Pad | End

Ready | Not F

List of Service Orders

Technically Completed Orders can not be selected. Choose another one.

Order Details: Notification Details

Mat C...	Description	Start Date	Service Order	User S...	User Status 1	End Date	Notifi...	SO Fee	SO Fee Waiver	Created By	Created On
BRH	Blanket Services&Latera...	12/12/2023	91477887		Field Complete	12/17/20...	2153...	0.00		CIEPLEJA	12/12/2023

« Back 1 2 Forward »

Cancel Service Order | Change Appointment | Add Comment

Service Order Details

Mat Code: BRH
Order Status: TECO
Appt Start Time: 00:00

Description: Blanket Services&LateralsRepl
Priority: 4. Within 5 Days
Appt End Time: 00:00
Order Start date: 12/12/2023

Order Comments:

CURB BOX REPLACE
replace curb box. Check and repair leak at copper setter.