

Angelina Umstead, Esq.

(610) 921-6202  
Fax: (330) 315-9263

April 3, 2025

**VIA E-FILING**

Rosemary Chiavetta, Secretary  
Pennsylvania Public Utility Commission  
Commonwealth Keystone Building  
400 North Street, 2<sup>nd</sup> Floor  
Harrisburg, PA 17120

***Re: Completed Restoration of Momentary and Sustained Interruptions –  
FirstEnergy Pennsylvania Electric Company; Docket No. M-2025-3052814***


Dear Secretary Chiavetta:

Pursuant to 52 Pa. Code § 67.1, FirstEnergy Pennsylvania Electric Company on behalf of Penelec Rate District (“Penelec”) submits written notification of completed restoration efforts following storm conditions that began on March 15, 2025 that caused multiple service interruptions in the Penelec service territory.

Attached please find the details relative to the impact of this recent outage event and the restoration activities that took place. It should be noted that the review and approval process of this outage information is still in progress at the time of filing this report and as such, all outage information contained in this report should be considered preliminary.

If you have any questions, please contact me at (610) 921-6202.

Sincerely,



Angelina Umstead

Enclosures

c: Dan Searfoorce - PaPUC Bureau of Technical Utility Services (via electronic mail)  
Derek Ruhl - PaPUC Bureau of Technical Utility Services (via electronic mail)  
John Van Zant - PaPUC Bureau of Technical Utility Services (via electronic mail)

ELECTRIC UTILITY REPORT OF OUTAGE TO  
PENNSYLVANIA PUBLIC UTILITY COMMISSION  
SECRETARY'S BUREAU  
P O BOX 3265  
HARRISBURG, PA 17105-3265

1. Reporting Utility: FirstEnergy Pennsylvania Electric Company ("FE PA")  
on behalf of Penelec Rate District ("Penelec")  
Address: 800 Cabin Hill Drive  
Greensburg, PA 15601

2. Name and title of person making report:

John Hawkins  
*(Name)*

President Pennsylvania  
*(Title)*

3. Telephone number: (330) 384-4795  
*(Telephone Number)*

4. Date and time report was made to Commission:

March 16, 2025  
*(Date)*

1808  
*(Time)*

5. Interruption or Outage:

(a) Number of customers affected: 104,243 (Represents 17.6% of Penelec's total customers).

(b) Approximate number of outage cases and trouble cases for each county affected during event: See response to 5(c)

(c) Approximate number of outages for each county affected during the event:

County	Outages	Outage Cases	Trouble Cases
Bedford	77	10	13
Blair	10,459	72	198
Bradford	3,890	64	64
Cambria	10,949	106	183
Centre	7,392	23	50
Clearfield	10,874	156	308
Crawford	6,092	26	36
Cumberland	946	5	4
Erie	4,415	57	84
Forest	1,117	9	2
Franklin	1	1	3
Huntingdon	1,340	21	55
Indiana	8,739	69	170
Jefferson	9,171	46	144
Lycoming	50	3	1
McKean	6,484	46	30
Mifflin	7	3	10
Perry	30	1	1
Potter	3,423	16	27
Somerset	4,290	66	144
Sullivan	1,872	16	2
Susquehanna	3,605	48	76
Tioga	3,152	64	137
Venango	462	13	10
Warren	2,437	21	17
Wayne	496	4	9
Westmoreland	1	1	4
Wyoming	2,472	35	42
<b>Total</b>	<b>104,243</b>	<b>1,002</b>	<b>1,824</b>

(d) Approximate number of outage cases exceeding 6 or more hours in duration: 550

(e) A listing of each outage case exceeding 6 or more hours in duration:  
See Attachment A.

(f) Reason for the interruption or outages: Beginning the morning of Saturday, March 15, 2025, a weather system began moving through Pennsylvania including the

Penelec service territory, producing thunderstorms and wind gusts of 35 to 45 mph. On Sunday, March 16, 2025, the system produced even stronger storms, a tornado, and high winds with maximum gusts of approximately 65 to 90 miles per hour. Gusts of approximately 35 miles per hour persisted an additional two days, Monday, March 17, 2025, through Tuesday, March 18, 2025. The persistent wind prolonged storm activity as well as restoration efforts, since crews cannot safely handle materials if winds exceed 30 mph, or operate bucket trucks if winds exceed 40 mph. See Attachment B for the maximum wind gusts for March 15-18, 2025, tornado touch down locations, and the 24-hour total precipitation for March 16, 2025. In addition to the persistent wind, restoration was hampered by multiple 115kv transmission line outages that required repair prior to re-energizing customers.

Damage as a result of high winds included downed wires, and damaged and broken poles, trees, crossarms and transformers. The Altoona, Clearfield, Dubois, Indiana, Mansfield, Philipsburg, and Somerset regions were the hardest hit areas. Approximately 56.7% of the total outages that occurred were tree related with an additional 20.8% being wind and lightning related.

Preliminary data indicates the reliability impact of the storm was 86.5 minutes of SAIDI, 0.176 of SAIFI, and an overall storm CAIDI of 491.4 minutes.

- (g) Projected time of restoration: It was estimated that the majority of customers affected would be restored by 1500 on Wednesday, March 19, 2025.

See Attachment C for the restoration curve and Attachment D for the order restoration graphs.

- (h) The number of utility workers, contract workers, and workers received as mutual aid assigned specifically to the repair work by general function:

<b>Company</b>	<b># of Workers</b>	<b>General Function</b>
Penelec	67	Line
Penn Power Rate District	14	Line
West Penn Rate District	6	Line
<b>Subtotal</b>	<b>87</b>	<b>Line</b>
Agostino Utilities LLC	39	Line Contractor
Henkels & McCoy	19	Line Contractor
I.B. Abel	10	Line Contractor
JW Didado	47	Line Contractor
NG Gilbert	17	Line Contractor
Thompson Electric	10	Line Contractor
<b>Subtotal</b>	<b>142</b>	<b>Line Contractor</b>
Asplundh Tree Expert, LLC	26	Forestry Contractor
Davey Tree Expert	30	Forestry Contractor
Lewis Tree	15	Forestry Contractor
Penn Line Services, Inc.	110	Forestry Contractor
<b>Subtotal</b>	<b>181</b>	<b>Forestry Contractor</b>
FirstEnergy Service Company	12	Forestry Support
<b>Subtotal</b>	<b>12</b>	<b>Forestry Support</b>
Penelec	75	Hazard/Damage Responders
FirstEnergy Service Company	40	Hazard/Damage Responders
<b>Subtotal</b>	<b>115</b>	<b>Hazard/Damage Responders</b>
Penelec	12	Hazard/Damage Support
FirstEnergy Service Company	9	Hazard/Damage Support
<b>Subtotal</b>	<b>21</b>	<b>Hazard/Damage Support</b>
Penelec	34	Support
FirstEnergy Service Company	5	Support
<b>Subtotal</b>	<b>39</b>	<b>Support</b>
<b>Grand Total</b>	<b>597</b>	

- (i) The date and time of the first information of a service interruption: March 15, 2025, at 0840.
- (j) The date and time that repair crews were assembled: March 15, 2025, at 0600.
- (k) The actual time that service was restored to the last affected customer: March 20, 2025, at 16:47

- (l) A general description of the physical damage sustained by the utility facilities as a result of the interruption/outage:

Equipment	Number
Primary Spans	536
Secondary Spans	216
Crossarms Replaced	251
Cutouts Replaced	141
Poles Replaced	142
Transformers Replaced	60
Wire & Cable Replaced (feet)	26,238

- (m) If the interruption/outage event was weather-related, the utility’s weather reports, outlooks, or scenarios for the day before and the day of the interruption/outage event:

See Attachment E for the weather forecast reports.

- (n) If the interruption/outage event caused approximate outages that exceed 10% or more of the number of customers in the utility’s entire service territory, rank the event in terms of the number and duration of outages and provide 2 comparable events, including the number and duration of outages for those comparable events.

The below chart reflects a ranking of the subject event in relation to two comparable Penelec events (based on the number and duration of outages).

Rank by Number of Outages	Operating Company	Date	Event Description	Duration (hours)	Customers Affected
1	Penelec	January 9-13, 2024	High Winds and Rain	108 hours 25 minutes	112,452 (19.2%)
2	Penelec	March 15-20, 2025	Winter Storm Nyla	128 hours 7 minutes	104,243 (17.6%)
3	Penelec	November 15–18, 2025	High Winds	82 hours 50 minutes	90,058 (15.5%)

Remarks: The storm statistics contained in this report are preliminary. The review and approval of the storm statistics were still in progress as of the time this report was filed.

**Attachment A: A listing of each outage case exceeding six or more hours in duration, including the following information<sup>1</sup>:**

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1660219	Clearfield	299	4,653	03/16/2025 1418	03/19/2025 1951
1672238	Clearfield	14	4,626	03/16/2025 1409	03/19/2025 1915
1672221	Clearfield	16	4,611	03/16/2025 1409	03/19/2025 1900
1661019	Clearfield	12	4,611	03/16/2025 1439	03/19/2025 1930
1671640	Cambria	7	4,580	03/16/2025 1418	03/19/2025 1838
1671640	Cambria	8	4,577	03/16/2025 1418	03/19/2025 1835
1660395	Clearfield	24	4,575	03/16/2025 1425	03/19/2025 1840
1665626	Clearfield	14	4,569	03/16/2025 1427	03/19/2025 1836
1660346	Clearfield	4	4,527	03/16/2025 1351	03/19/2025 1718
1672676	Clearfield	4	4,505	03/16/2025 1541	03/19/2025 1846
1664498	Clearfield	5	4,505	03/16/2025 1445	03/19/2025 1750
1663081	Centre	6	4,483	03/16/2025 1427	03/19/2025 1710
1660346	Clearfield	39	4,480	03/16/2025 1351	03/19/2025 1631
1669470	Clearfield	4	4,480	03/16/2025 1351	03/19/2025 1631
1672091	Clearfield	1	4,447	03/16/2025 1431	03/19/2025 1638
1667620	Clearfield	4	4,434	03/16/2025 1438	03/19/2025 1632
1661476	Blair	1	4,419	03/16/2025 1448	03/19/2025 1627
1665175	Bedford	4	4,408	03/16/2025 1440	03/19/2025 1608
1661303	Clearfield	1	4,400	03/16/2025 1445	03/19/2025 1605
1669523	Centre	6	4,383	03/16/2025 1822	03/19/2025 1925
1659308	Clearfield	1	4,374	03/16/2025 1410	03/19/2025 1504
1661028	Blair	4	4,364	03/16/2025 1439	03/19/2025 1523
1664931	Clearfield	3	4,359	03/16/2025 1518	03/19/2025 1557
1670520	Clearfield	814	4,356	03/16/2025 1409	03/19/2025 1445
1666526	Huntingdon	6	4,346	03/16/2025 1435	03/19/2025 1501
1666432	Huntingdon	7	4,316	03/16/2025 1435	03/19/2025 1431
1664096	Clearfield	21	4,284	03/16/2025 1431	03/19/2025 1355
1670883	Cambria	10	4,282	03/16/2025 1418	03/19/2025 1340
1669708	Clearfield	11	4,271	03/16/2025 1437	03/19/2025 1348
1660343	Clearfield	25	4,256	03/16/2025 1423	03/19/2025 1319
1668579	Clearfield	4	4,238	03/16/2025 1722	03/19/2025 1600
1661042	Clearfield	6	4,221	03/16/2025 1439	03/19/2025 1300

<sup>1</sup> When applicable, the individual restoration steps for an order are provided for those customers that were out of service for 6 hours or more.

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1662008	Centre	33	4,217	03/16/2025 1427	03/19/2025 1244
1660986	Blair	2	4,210	03/16/2025 1438	03/19/2025 1248
1661822	Clearfield	12	4,203	03/16/2025 1500	03/19/2025 1303
1669606	Clearfield	20	4,191	03/16/2025 1243	03/19/2025 1034
1669533	Clearfield	2	4,177	03/16/2025 1439	03/19/2025 1216
1671990	Bedford	1	4,168	03/16/2025 1530	03/19/2025 1258
1661010	Clearfield	3	4,167	03/16/2025 1438	03/19/2025 1205
1660986	Blair	1	4,167	03/16/2025 1438	03/19/2025 1205
1664523	Bedford	1	4,167	03/16/2025 1530	03/19/2025 1257
1661081	Clearfield	6	4,158	03/16/2025 1440	03/19/2025 1158
1669085	Clearfield	3	4,157	03/16/2025 1953	03/19/2025 1710
1662703	Centre	22	4,147	03/16/2025 1552	03/19/2025 1259
1670551	Cambria	23	4,037	03/16/2025 1418	03/19/2025 0935
1669930	Clearfield	1	4,024	03/16/2025 2011	03/19/2025 1515
1660271	Indiana	5	3,497	03/16/2025 1421	03/19/2025 0038
1657894	Huntingdon	4	3,470	03/16/2025 0848	03/18/2025 1838
1663791	Huntingdon	2	3,440	03/16/2025 1140	03/18/2025 2100
1660475	Clearfield	8	3,426	03/16/2025 1427	03/18/2025 2333
1661904	Clearfield	32	3,377	03/16/2025 1504	03/18/2025 2321
1664922	Clearfield	2	3,314	03/16/2025 1446	03/18/2025 2200
1670685	Indiana	33	3,313	03/16/2025 1333	03/18/2025 2046
1667220	Clearfield	2	3,283	03/17/2025 0817	03/19/2025 1500
1659955	Cambria	13	3,279	03/16/2025 1407	03/18/2025 2046
1660912	Clearfield	5	3,244	03/16/2025 1436	03/18/2025 2040
1659824	Clearfield	41	3,237	03/16/2025 1136	03/18/2025 1733
1666185	Indiana	3	3,233	03/16/2025 1335	03/18/2025 1928
1668380	Huntingdon	1	3,222	03/17/2025 1332	03/19/2025 1914
1670891	Clearfield	4	3,219	03/16/2025 1438	03/18/2025 2017
1670891	Clearfield	3	3,217	03/16/2025 1438	03/18/2025 2015
1659796	Cambria	25	3,211	03/16/2025 1402	03/18/2025 1933
1658652	Clearfield	188	3,202	03/16/2025 1409	03/18/2025 1931
1669322	Tioga	2	3,191	03/16/2025 1549	03/18/2025 2100
1660748	Clearfield	12	3,184	03/16/2025 1433	03/18/2025 1937
1661254	Blair	7	3,182	03/16/2025 1444	03/18/2025 1946
1660273	Cambria	116	3,167	03/16/2025 1418	03/18/2025 1905
1663901	Clearfield	4	3,149	03/16/2025 1729	03/18/2025 2158
1668714	Jefferson	22	3,143	03/16/2025 1347	03/18/2025 1810
1670465	Blair	4	3,116	03/16/2025 1454	03/18/2025 1850

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1659026	Indiana	15	3,103	03/16/2025 1338	03/18/2025 1721
1663819	McKean	5	3,078	03/16/2025 1449	03/18/2025 1807
1661051	Blair	5	3,072	03/16/2025 1439	03/18/2025 1751
1666638	Cambria	2	3,071	03/16/2025 1420	03/18/2025 1731
1666679	Cambria	1	3,071	03/16/2025 1507	03/18/2025 1818
1670772	Clearfield	40	3,062	03/16/2025 1423	03/18/2025 1725
1670773	Clearfield	27	3,062	03/16/2025 1423	03/18/2025 1725
1666389	Huntingdon	2	3,057	03/16/2025 1435	03/18/2025 1732
1661263	Clearfield	11	3,052	03/16/2025 1445	03/18/2025 1737
1666036	Somerset	1	3,050	03/16/2025 1657	03/18/2025 1947
1658537	Bradford	3	3,037	03/16/2025 1208	03/18/2025 1445
1662030	Centre	3	3,030	03/16/2025 1510	03/18/2025 1740
1668985	Clearfield	4	3,017	03/17/2025 1658	03/19/2025 1915
1664120	Clearfield	3	3,001	03/16/2025 1749	03/18/2025 1950
1661890	Blair	5	2,996	03/16/2025 1504	03/18/2025 1700
1660240	Cambria	189	2,992	03/16/2025 1418	03/18/2025 1610
1661146	Clearfield	97	2,986	03/16/2025 1438	03/18/2025 1624
1669321	Tioga	1	2,986	03/16/2025 1549	03/18/2025 1735
1664705	Centre	7	2,978	03/16/2025 1900	03/18/2025 2038
1667611	Jefferson	1	2,955	03/17/2025 0948	03/19/2025 1103
1669089	Clearfield	1	2,944	03/17/2025 1746	03/19/2025 1850
1668831	Clearfield	44	2,944	03/16/2025 1433	03/18/2025 1537
1660972	Clearfield	122	2,942	03/16/2025 1438	03/18/2025 1540
1658984	Indiana	22	2,939	03/16/2025 1333	03/18/2025 1432
1668833	Clearfield	89	2,937	03/16/2025 1433	03/18/2025 1530
1659271	Cambria	75	2,928	03/16/2025 1353	03/18/2025 1441
1662300	Tioga	21	2,923	03/16/2025 1524	03/18/2025 1607
1661120	Clearfield	4	2,919	03/16/2025 1441	03/18/2025 1520
1670337	Clearfield	5	2,918	03/16/2025 1422	03/18/2025 1500
1664534	Centre	501	2,907	03/16/2025 1427	03/18/2025 1454
1665350	Jefferson	35	2,877	03/16/2025 1342	03/18/2025 1339
1660760	Blair	58	2,876	03/16/2025 1433	03/18/2025 1429
1659010	Indiana	23	2,873	03/16/2025 1336	03/18/2025 1329
1664691	Blair	1	2,872	03/16/2025 1858	03/18/2025 1850
1664347	Huntingdon	4	2,856	03/16/2025 1810	03/18/2025 1746
1659817	Cambria	2	2,845	03/16/2025 1403	03/18/2025 1328
1660383	Clearfield	60	2,839	03/16/2025 1425	03/18/2025 1344
1659204	Somerset	7	2,834	03/16/2025 1348	03/18/2025 1302

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1665038	Clearfield	21	2,834	03/16/2025 1943	03/18/2025 1857
1667078	Somerset	3	2,832	03/16/2025 1337	03/18/2025 1249
1666300	Huntingdon	6	2,830	03/16/2025 1435	03/18/2025 1345
1660219	Clearfield	71	2,828	03/16/2025 1418	03/18/2025 1326
1659637	Cambria	17	2,825	03/16/2025 1358	03/18/2025 1303
1660432	Clearfield	34	2,822	03/16/2025 1427	03/18/2025 1329
1658652	Clearfield	165	2,811	03/16/2025 1409	03/18/2025 1300
1663947	Clearfield	1	2,800	03/16/2025 1734	03/18/2025 1614
1660219	Clearfield	124	2,794	03/16/2025 1418	03/18/2025 1252
1658762	Bradford	1	2,780	03/16/2025 1301	03/18/2025 1121
1665393	Jefferson	8	2,778	03/16/2025 1346	03/18/2025 1204
1664879	Cambria	2	2,773	03/16/2025 1508	03/18/2025 1321
1661895	Susquehanna	28	2,760	03/16/2025 1503	03/18/2025 1303
1660217	Cambria	8	2,744	03/16/2025 1419	03/18/2025 1203
1662569	Blair	1	2,723	03/16/2025 1541	03/18/2025 1304
1662678	Blair	1	2,718	03/16/2025 1550	03/18/2025 1308
1660967	Blair	4	2,692	03/16/2025 1438	03/18/2025 1130
1666164	Jefferson	14	2,684	03/16/2025 1346	03/18/2025 1030
1666164	Jefferson	3	2,683	03/16/2025 1347	03/18/2025 1030
1662860	Tioga	11	2,666	03/16/2025 1602	03/18/2025 1228
1660892	Somerset	1	2,664	03/16/2025 1436	03/18/2025 1100
1662640	Jefferson	1	2,654	03/16/2025 1546	03/18/2025 1200
1669583	Tioga	2	2,651	03/16/2025 1555	03/18/2025 1206
1659862	Somerset	5	2,650	03/16/2025 1336	03/18/2025 0946
1665066	Blair	1	2,638	03/16/2025 1947	03/18/2025 1545
1661693	Blair	3	2,623	03/16/2025 1640	03/18/2025 1223
1670076	Tioga	7	2,622	03/16/2025 1547	03/18/2025 1129
1662678	Blair	3	2,620	03/16/2025 1550	03/18/2025 1130
1666034	Somerset	1	2,612	03/16/2025 1357	03/18/2025 0929
1662718	Tioga	2	2,601	03/16/2025 1553	03/18/2025 1114
1661100	Blair	6	2,586	03/16/2025 1441	03/18/2025 0947
1670265	Tioga	35	2,579	03/16/2025 1549	03/18/2025 1048
1660348	Blair	6	2,569	03/16/2025 1424	03/18/2025 0913
1668811	Cambria	3	2,555	03/17/2025 1607	03/19/2025 1042
1670113	Bradford	5	2,550	03/16/2025 1549	03/18/2025 1019
1658652	Clearfield	21	2,537	03/16/2025 1409	03/18/2025 0826
1663830	Tioga	1	2,514	03/16/2025 1721	03/18/2025 1115
1664245	Tioga	36	2,490	03/16/2025 1758	03/18/2025 1128

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1660757	Bradford	1	2,487	03/16/2025 1433	03/18/2025 0800
1664601	Blair	1	2,459	03/16/2025 1846	03/18/2025 1145
1665241	Tioga	6	2,402	03/16/2025 2014	03/18/2025 1216
1670390	Centre	1	2,400	03/16/2025 2003	03/18/2025 1203
1668139	Huntingdon	3	2,238	03/16/2025 1442	03/18/2025 0400
1669385	Indiana	1	2,237	03/17/2025 2024	03/19/2025 0941
1662944	Tioga	1	2,222	03/16/2025 1608	03/18/2025 0510
1663356	Centre	1	2,210	03/16/2025 1630	03/18/2025 0520
1668139	Huntingdon	38	2,207	03/16/2025 1442	03/18/2025 0329
1670220	Clearfield	2	2,147	03/18/2025 1033	03/19/2025 2220
1660143	Clearfield	478	2,146	03/16/2025 1409	03/18/2025 0155
1658652	Clearfield	395	2,146	03/16/2025 1409	03/18/2025 0155
1660938	Clearfield	50	2,139	03/16/2025 1437	03/18/2025 0216
1659223	Indiana	4	2,123	03/16/2025 1349	03/18/2025 0112
1667509	Tioga	2	2,122	03/16/2025 2302	03/18/2025 1024
1669631	Cambria	11	2,110	03/16/2025 1405	03/18/2025 0115
1669631	Cambria	48	2,110	03/16/2025 1405	03/18/2025 0115
1658652	Clearfield	22	2,078	03/16/2025 1409	03/18/2025 0047
1658652	Clearfield	25	2,056	03/16/2025 1409	03/18/2025 0025
1666063	Somerset	8	2,054	03/16/2025 1356	03/18/2025 0010
1659004	Westmoreland	1	2,050	03/16/2025 1333	03/17/2025 2343
1663069	Blair	14	2,032	03/16/2025 1423	03/18/2025 0015
1663070	Blair	4	2,032	03/16/2025 1423	03/18/2025 0015
1669612	Centre	8	1,994	03/16/2025 1554	03/18/2025 0108
1662625	Blair	15	1,992	03/16/2025 0748	03/17/2025 1700
1661191	Clearfield	6	1,987	03/16/2025 1443	03/17/2025 2350
1670596	Tioga	1	1,954	03/17/2025 0846	03/18/2025 1720
1661370	Blair	10	1,954	03/16/2025 1446	03/17/2025 2320
1666168	Somerset	15	1,951	03/16/2025 1324	03/17/2025 2155
1662401	Blair	1	1,949	03/16/2025 1531	03/18/2025 0000
1668607	Somerset	4	1,930	03/16/2025 1350	03/17/2025 2200
1665475	Indiana	181	1,898	03/16/2025 1347	03/17/2025 2125
1665417	Somerset	45	1,881	03/16/2025 1341	03/17/2025 2102
1661048	Clearfield	40	1,871	03/16/2025 1439	03/17/2025 2150
1662737	Tioga	129	1,860	03/16/2025 1555	03/17/2025 2255
1658652	Clearfield	28	1,858	03/16/2025 1409	03/17/2025 2107
1666447	Tioga	9	1,839	03/16/2025 1551	03/17/2025 2230
1661073	Clearfield	149	1,833	03/16/2025 1440	03/17/2025 2113

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1667459	Tioga	1	1,829	03/17/2025 0909	03/18/2025 1538
1666789	Tioga	5	1,826	03/17/2025 0554	03/18/2025 1220
1669308	Tioga	7	1,826	03/16/2025 1534	03/17/2025 2200
1668263	Indiana	48	1,823	03/16/2025 1347	03/17/2025 2010
1664623	Jefferson	7	1,816	03/16/2025 1358	03/17/2025 2014
1659481	Huntingdon	31	1,811	03/16/2025 1355	03/17/2025 2006
1659009	Somerset	46	1,809	03/16/2025 1333	03/17/2025 1942
1670207	McKean	5	1,808	03/16/2025 1722	03/17/2025 2330
1669337	Indiana	1	1,791	03/16/2025 1351	03/17/2025 1942
1669190	Somerset	20	1,783	03/16/2025 1322	03/17/2025 1905
1664886	McKean	41	1,739	03/16/2025 1931	03/18/2025 0030
1660793	Blair	8	1,722	03/16/2025 1434	03/17/2025 1916
1661213	Clearfield	44	1,715	03/16/2025 1427	03/17/2025 1902
1668568	Bradford	2	1,709	03/16/2025 1216	03/17/2025 1645
1658652	Clearfield	40	1,706	03/16/2025 1409	03/17/2025 1835
1660664	Clearfield	1	1,693	03/16/2025 1432	03/17/2025 1845
1659908	Cambria	81	1,689	03/16/2025 1405	03/17/2025 1814
1658972	Indiana	31	1,678	03/16/2025 1332	03/17/2025 1730
1669012	Indiana	1	1,674	03/16/2025 1724	03/17/2025 2118
1662825	Wayne	1	1,672	03/16/2025 1600	03/17/2025 1952
1665927	Cambria	5	1,665	03/16/2025 1411	03/17/2025 1756
1661159	McKean	12	1,664	03/16/2025 1442	03/17/2025 1826
1662277	Bradford	2	1,658	03/16/2025 1524	03/17/2025 1902
1669042	Blair	1	1,653	03/16/2025 1407	03/17/2025 1740
1662253	Centre	25	1,652	03/16/2025 1822	03/17/2025 2154
1658270	Susquehanna	12	1,640	03/16/2025 1007	03/17/2025 1327
1662469	Tioga	163	1,640	03/16/2025 1534	03/17/2025 1854
1668871	Jefferson	115	1,635	03/16/2025 1347	03/17/2025 1702
1660333	Somerset	25	1,634	03/16/2025 1423	03/17/2025 1737
1669068	McKean	4	1,630	03/16/2025 1520	03/17/2025 1830
1666016	Clearfield	3	1,623	03/17/2025 0942	03/18/2025 1245
1662763	Tioga	69	1,622	03/16/2025 1557	03/17/2025 1859
1662812	Tioga	240	1,622	03/16/2025 1557	03/17/2025 1859
1662811	Tioga	329	1,622	03/16/2025 1557	03/17/2025 1859
1662447	Tioga	40	1,620	03/16/2025 1533	03/17/2025 1833
1659240	Jefferson	988	1,614	03/16/2025 1350	03/17/2025 1644
1661993	McKean	1	1,611	03/16/2025 1509	03/17/2025 1800
1668491	Bradford	22	1,611	03/16/2025 1549	03/17/2025 1840

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1666436	Cambria	10	1,607	03/16/2025 1411	03/17/2025 1658
1666995	Cambria	5	1,607	03/16/2025 1425	03/17/2025 1712
1669300	Huntingdon	1	1,601	03/17/2025 1037	03/18/2025 1318
1662374	Bradford	59	1,591	03/16/2025 1529	03/17/2025 1800
1668921	Jefferson	1	1,581	03/16/2025 1347	03/17/2025 1608
1667082	McKean	45	1,572	03/16/2025 1520	03/17/2025 1732
1658652	Clearfield	95	1,564	03/16/2025 1409	03/17/2025 1613
1665534	Indiana	39	1,558	03/16/2025 1347	03/17/2025 1545
1666450	Cambria	49	1,555	03/16/2025 1409	03/17/2025 1604
1662496	Tioga	21	1,554	03/16/2025 1536	03/17/2025 1730
1666450	Cambria	1	1,551	03/16/2025 1409	03/17/2025 1600
1662650	Tioga	21	1,549	03/16/2025 1547	03/17/2025 1736
1666305	Potter	176	1,548	03/16/2025 1442	03/17/2025 1630
1666005	Bradford	3	1,546	03/16/2025 1249	03/17/2025 1435
1662318	Huntingdon	2	1,543	03/16/2025 1527	03/17/2025 1710
1667032	Susquehanna	11	1,543	03/16/2025 1412	03/17/2025 1555
1666005	Bradford	4	1,542	03/16/2025 1249	03/17/2025 1431
1661871	Susquehanna	10	1,540	03/16/2025 1503	03/17/2025 1643
1661078	Huntingdon	63	1,539	03/16/2025 1439	03/17/2025 1618
1660047	Susquehanna	1	1,538	03/16/2025 1412	03/17/2025 1550
1666304	Potter	279	1,537	03/16/2025 1442	03/17/2025 1619
1663492	Wayne	37	1,530	03/16/2025 1644	03/17/2025 1814
1667320	Bradford	1	1,522	03/17/2025 0844	03/18/2025 1006
1658526	Somerset	11	1,520	03/16/2025 1201	03/17/2025 1321
1659869	Cambria	20	1,517	03/16/2025 1404	03/17/2025 1521
1661337	Susquehanna	15	1,515	03/16/2025 1446	03/17/2025 1601
1659647	Somerset	1	1,512	03/16/2025 1358	03/17/2025 1510
1667350	Susquehanna	5	1,509	03/16/2025 1227	03/17/2025 1336
1669039	Lycoming	36	1,509	03/16/2025 1910	03/17/2025 2019
1666371	Blair	6	1,509	03/16/2025 1441	03/17/2025 1550
1668218	Indiana	25	1,509	03/16/2025 1350	03/17/2025 1459
1660650	Cambria	3	1,507	03/16/2025 1432	03/17/2025 1539
1662021	Somerset	1	1,503	03/16/2025 1510	03/17/2025 1613
1664494	Blair	11	1,491	03/16/2025 1429	03/17/2025 1520
1661618	McKean	107	1,490	03/16/2025 1451	03/17/2025 1541
1662732	Somerset	6	1,487	03/16/2025 1555	03/17/2025 1642
1670257	Blair	1	1,487	03/18/2025 1051	03/19/2025 1138
1664370	Susquehanna	193	1,485	03/16/2025 1227	03/17/2025 1312

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1660663	McKean	24	1,483	03/16/2025 1432	03/17/2025 1515
1666520	Blair	9	1,481	03/16/2025 1439	03/17/2025 1520
1659284	Jefferson	307	1,479	03/16/2025 1347	03/17/2025 1426
1659228	Jefferson	904	1,477	03/16/2025 1347	03/17/2025 1424
1666041	Bradford	2	1,475	03/16/2025 1629	03/17/2025 1704
1661318	Indiana	474	1,472	03/16/2025 1347	03/17/2025 1419
1661028	Blair	12	1,471	03/16/2025 1439	03/17/2025 1510
1667195	Cambria	1	1,465	03/16/2025 1457	03/17/2025 1522
1659222	Jefferson	378	1,454	03/16/2025 1347	03/17/2025 1401
1665537	Indiana	3	1,451	03/16/2025 2124	03/17/2025 2135
1669247	Blair	20	1,450	03/17/2025 1401	03/18/2025 1411
1660421	Clearfield	11	1,447	03/16/2025 1427	03/17/2025 1434
1659620	Somerset	2	1,446	03/16/2025 1329	03/17/2025 1335
1663198	McKean	2	1,444	03/16/2025 1620	03/17/2025 1624
1659256	Jefferson	33	1,444	03/16/2025 1347	03/17/2025 1351
1659133	Wyoming	110	1,434	03/16/2025 1609	03/17/2025 1603
1662252	Potter	96	1,434	03/16/2025 1523	03/17/2025 1517
1666005	Bradford	3	1,433	03/16/2025 1249	03/17/2025 1242
1659229	Jefferson	558	1,423	03/16/2025 1347	03/17/2025 1330
1662252	Potter	35	1,420	03/16/2025 1523	03/17/2025 1503
1658204	Warren	1	1,413	03/16/2025 0927	03/17/2025 0900
1665132	Bradford	5	1,411	03/16/2025 1956	03/17/2025 1927
1667978	Clearfield	74	1,410	03/16/2025 1427	03/17/2025 1357
1667081	Clearfield	1	1,406	03/16/2025 1922	03/17/2025 1848
1659256	Jefferson	427	1,404	03/16/2025 1347	03/17/2025 1311
1665265	Potter	41	1,397	03/16/2025 1524	03/17/2025 1441
1664604	Clearfield	18	1,388	03/16/2025 1846	03/17/2025 1754
1659256	Jefferson	391	1,387	03/16/2025 1347	03/17/2025 1254
1659235	Indiana	196	1,382	03/16/2025 1347	03/17/2025 1249
1659256	Jefferson	354	1,381	03/16/2025 1347	03/17/2025 1248
1665221	Clearfield	3	1,379	03/16/2025 2011	03/17/2025 1910
1663683	Somerset	2	1,378	03/16/2025 1406	03/17/2025 1304
1659996	Cambria	1	1,377	03/16/2025 1409	03/17/2025 1306
1659996	Cambria	1	1,377	03/16/2025 1409	03/17/2025 1306
1659252	Indiana	117	1,372	03/16/2025 1347	03/17/2025 1239
1667931	Somerset	32	1,368	03/16/2025 1239	03/17/2025 1127
1664068	Cambria	1	1,360	03/16/2025 1746	03/17/2025 1626
1661986	Indiana	3	1,356	03/16/2025 1508	03/17/2025 1344

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1665406	Wyoming	13	1,352	03/16/2025 1633	03/17/2025 1505
1660538	Susquehanna	10	1,345	03/16/2025 1430	03/17/2025 1255
1660788	Blair	10	1,341	03/16/2025 1434	03/17/2025 1255
1668207	Bradford	1	1,340	03/16/2025 1650	03/17/2025 1510
1658980	Wyoming	310	1,340	03/16/2025 1333	03/17/2025 1153
1664992	Cambria	5	1,337	03/16/2025 1339	03/17/2025 1156
1659235	Indiana	54	1,333	03/16/2025 1347	03/17/2025 1200
1659543	Tioga	272	1,333	03/16/2025 1549	03/17/2025 1402
1667958	Clearfield	165	1,333	03/16/2025 1427	03/17/2025 1240
1664751	Lycoming	12	1,330	03/16/2025 1910	03/17/2025 1720
1660090	Clearfield	32	1,328	03/16/2025 1413	03/17/2025 1221
1669069	Somerset	2	1,316	03/17/2025 1736	03/18/2025 1532
1665165	Wyoming	9	1,314	03/16/2025 1609	03/17/2025 1403
1662697	Tioga	120	1,314	03/16/2025 1549	03/17/2025 1343
1666708	Bradford	17	1,312	03/16/2025 1448	03/17/2025 1240
1665221	Clearfield	5	1,309	03/16/2025 2011	03/17/2025 1800
1662697	Tioga	89	1,307	03/16/2025 1549	03/17/2025 1336
1667924	Bradford	69	1,301	03/16/2025 1558	03/17/2025 1339
1660323	Cambria	1	1,297	03/16/2025 1423	03/17/2025 1200
1659252	Indiana	325	1,296	03/16/2025 1347	03/17/2025 1123
1666911	Tioga	95	1,293	03/16/2025 1627	03/17/2025 1400
1659252	Indiana	18	1,292	03/16/2025 1347	03/17/2025 1119
1663313	Somerset	1	1,290	03/16/2025 1333	03/17/2025 1103
1665198	Bradford	2	1,289	03/16/2025 2004	03/17/2025 1733
1661832	Wyoming	21	1,281	03/16/2025 1501	03/17/2025 1222
1663525	Cambria	2	1,278	03/16/2025 1455	03/17/2025 1213
1666023	Cambria	1	1,266	03/16/2025 2330	03/17/2025 2036
1659252	Indiana	161	1,260	03/16/2025 1347	03/17/2025 1047
1663215	Bradford	11	1,260	03/16/2025 1356	03/17/2025 1056
1667958	Clearfield	199	1,256	03/16/2025 1427	03/17/2025 1123
1666005	Bradford	41	1,254	03/16/2025 1249	03/17/2025 0943
1664541	Clearfield	14	1,252	03/16/2025 1405	03/17/2025 1057
1659433	Jefferson	8	1,251	03/16/2025 1352	03/17/2025 1043
1659795	Somerset	42	1,246	03/16/2025 1402	03/17/2025 1048
1663708	Tioga	3	1,245	03/16/2025 1707	03/17/2025 1352
1662466	Somerset	28	1,243	03/16/2025 1534	03/17/2025 1217
1659252	Indiana	108	1,230	03/16/2025 1347	03/17/2025 1017
1664372	Susquehanna	4	1,224	03/16/2025 1506	03/17/2025 1130

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1666200	Blair	8	1,223	03/16/2025 1457	03/17/2025 1120
1664090	Cambria	4	1,221	03/16/2025 1747	03/17/2025 1408
1673131	Clearfield	2	1,219	03/19/2025 1409	03/20/2025 1028
1666051	Tioga	2	1,218	03/17/2025 1428	03/18/2025 1046
1661490	Bradford	19	1,214	03/16/2025 1448	03/17/2025 1102
1658514	McKean	15	1,214	03/16/2025 1153	03/17/2025 0807
1664856	Somerset	1	1,209	03/16/2025 1925	03/17/2025 1534
1659433	Jefferson	409	1,207	03/16/2025 1352	03/17/2025 0959
1662697	Tioga	159	1,201	03/16/2025 1549	03/17/2025 1150
1669151	McKean	6	1,199	03/17/2025 1807	03/18/2025 1406
1659930	Cambria	12	1,198	03/16/2025 1347	03/17/2025 0945
1660986	Blair	273	1,191	03/16/2025 1438	03/17/2025 1029
1667190	Susquehanna	66	1,185	03/16/2025 1456	03/17/2025 1041
1670901	Clearfield	3	1,180	03/18/2025 1649	03/19/2025 1229
1659433	Jefferson	149	1,174	03/16/2025 1352	03/17/2025 0926
1659433	Jefferson	26	1,163	03/16/2025 1352	03/17/2025 0915
1662498	Susquehanna	33	1,162	03/16/2025 1536	03/17/2025 1058
1662695	Susquehanna	17	1,154	03/16/2025 1551	03/17/2025 1105
1671292	Cambria	7	1,151	03/19/2025 0014	03/19/2025 1925
1665390	Clearfield	18	1,151	03/16/2025 2055	03/17/2025 1606
1661078	Huntingdon	96	1,146	03/16/2025 1439	03/17/2025 0945
1666527	McKean	36	1,144	03/16/2025 2347	03/17/2025 1851
1659479	Somerset	67	1,140	03/16/2025 1355	03/17/2025 0855
1664791	Sullivan	2	1,133	03/16/2025 1917	03/17/2025 1410
1659941	Bradford	4	1,129	03/16/2025 1407	03/17/2025 0856
1663205	Wyoming	1	1,124	03/16/2025 1621	03/17/2025 1105
1662246	Cambria	1	1,114	03/16/2025 1522	03/17/2025 0956
1659433	Jefferson	27	1,108	03/16/2025 1352	03/17/2025 0820
1662138	McKean	9	1,104	03/16/2025 1516	03/17/2025 0940
1665094	Tioga	9	1,104	03/16/2025 1951	03/17/2025 1415
1661344	Clearfield	7	1,101	03/16/2025 1446	03/17/2025 0907
1660362	Bradford	2	1,096	03/16/2025 1424	03/17/2025 0840
1662252	Potter	31	1,094	03/16/2025 2103	03/17/2025 1517
1660489	Indiana	1	1,087	03/16/2025 1428	03/17/2025 0835
1662252	Potter	8	1,080	03/16/2025 2103	03/17/2025 1503
1660379	Susquehanna	22	1,075	03/16/2025 1425	03/17/2025 0820
1665379	Susquehanna	7	1,067	03/16/2025 2050	03/17/2025 1437
1668160	Wayne	25	1,065	03/16/2025 1849	03/17/2025 1234

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1659946	Clearfield	37	1,065	03/16/2025 1407	03/17/2025 0752
1672691	Indiana	1	1,039	03/19/2025 1854	03/20/2025 1213
1669167	Blair	1	1,033	03/17/2025 1819	03/18/2025 1132
1669283	Somerset	2	978	03/17/2025 1907	03/18/2025 1125
1663429	Tioga	3	978	03/16/2025 1636	03/17/2025 0854
1664824	Susquehanna	1	976	03/16/2025 1918	03/17/2025 1134
1659660	Indiana	11	972	03/16/2025 1358	03/17/2025 0610
1658467	Erie	5	968	03/16/2025 0851	03/17/2025 0059
1663351	Tioga	1	963	03/16/2025 1630	03/17/2025 0833
1672650	Clearfield	1	960	03/19/2025 1813	03/20/2025 1013
1669681	Franklin	1	951	03/17/2025 1629	03/18/2025 0820
1663977	Venango	3	950	03/16/2025 1251	03/17/2025 0441
1665182	Somerset	25	942	03/16/2025 1343	03/17/2025 0525
1657946	Warren	1	941	03/16/2025 0854	03/17/2025 0035
1659251	Crawford	1	929	03/16/2025 1340	03/17/2025 0509
1664383	Wyoming	24	923	03/16/2025 1814	03/17/2025 0937
1666694	Indiana	2	904	03/16/2025 1411	03/17/2025 0515
1667341	Tioga	2	884	03/17/2025 0846	03/17/2025 2330
1666733	Blair	1	880	03/16/2025 1435	03/17/2025 0515
1669517	Indiana	12	870	03/17/2025 2147	03/18/2025 1217
1663806	Bradford	17	866	03/16/2025 1711	03/17/2025 0737
1666920	Bradford	36	857	03/16/2025 1743	03/17/2025 0800
1661812	McKean	1	853	03/16/2025 1500	03/17/2025 0513
1661030	Blair	21	851	03/16/2025 1439	03/17/2025 0450
1659251	Crawford	43	839	03/16/2025 1340	03/17/2025 0339
1666442	Warren	28	818	03/16/2025 1249	03/17/2025 0227
1659529	Cambria	13	810	03/16/2025 1355	03/17/2025 0325
1661769	Wyoming	7	804	03/16/2025 1457	03/17/2025 0421
1661213	Clearfield	122	797	03/16/2025 1427	03/17/2025 0344
1662081	Somerset	2	789	03/16/2025 1418	03/17/2025 0327
1669525	Indiana	4	780	03/17/2025 1050	03/17/2025 2350
1660169	Bradford	14	776	03/16/2025 1417	03/17/2025 0313
1661217	Cambria	8	768	03/16/2025 1444	03/17/2025 0332
1659046	Forest	1	758	03/16/2025 1337	03/17/2025 0215
1669172	McKean	2	756	03/17/2025 0559	03/17/2025 1835
1658927	Indiana	21	747	03/16/2025 1321	03/17/2025 0148
1667099	Cambria	7	730	03/17/2025 0745	03/17/2025 1955
1666868	Jefferson	3	712	03/17/2025 0631	03/17/2025 1823

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1666868	Jefferson	3	712	03/17/2025 0631	03/17/2025 1823
1659965	Clearfield	14	709	03/16/2025 1408	03/17/2025 0157
1668543	Bradford	25	708	03/17/2025 0352	03/17/2025 1540
1659022	Forest	54	707	03/16/2025 1337	03/17/2025 0124
1661120	Clearfield	77	703	03/16/2025 1441	03/17/2025 0224
1660655	Erie	149	690	03/16/2025 1426	03/17/2025 0156
1662018	Bradford	2	688	03/16/2025 1510	03/17/2025 0238
1660810	Huntingdon	1066	684	03/16/2025 1435	03/17/2025 0159
1662707	Erie	3	684	03/16/2025 1132	03/16/2025 2256
1659996	Cambria	235	683	03/16/2025 1409	03/17/2025 0132
1662737	Tioga	50	680	03/17/2025 1135	03/17/2025 2255
1664040	Warren	1	675	03/16/2025 1744	03/17/2025 0459
1665778	Indiana	16	672	03/16/2025 1317	03/17/2025 0029
1662018	Bradford	2	672	03/16/2025 1510	03/17/2025 0222
1659266	Indiana	292	671	03/16/2025 1347	03/17/2025 0058
1659266	Indiana	334	669	03/16/2025 1347	03/17/2025 0056
1664396	Wyoming	1	668	03/16/2025 1815	03/17/2025 0523
1660655	Erie	15	667	03/16/2025 1426	03/17/2025 0133
1657829	Cambria	35	666	03/16/2025 0727	03/16/2025 1833
1657829	Cambria	4	666	03/16/2025 0727	03/16/2025 1833
1657829	Cambria	1	666	03/16/2025 0727	03/16/2025 1833
1657829	Cambria	5	666	03/16/2025 0727	03/16/2025 1833
1673178	Erie	57	663	03/20/2025 0126	03/20/2025 1229
1659421	Jefferson	229	660	03/16/2025 1347	03/17/2025 0047
1659271	Cambria	366	657	03/16/2025 1353	03/17/2025 0050
1659157	Jefferson	346	656	03/16/2025 1347	03/17/2025 0043
1658995	Indiana	103	650	03/16/2025 1335	03/17/2025 0025
1660198	Clearfield	442	645	03/16/2025 1417	03/17/2025 0102
1672101	Clearfield	20	636	03/19/2025 1407	03/20/2025 0043
1665475	Indiana	45	635	03/17/2025 1050	03/17/2025 2125
1662697	Tioga	350	632	03/16/2025 1549	03/17/2025 0221
1658967	Indiana	86	630	03/16/2025 1330	03/17/2025 0000
1665960	Tioga	62	621	03/16/2025 2302	03/17/2025 0923
1658689	Bradford	520	616	03/16/2025 1249	03/16/2025 2305
1658688	Bradford	576	616	03/16/2025 1249	03/16/2025 2305
1663976	Somerset	1	608	03/16/2025 1738	03/17/2025 0346
1666121	Jefferson	21	603	03/17/2025 0013	03/17/2025 1016
1663893	Indiana	11	602	03/16/2025 1343	03/16/2025 2345

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1666855	Sullivan	1	601	03/17/2025 0624	03/17/2025 1625
1657899	Erie	1	598	03/16/2025 0852	03/16/2025 1850
1662101	McKean	102	594	03/16/2025 1442	03/17/2025 0036
1661133	Potter	4	594	03/16/2025 1442	03/17/2025 0036
1657829	Cambria	9	593	03/16/2025 0840	03/16/2025 1833
1659251	Crawford	41	590	03/16/2025 1340	03/16/2025 2330
1666995	Cambria	12	589	03/17/2025 0723	03/17/2025 1712
1658335	McKean	8	587	03/16/2025 1104	03/16/2025 2051
1663313	Somerset	27	587	03/16/2025 1333	03/16/2025 2320
1665182	Somerset	43	585	03/16/2025 1940	03/17/2025 0525
1662630	Tioga	13	584	03/16/2025 1546	03/17/2025 0130
1659541	Cambria	5	580	03/16/2025 1356	03/16/2025 2336
1659077	Indiana	290	579	03/16/2025 1339	03/16/2025 2318
1667109	Susquehanna	1	571	03/17/2025 0744	03/17/2025 1715
1661770	Blair	10	568	03/16/2025 1457	03/17/2025 0025
1658854	Wayne	433	567	03/16/2025 1313	03/16/2025 2240
1660527	Blair	20	566	03/16/2025 1429	03/16/2025 2355
1659554	Cambria	35	566	03/16/2025 1356	03/16/2025 2322
1661355	Forest	154	561	03/16/2025 1407	03/16/2025 2328
1661355	Forest	5	559	03/16/2025 1407	03/16/2025 2326
1659997	Bedford	1	558	03/16/2025 1409	03/16/2025 2327
1667279	Clearfield	1	554	03/17/2025 0831	03/17/2025 1745
1659266	Indiana	59	554	03/16/2025 1347	03/16/2025 2301
1659926	Clearfield	49	552	03/16/2025 1406	03/16/2025 2318
1658678	Bradford	27	547	03/16/2025 1249	03/16/2025 2156
1659323	Cambria	22	538	03/16/2025 1352	03/16/2025 2250
1664458	Crawford	6	536	03/16/2025 1824	03/17/2025 0320
1659854	Clearfield	75	534	03/16/2025 1403	03/16/2025 2257
1659663	Cambria	25	534	03/16/2025 1358	03/16/2025 2252
1658652	Clearfield	286	528	03/16/2025 1409	03/16/2025 2257
1658957	Warren	11	526	03/16/2025 1059	03/16/2025 1945
1660036	Cambria	4	520	03/16/2025 1411	03/16/2025 2251
1668625	Tioga	2	518	03/17/2025 1452	03/17/2025 2330
1659068	Indiana	18	515	03/16/2025 1340	03/16/2025 2215
1659251	Crawford	181	515	03/16/2025 1340	03/16/2025 2215
1659238	Jefferson	375	512	03/16/2025 1347	03/16/2025 2219
1659218	Jefferson	254	512	03/16/2025 1347	03/16/2025 2219
1657880	Erie	9	510	03/16/2025 0740	03/16/2025 1610

Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1659937	Somerset	50	508	03/16/2025 1332	03/16/2025 2200
1658749	Sullivan	1	508	03/16/2025 1252	03/16/2025 2120
1668845	Clearfield	56	506	03/17/2025 1614	03/18/2025 0040
1669920	Somerset	1	505	03/18/2025 0659	03/18/2025 1524
1660178	Somerset	9	503	03/16/2025 1337	03/16/2025 2200
1662298	Cambria	125	490	03/16/2025 1804	03/17/2025 0214
1667161	Bradford	1	488	03/17/2025 0802	03/17/2025 1610
1660347	Clearfield	546	483	03/16/2025 1423	03/16/2025 2226
1657841	Blair	35	474	03/16/2025 0748	03/16/2025 1542
1661066	Susquehanna	44	470	03/16/2025 1440	03/16/2025 2230
1668998	Bradford	1	465	03/17/2025 1008	03/17/2025 1753
1660424	Clearfield	1	462	03/16/2025 1410	03/16/2025 2152
1668097	McKean	8	462	03/17/2025 0538	03/17/2025 1320
1659308	Clearfield	50	462	03/16/2025 1410	03/16/2025 2152
1671598	Clearfield	3	459	03/19/2025 0913	03/19/2025 1652
1665534	Indiana	368	450	03/16/2025 1347	03/16/2025 2117
1660074	Wyoming	21	449	03/16/2025 1413	03/16/2025 2142
1669582	Sullivan	269	447	03/17/2025 1957	03/18/2025 0324
1669343	Sullivan	1	447	03/17/2025 1957	03/18/2025 0324
1659319	Indiana	933	445	03/16/2025 1347	03/16/2025 2112
1660028	Blair	2	445	03/16/2025 1411	03/16/2025 2136
1660994	Blair	1	442	03/16/2025 1438	03/16/2025 2200
1662312	Mifflin	1	441	03/16/2025 1526	03/16/2025 2247
1666041	Bradford	70	441	03/16/2025 1629	03/16/2025 2350
1666041	Bradford	64	439	03/16/2025 1629	03/16/2025 2348
1660248	Wyoming	141	439	03/16/2025 1420	03/16/2025 2139
1660735	Clearfield	27	438	03/16/2025 1433	03/16/2025 2151
1670257	Blair	1	433	03/19/2025 0425	03/19/2025 1138
1664486	Clearfield	9	431	03/16/2025 1427	03/16/2025 2138
1659155	Jefferson	23	431	03/16/2025 1346	03/16/2025 2057
1672967	Bradford	2	425	03/20/2025 0512	03/20/2025 1217
1660886	Wyoming	233	413	03/16/2025 1436	03/16/2025 2129
1660760	Blair	998	412	03/16/2025 1433	03/16/2025 2125
1658580	Somerset	463	409	03/16/2025 1228	03/16/2025 1917
1662075	Somerset	25	409	03/16/2025 1341	03/16/2025 2030
1657153	Cambria	1	408	03/15/2025 1546	03/15/2025 2234
1663880	Erie	18	407	03/16/2025 1726	03/17/2025 0013
1664493	Jefferson	36	406	03/16/2025 1359	03/16/2025 2045


Penelec Rate District Storm Report

Order #	Approximate Location (County)	Total Number of Customers Affected	Duration of the Outage (minutes)	Initial Date and Time of the Outage	Restoration Date and Time
1659142	Bradford	14	405	03/16/2025 1345	03/16/2025 2030
1659136	Indiana	18	404	03/16/2025 1344	03/16/2025 2028
1664666	Susquehanna	4	402	03/16/2025 1616	03/16/2025 2258
1667095	Clearfield	1	400	03/16/2025 1539	03/16/2025 2219
1659626	Indiana	29	400	03/16/2025 1347	03/16/2025 2027
1668027	Clearfield	1	397	03/17/2025 1144	03/17/2025 1821
1657192	Somerset	1	397	03/15/2025 1546	03/15/2025 2223
1668079	McKean	1	397	03/17/2025 0538	03/17/2025 1215
1659018	Somerset	7	393	03/16/2025 1337	03/16/2025 2010
1658859	Blair	195	390	03/16/2025 1313	03/16/2025 1943
1658513	Warren	76	388	03/16/2025 1034	03/16/2025 1702
1669351	Cambria	1	383	03/17/2025 2002	03/18/2025 0225
1660760	Blair	413	381	03/16/2025 1433	03/16/2025 2054
1662707	Erie	23	380	03/16/2025 1132	03/16/2025 1752
1659018	Somerset	25	380	03/16/2025 1350	03/16/2025 2010
1665182	Somerset	19	378	03/16/2025 1343	03/16/2025 2001
1668672	Tioga	1	370	03/17/2025 1517	03/17/2025 2127
1659452	Cambria	1	363	03/16/2025 1354	03/16/2025 1957
1658944	Indiana	206	362	03/16/2025 1325	03/16/2025 1927
1659150	Somerset	33	362	03/16/2025 1345	03/16/2025 1947
1664378	Clearfield	214	362	03/16/2025 1405	03/16/2025 2007
1670098	Susquehanna	1	361	03/18/2025 0929	03/18/2025 1530
1659133	Wyoming	17	361	03/16/2025 1609	03/16/2025 2210
1659235	Indiana	95	360	03/16/2025 1347	03/16/2025 1947


**Attachment B: Wind, Tornado, and Precipitation Reports**

**Wind, Tornado, & Precipitation Reports:** Graphics 1 through 4 illustrate the maximum wind gusts in the Penelec service territory from March 15, 2025 through March 18, 2025. Graphic 5 depicts the locations of confirmed tornado touchdowns on Sunday, March 16, 2025. Graphic 6 illustrates the 24-Hour Total Precipitation in the Penelec service territory on Sunday, March 16, 2025. The graphics depict data from the National Oceanic and Atmospheric Administration (“NOAA”).


**Graphic 1: Maximum Wind Gusts – Saturday, March 15, 2025**

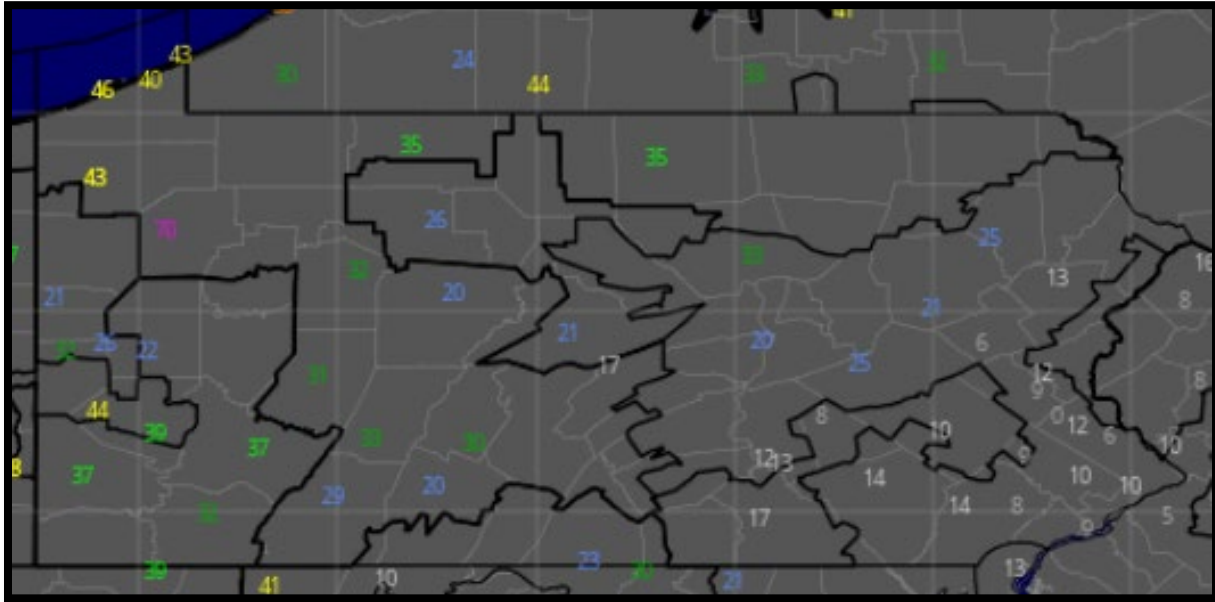


**Graphic 2: Maximum Wind Gusts – Sunday, March 16, 2025**

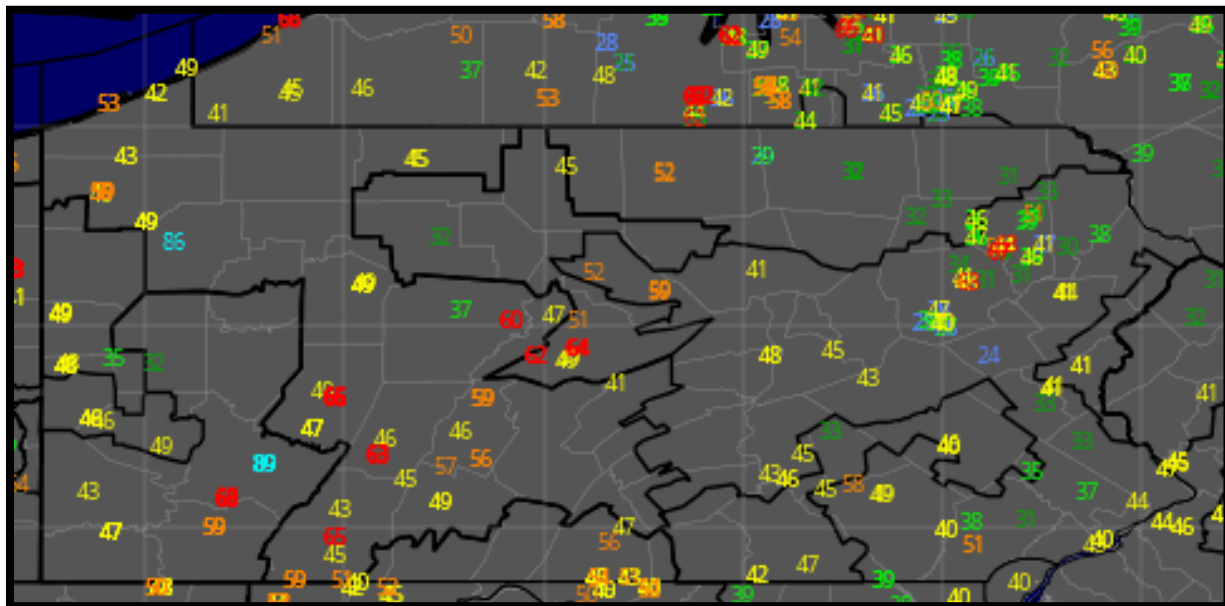


**Graphic 3: Maximum Wind Gusts – Monday, March 17, 2025**

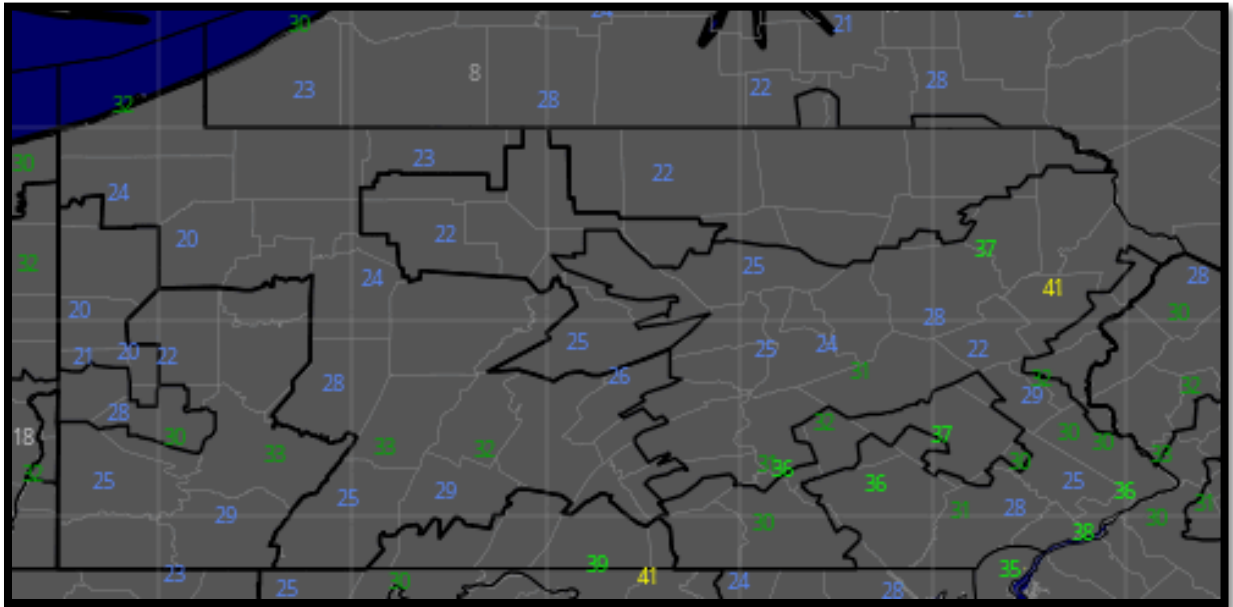


**Graphic 4: Maximum Wind Gusts – Tuesday, March 18, 2025**

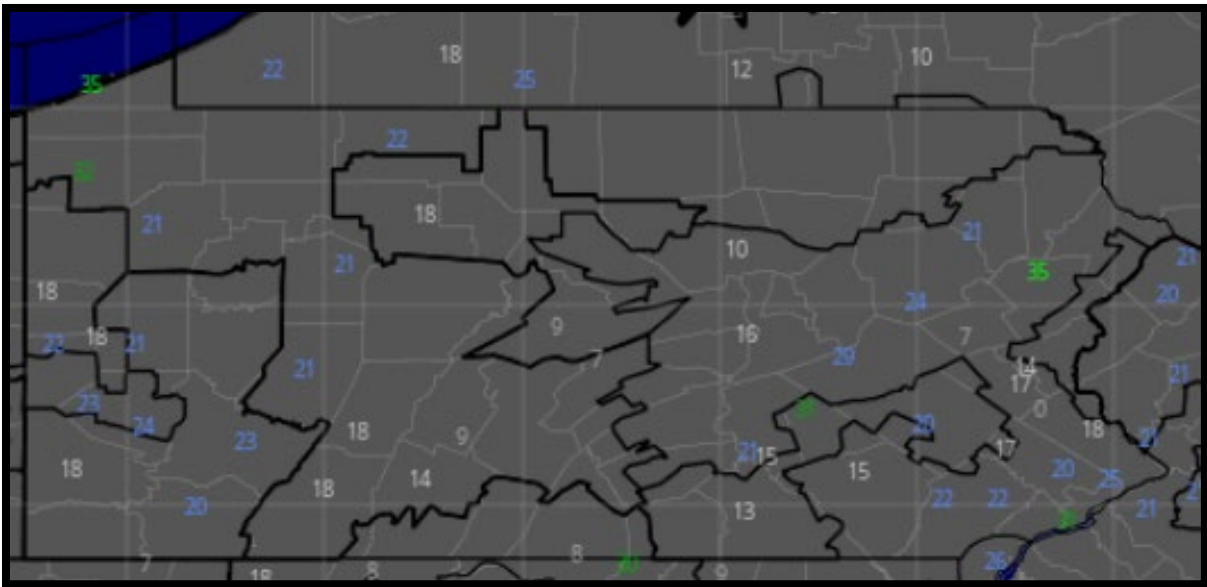


**Graphic 5: Tornado Touch Down Locations (“T”) – Sunday, March 16, 2025**

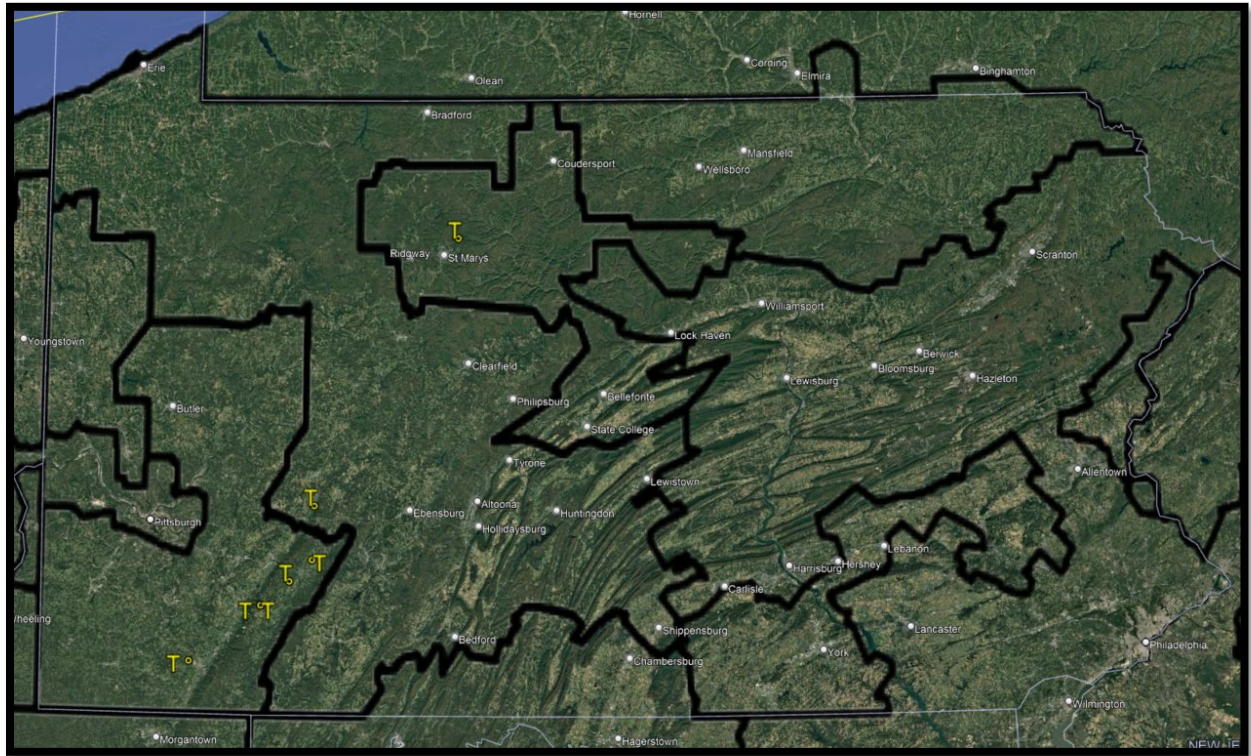


**Graphic 6: 24-Hour Total Precipitation – Sunday, March 16, 2025**

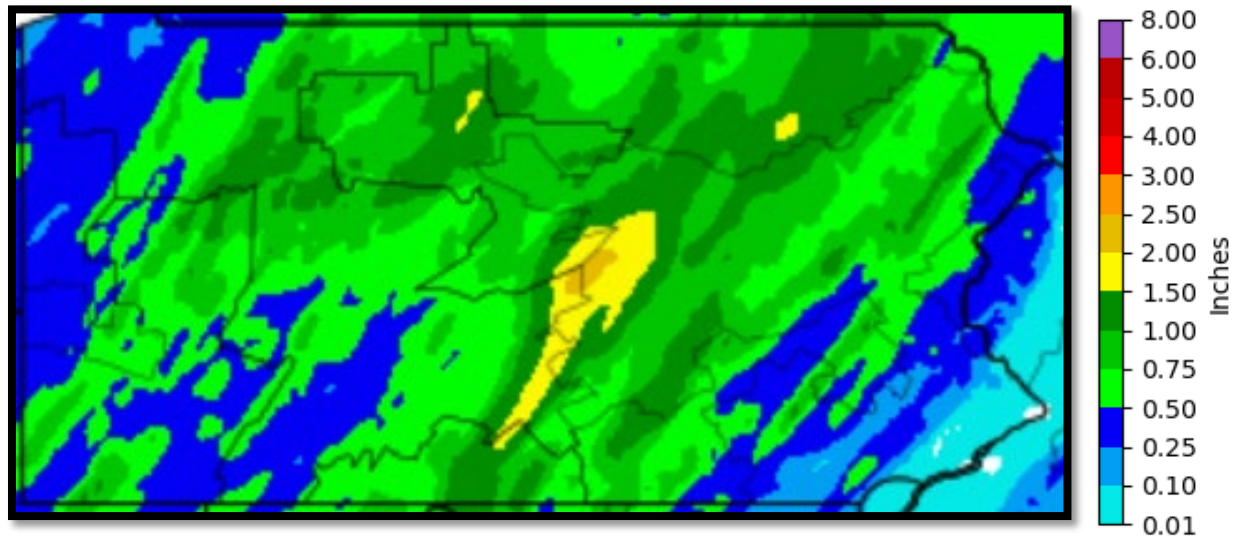


**Attachment C: Restoration Curve**

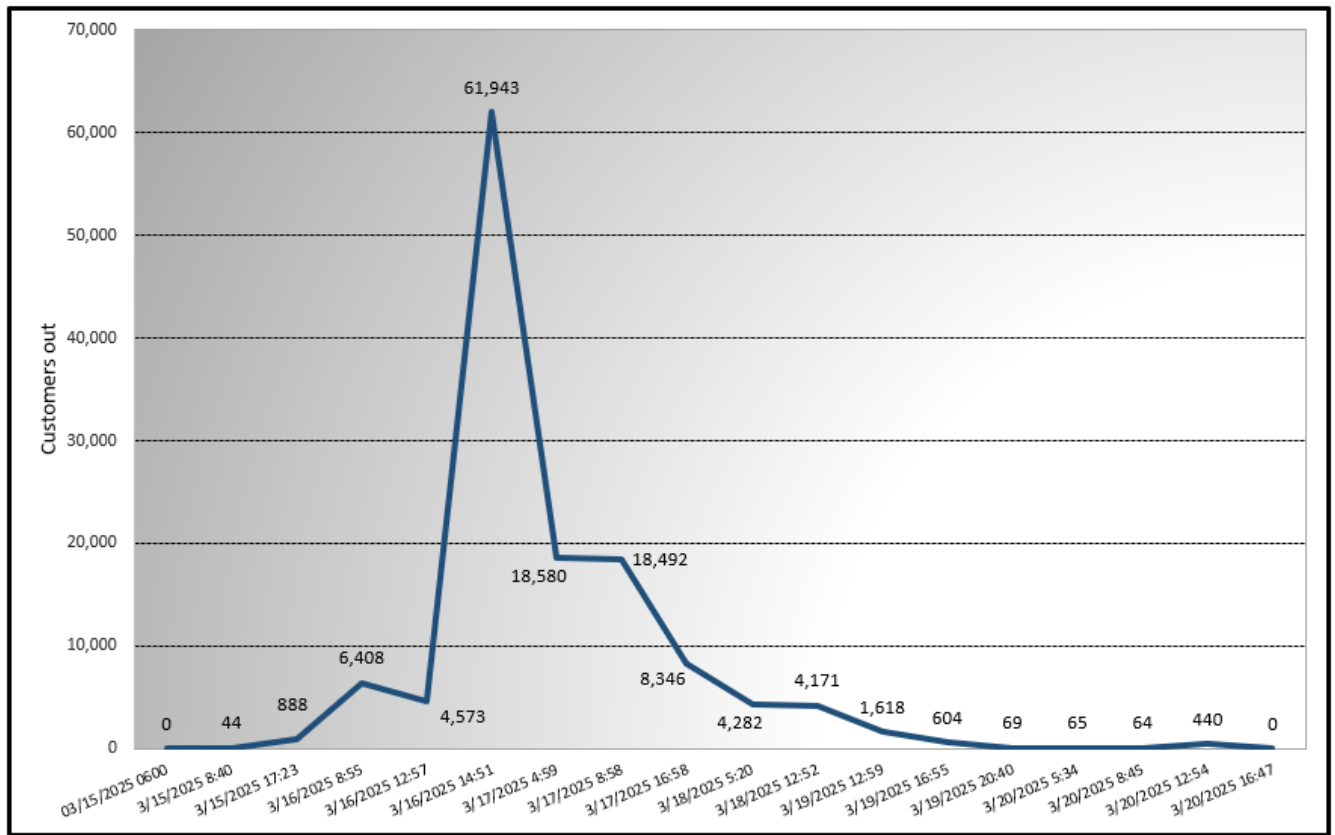

**Attachment D: Order Restoration Graphs**

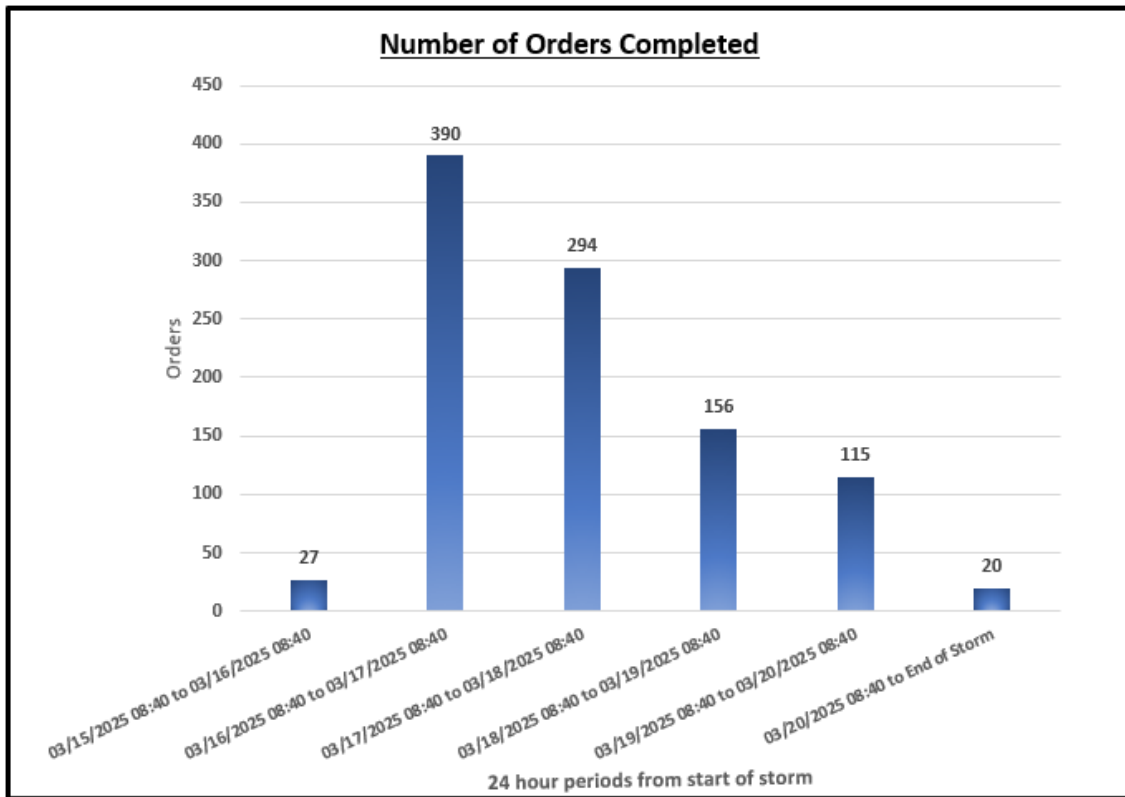

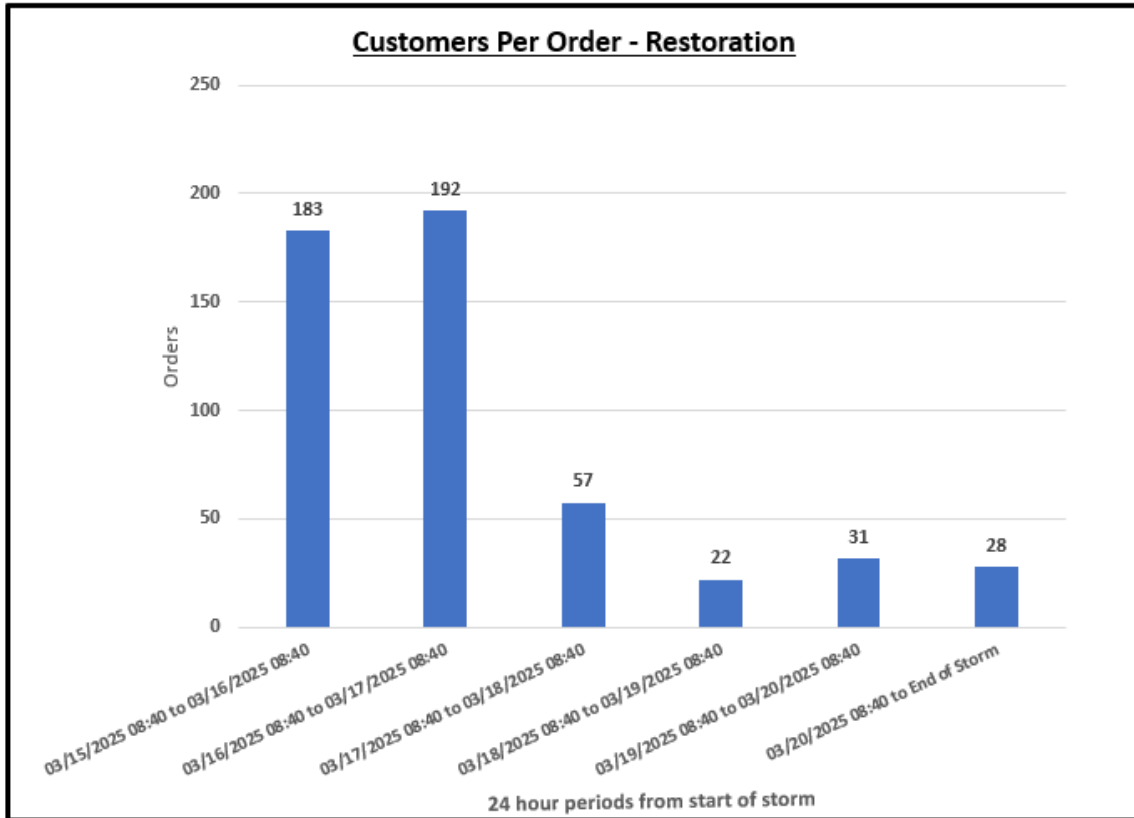


**Attachment E: Meteorologist Reports**

**Thursday, March 13, 2025 @ 0959**

**New Issuance:**


Non-thunderstorm gusts expected ahead of a frontal passage will be mixed with a threat of some cells forming in the same areas producing generally the same gust threat for two days until the front passes.

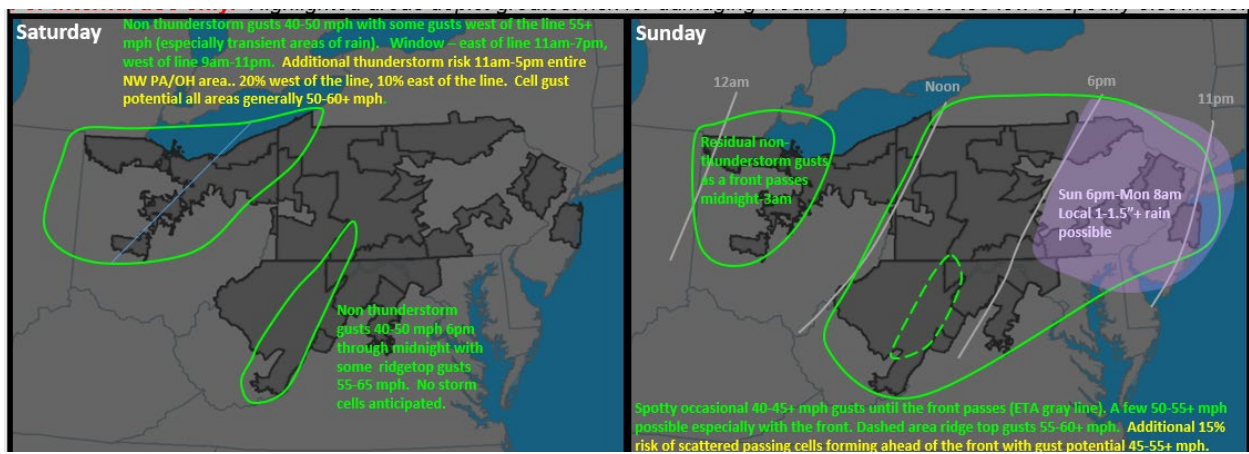

**Thursday, March 13, 2025 @ 1011**

**Update:**


Clarifying the start time for the Sun gusts in WV/PA/NJ is 11am (ending time still with the frontal passage). Also highlighted the Sat time window in WV.

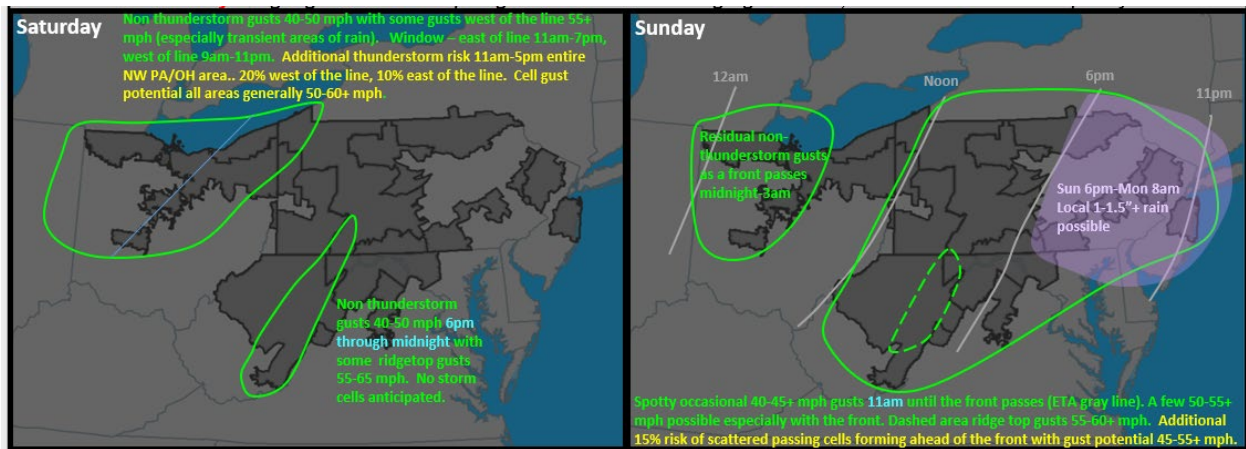

**Friday, March 14, 2025 @ 1001**

**Changes:**


1. Today - added mention in the top left panel (white box) of some nuisance 40 mph gusts this afternoon in west OH
2. Saturday – some timing changes (earlier start times)
3. Sunday – slowed the front’s ETA and had to change timing of gusts - also the heavy rain area in east FE shifted offshore but the slower frontal movement introduces a heavy rain threat in FE West.

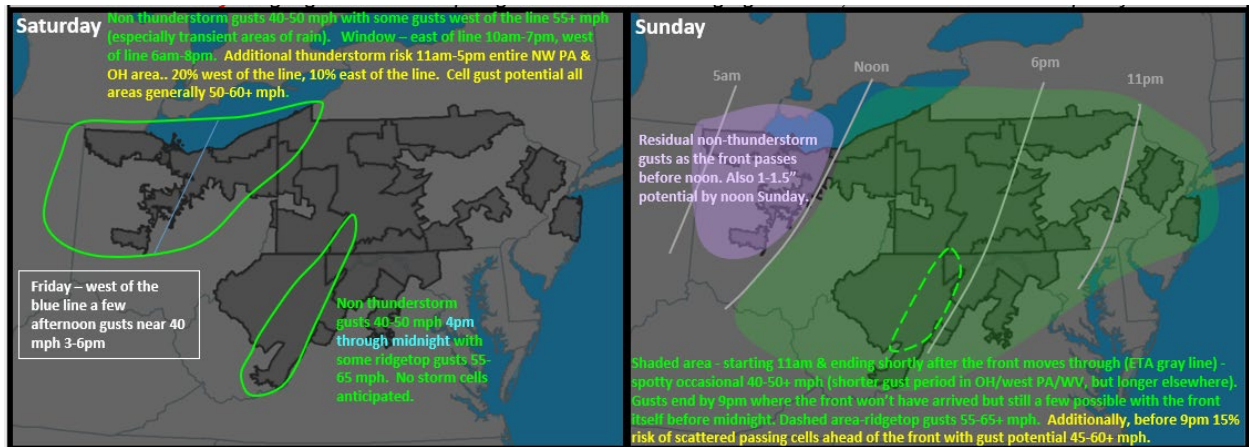

**Saturday, March 15, 2025 @ 0854**

**Changes:**

1. Today: Limited the damaging thunderstorm threat to extreme south and southwest FE in the evening. Still, non-thunderstorm gusts which will continue in the green areas anyway, some of which have the potential to peak over 55 mph, especially west of the blue line. Also, fine-tuned details of WV/MD/southwest PA gusts.
2. Sunday: Replaced the ETAs of the cold front instead with two potential separate rounds of heavy rain/cells. This is not etched in stone but there is good agreement in the different models for two separated bands. This would likely manifest itself an early runner (in white) well out ahead of the actual cold front which would weaken by late afternoon) then a separate afternoon evening runner (in yellow) more closely tied with the front itself. Regardless, both these potential bands are superimposed on the backdrop of general wind gusts (shaded in green) occurring most of the day. The ETAs aren't tight yet – still a slush of +/- 90 minutes.

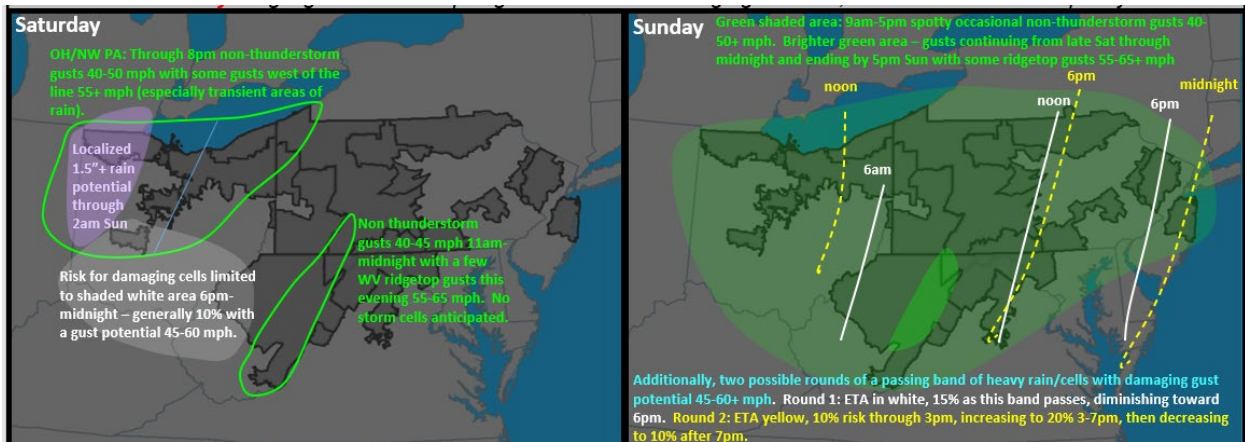


**Sunday, March 16, 2025 @ 0811**

**Changes:**

Today: Focused on a primary band of cells expected to form late this morning in east OH/WV then move east and is expected to stall and diminish as it reaches NJ. Its best potential for producing multiple heavy storms in a band noon-6pm (west central PA south through MD and WV and then into east central PA). Meanwhile – general non-thunderstorm gusts near 40 mph will continue through 6pm today – although spotty and infrequent – some might reach 50-60 mph.

We will continue to monitor and issue an update early this afternoon only if there is any significant deviation from this forecast, but otherwise this will be the final update on this event.

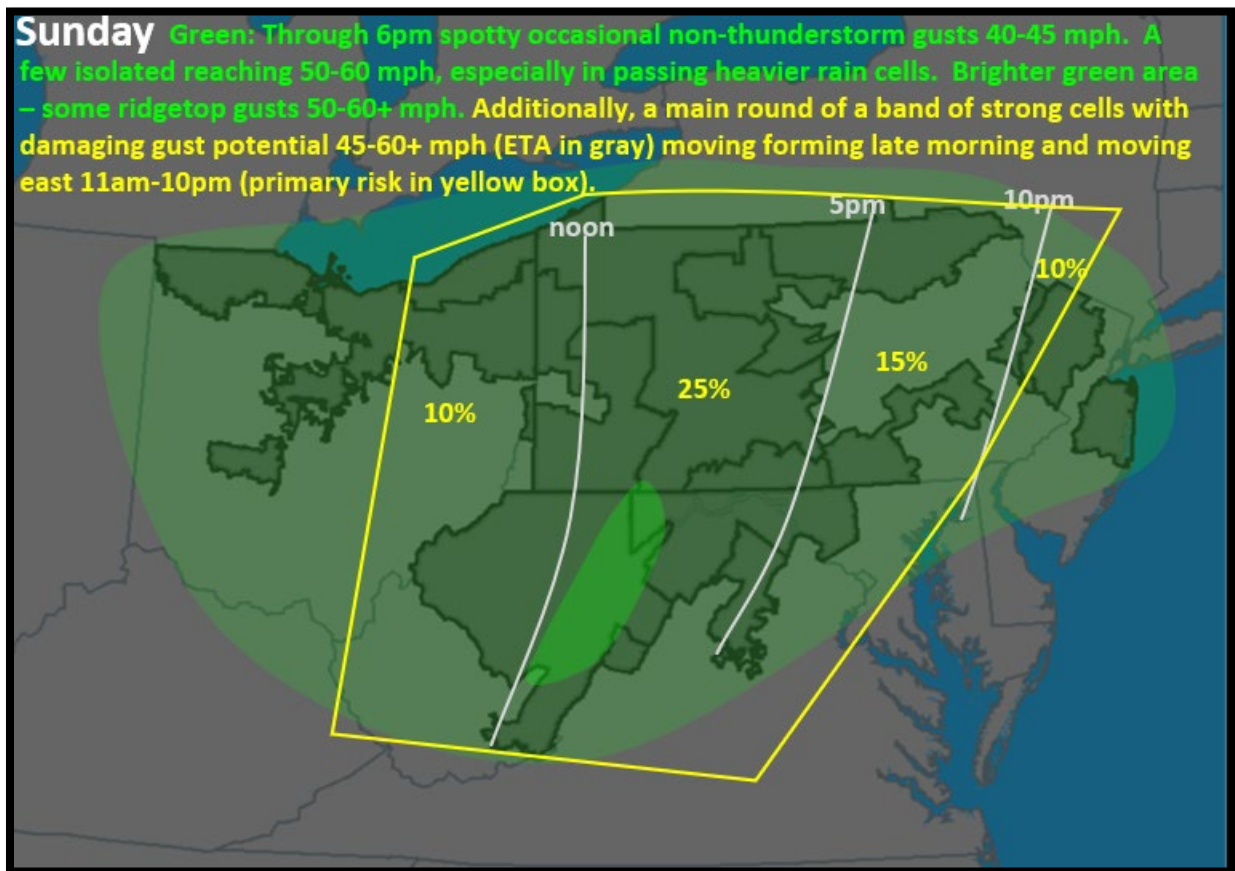

**Sunday, March 16, 2025 @ 1303**

**Changes:**

Updated to better time the primary band of cells moving east. There is some potential for the line to arrive an hour ahead of schedule in east PA and into NJ. Regardless, the damaging storm threat is over in any given area after the main band pushes through, although occasional non-thunderstorm gusts 40-45 mph still be possible through 6pm in the entire green-shaded area, especially with any sunshine.

