



COMMONWEALTH OF PENNSYLVANIA
PENNSYLVANIA PUBLIC UTILITY COMMISSION
COMMONWEALTH KEYSTONE BUILDING
400 NORTH STREET, HARRISBURG, PA 17120

BUREAU OF
INVESTIGATION
&
ENFORCEMENT

June 25, 2025

Via Hand-Delivery

Matthew Homsher, Secretary
Pennsylvania Public Utility Commission
Commonwealth Keystone Building
400 North Street
Harrisburg, PA 17120

RCVD PUC SEC BUR
JUN 25 2025 AM 10:16

Re: Pennsylvania Public Utility Commission,
Bureau of Investigation and Enforcement v.
UGI Utilities, Inc. - Gas Division
Docket No. C-2025-
I&E Formal Complaint (Damage Prevention)

Dear Secretary Homsher:

Enclosed for electronic filing please find the Formal Complaint of the Bureau of Investigation and Enforcement of the Pennsylvania Public Utility Commission in the above-referenced matter.

Copies are being served on the parties of record in accordance with the attached Certificate of Service. Should you have any questions, please do not hesitate to contact me.

Sincerely,

Colby B. Widdowson
Prosecutor
Bureau of Investigation and Enforcement
PA Attorney ID No. 326185
(717) 787-2139
cwiddowson@pa.gov

CW/ac
Enclosures

cc: Michael L. Swindler, Deputy Chief Prosecutor, I&E (*via email – mwindler@pa.gov*)
Robert Horensky, Manager, Safety Division (*via email – rhorensky@pa.gov*)
As per Certificate of Service

NOTICE

A. You must file an Answer within twenty (20) days of the date of service of this Complaint. The date of service is the date as indicated at the top of the Secretarial Letter. *See* 52 Pa. Code § 1.56(a). The Answer must raise all factual and legal arguments that you wish to claim in your defense, include the docket number of this Complaint, and be verified.

In Addition to filing your Answer with the Commission's Secretary, please electronically serve a copy on:

Colby B. Widdowson, Prosecutor
Pennsylvania Public Utility Commission
Bureau of Investigation and Enforcement
cwiddowson@pa.gov

B. If you fail to answer this Complaint within twenty (20) days, the Bureau of Investigation and Enforcement will request that the Commission issue an Order imposing the administrative penalty and other requested relief.

C. You may elect not to contest this Complaint by paying the administrative penalty within twenty (20) days and performing the corrective actions, if any, set forth in the requested relief. A certified check, cashier's check or money order should be payable to the "Commonwealth of Pennsylvania" and mailed to:

Matthew Homsher, Secretary
Pennsylvania Public Utility Commission
Commonwealth Keystone Building
400 North Street
Harrisburg, PA 17120

Your payment is an admission that you committed the alleged violations and an agreement to cease and desist from committing further violations. Upon receipt of your payment, the Complaint proceeding shall be closed.

D. If you file an Answer, which either admits or fails to deny the allegations of the Complaint, the Bureau of Investigation and Enforcement will request the Commission to issue an Order imposing the administrative penalty and granting the requested relief as set forth in the Complaint.

E. If you file an Answer which contests the Complaint, the matter will proceed before the assigned presiding Administrative Law Judge for hearing and decision. The Judge is not bound by the penalty set forth in the Complaint and may impose additional and/or alternative penalties as appropriate.

F. If you are a corporation, you must be represented by legal counsel. 52 Pa. Code § 1.21.

G. Alternative formats of this material are available for persons with disabilities by contacting the Commission's ADA Coordinator at (717) 787-8714.

**BEFORE THE
PENNSYLVANIA PUBLIC UTILITY COMMISSION**

Pennsylvania Public Utility Commission, :
Bureau of Investigation and Enforcement, :
Complainant :

v. :

UGI Utilities, Inc. - Gas Division, :
Respondent :

Docket No. C-2025-

RECEIVED

JUN 25 2025

FORMAL COMPLAINT

PA PUBLIC UTILITY COMMISSION
SECRETARY'S BUREAU

NOW COMES the Bureau of Investigation and Enforcement (“I&E”) of the Pennsylvania Public Utility Commission, by its prosecuting attorneys, pursuant to Section 182 of the Underground Utility Line Protection Law (“UULPL” or “PA One Call Law”), Act of October 29, 2024, P.L. 1106, No. 127, 73 P.S. § 182.8(c)(2), and files this Formal Complaint (“Complaint”) against UGI Utilities, Inc. - Gas Division (“UGI” or “Respondent”) alleging violations of the PA One Call Law in connection with a strike on a UGI gas line by an excavator, Pronto Plumbing and Drains Inc., on December 13, 2022, at 3204 Crest Road, Harrisburg, Dauphin County, Pennsylvania. In support of its Complaint, I&E respectfully avers as follows:

I. COMMISSION JURISDICTION AND AUTHORITY

1. The Pennsylvania Public Utility Commission (“Commission” or “PUC”), with a mailing address of the Commonwealth Keystone Building, 400 North Street, Harrisburg, PA 17120, is a duly constituted agency of the Commonwealth of Pennsylvania empowered to regulate, *inter alia*, excavators, within the Commonwealth pursuant to the PA One Call Law, Act of October 29, 2024, P.L. 1106, No. 127, 73 P.S. §§ 176 *et seq.*

2. Complainant is the Commission's Bureau of Investigation and Enforcement, which is the bureau established to take enforcement actions against public utilities and other entities subject to the Commission's jurisdiction pursuant to 66 Pa.C.S. § 308.2(a)(11). *See also Implementation of Act 129 of 2008; Organization of Bureaus and Offices*, Docket No. M-2008-2071852 (August 11, 2011) (delegating authority to initiate proceedings that are prosecutory in nature to I&E).

3. Complainant's prosecuting attorney is as follows:

Colby B. Widdowson
Prosecutor
cwiddowson@pa.gov
(717) 787-2139

Pennsylvania Public Utility Commission
Bureau of Investigation and Enforcement
Commonwealth Keystone Building
400 North Street
Harrisburg, PA 17120

4. Respondent is UGI Utilities, Inc. - Gas Division with a principal place of business and mailing address of 1 UGI Drive, Denver, PA 17517.

5. Respondent is a "facility owner" as that term is defined in Section 176 of the PA One Call Law, 73 P.S. § 176.¹

6. Respondent is a "public utility" as that term is defined at 66 Pa.C.S. § 102, as it is engaged in providing public utility service as a natural gas distribution company ("NGDC") to the public for compensation.

7. Section 177 of the PA One Call Law, 73 P.S. § 177, imposes duties and responsibilities upon facility owners.

¹ "Facility owner" is defined as a public utility or agency, political subdivision, municipality, authority, rural electric cooperative or other person or entity who or which owns or operates a line.

8. Respondent, as a facility owner, is subject to the authority of this Commission pursuant to Section 182.10 of the PA One Call Law, 73 P.S. § 182.10, which requires facility owners to comply with the PA One Call Law. 73 P.S. § 182.10.

9. Section 182.8(c)-(d) and Section 182.10 of the PA One Call Law, 73 P.S. §§ 182.8(c)-(d) and 182.10, authorize the Commission to, *inter alia*, hear and determine complaints against facility owners for violations of the PA One Call Law and to enforce the provisions of the PA One Call Law. 73 P.S. §§ 182.8(c)-(d) and 182.10.

10. Section 182.8(c)(2) of the PA One Call Law, 73 P.S. § 182.8(c)(2), authorizes the Commission's prosecutor staff to bring a formal complaint against entities subject to the PA One Call Law. 73 P.S. § 182.8(c)(2).

11. Section 182.10 of the PA One Call Law, 73 P.S. § 182.10(b)(1)(i)-(ii), authorizes the Commission to impose administrative penalties on any person or corporation, subject to the PA One Call Law, who violates any provisions of the PA One Call Law or any regulation or order issued thereunder governing underground utility lines, of up to \$2,500 per violation or if the violation results in injury, death, or property damage of \$25,000 dollars or more an administrative penalty not to exceed \$50,000. 73 P.S. § 182.10(b)(1)(i)-(ii).

12. Pursuant to the provisions of the applicable Commonwealth statutes and regulations, the Commission has jurisdiction over the subject matter of this Complaint and the actions of Respondent related thereto.

II. FACTUAL BACKGROUND

13. On December 12, 2022, Pronto Plumbing and Drains Inc. ("Pronto Plumbing") provided the homeowner of 3204 Crest Road, Harrisburg, PA with a written estimate for the excavation and replacement of an outside sewer line.

14. On December 12, 2022, at 1:15 p.m., Pronto Plumbing placed a locate request, ticket number 20223461851, ("Locate Ticket") to the Pennsylvania Once Call System for 3204 Crest Road. See attached I&E Exhibit 1.

15. The Locate Ticket indicated that the excavation was an "emergency" and Respondent would be performing an emergency excavation the following day, December 13, 2022 at 8:00 a.m., to repair a sewer line because "sewage is backing up into the basement" of 3204 Crest Road. See attached I&E Exhibit 1.

16. The One Call Law defines "emergency" as "sudden or unforeseen occurrence involving a clear and immediate danger to life, property or the environment, including, but not limited to, serious breaks or defects in a facility owner's lines." 73 P.S. § 176.

17. A facility owner is required to respond to all notices through the One Call System and the response "shall be made not later than the end of the second business day following receipt of the notification by the One Call System, excluding the business day upon which the notification is received, or not later than the day prior to the lawful start date of excavation if the excavator specifies a later date or, in the case of an emergency, to respond through the One Call System as soon as practicable following receipt of notification of the emergency by the One Call System." 73 P.S. § 178(5)(v).

18. Respondent distributes natural gas via a service line to 3204 Crest Road.

19. Respondent received notification of the Locate Ticket from the PA One Call System via email.

20. Respondent responded to Pronto Plumbing's Locate Ticket on December 12, 2022, at 1:18 p.m., that there was a conflict with the proposed excavation because of nearby lines and direct contact by facility owner would follow. See attached I&E Exhibit 1.

21. The UGI Dispatcher responsible for assigning emergency locates, mistakenly assigned the emergency locate to an employee of Miller Pipeline, a contractor for Respondent.

22. Miller Pipeline does not perform emergency locates for Respondent.

23. The UGI Dispatcher overrode a warning that the contractor employee lacked the qualifications for the assigned emergency locate.

24. Overrides of warnings are logged in Respondent's system; however, the log was not checked by a supervisor.

25. Consequently, the emergency locate was misassigned and no one was aware of the misassignment.

26. Prior to Pronto Plumbing beginning excavation, Respondent did not contact Pronto Plumbing and did not mark its natural gas distribution pipeline at 3204 Crest Road.

27. At approximately 8:17 a.m. on December 13, 2022, Pronto Plumbing's excavation crew arrived at 3204 Crest Road to begin work on the sewer repair.

28. Pronto Plumbing's excavation crew, using a mechanical excavator, began excavation at 3204 Crest Road.

29. At some time between 8:17 a.m. and 9:02 a.m. on December 13, 2022, Pronto Plumbing's excavation crew struck and damaged Respondent's natural gas service line at 3204 Crest Road.

30. The damage to the natural gas service line created a large kink in the line, split the seam, and completely separated the service line from the house. See attached I&E Exhibit 2.

31. The damage to the natural gas service line resulted in a rupture of the line and a natural gas leak.

32. At 9:02 a.m. on December 13, 2022, Dauphin County 911 Dispatch dispatched a crew from Progress Fire Department to respond to a reported gas leak at 3204 Crest Road.

33. At 9:07 a.m. on December 13, 2022, Respondent's Dispatch received a call from Dauphin County 911 Dispatch alerting Respondent to the excavation damage and gas leak.

34. After the gas line strike, Pronto Plumbing's crew evacuated the occupants of 3204 Crest Road and opened the first-floor windows of the residence.

35. The escaping natural gas flowed into the basement of the residence.

36. At 9:25 a.m. Respondent's First Responder arrived on scene.

37. At 9:30 a.m., the accumulated natural gas in the residence at 3204 Crest Road ignited, resulting in a natural gas explosion.

38. The natural gas explosion and secondary fire destroyed the residence at 3204 Crest Road, damaged three surrounding homes, and injured two people. The property damage exceeded \$25,000.00. The injured persons were treated at a hospital and released the same day. See attached I&E Exhibit 3.

III. VIOLATIONS


COUNT ONE

39. All allegations in paragraphs 1 through 38 are incorporated as if fully set forth herein. Respondent failed to respond to the emergency notification as soon as practicable following receipt of notification and failed to mark, stake, locate or otherwise provide the position of the facility owner's underground lines at the work site in response to the notification. If proven, this is a violation of 73 P.S. § 178(5) (Duties of facility owners).

WHEREFORE, for all the foregoing reasons, the Pennsylvania Public Utility Commission's Bureau of Investigation and Enforcement respectfully requests that the Commission:

- (1) Find UGI Utilities Inc. – Gas Division to be in violation of the PA One Call Law as alleged;
- (2) Impose an administrative penalty in the amount of \$20,000 based upon the injuries sustained and property damage exceeding \$25,000; and
- (4) Order such other remedies as the Commission may deem appropriate.
- (5) If payment of the administrative penalty is not made as directed, the Bureau of Investigation and Enforcement requests that this matter be referred to the Pennsylvania Office of the Attorney General for collection and any other appropriate action.

Respectfully submitted,

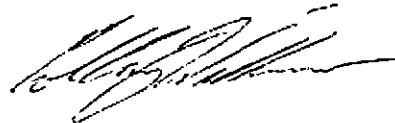

Colby B. Widdowson
Prosecutor
PA Attorney ID No. 326185

Pennsylvania Public Utility Commission
Bureau of Investigation and Enforcement
Commonwealth Keystone Building
400 North Street
Harrisburg, PA 17120
(717) 787-2139
cwiddowson@pa.gov

Date: June 25, 2025

**BEFORE THE
PENNSYLVANIA PUBLIC UTILITY COMMISSION**

Pennsylvania Public Utility Commission,	:	
Bureau of Investigation and Enforcement,	:	
Complainant	:	
	:	
v.	:	Docket No. C-2025-
	:	
UGI Utilities, Inc. - Gas Division,	:	
Respondent	:	

VERIFICATION

I, Sara Andrade-Locke, Damage Prevention Supervisor, Damage Prevention Section, Bureau of Investigation and Enforcement, hereby state that the facts above set forth are true and correct to the best of my knowledge, information, and belief and that I expect that the Bureau of Investigation and Enforcement will be able to prove the same at any hearing held in this matter. I understand that the statements herein are made subject to the penalties of 18 Pa.C.S. § 4904 relating to unsworn falsification to authorities.

RECEIVED

JUN 25 2025

PA PUBLIC UTILITY COMMISSION
SECRETARY'S BUREAU



Date: 6/25/2025

Sara Andrade-Locke
Damage Prevention Supervisor
Damage Prevention Section
Pennsylvania Public Utility Commission
Bureau of Investigation and Enforcement
Commonwealth Keystone Building
400 North Street
Harrisburg, PA 17120

**BEFORE THE
PENNSYLVANIA PUBLIC UTILITY COMMISSION**

Pennsylvania Public Utility Commission,
Bureau of Investigation and Enforcement,
Complainant

v.


UGI Utilities, Inc. - Gas Division,
Respondent

Docket No. C-2025-

VERIFICATION

I, Kokou Apetoh, Fixed Utility Valuation Engineer, Pipeline Safety Division, Bureau of Investigation and Enforcement, hereby state that the facts above set forth are true and correct to the best of my knowledge, information, and belief and that I expect that the Bureau of Investigation and Enforcement will be able to prove the same at any hearing held in this matter. I understand that the statements herein are made subject to the penalties of 18 Pa.C.S. § 4904 relating to unsworn falsification to authorities.

Date: June 25, 2025



Kokou Apetoh
Fixed Utility Valuation Engineer
Pipeline Safety Division
Pennsylvania Public Utility Commission
Bureau of Investigation and Enforcement
Commonwealth Keystone Building
400 North Street
Harrisburg, PA 17120

RECEIVED

JUN 25 2025

PA PUBLIC UTILITY COMMISSION
SECRETARY'S BUREAU

I&E Exhibit 1

RECEIVED

JUN 25 2025

PA PUBLIC UTILITY COMMISSION
SECRETARY'S BUREAU

CDC 00000 POCs MM/DD/YY TT:TT:TT 20223461851-000 NEW XCAV EMER

=====PENNSYLVANIA UNDERGROUND UTILITY LINE PROTECTION REQUEST=====

Serial Number--[20223461851]-[000] Channel#--[1311A999][0269][2019-08]
Message Type--[NEW][EXCAVATION][EMERGENCY]

County--[DAUPHIN] Municipality--[SUSQUEHANNA TWP]
Work Site--[3204 CREST RD]
Nearest Intersection--[NORTHWAY RD]
Second Intersection--[RITTER RD]
At Intersection--[N] Between Intersections--[Y] Site Marked in White--[Y]
Subdivision--[]
Location Information--
[]
Caller Lat/Lon--[]
Mapped Type--[P] Mapped Lat/Lon--
[40.292212/-76.848087,40.292564/-76.848271,40.292611/-76.847932,
40.292271/-76.847873]
Attachments--[http://www.pa811.org/attachments/20223461851]
Type of Work--[SWR LINE REPAIR] Depth--[7FT]
Extent of Excavation--[20-25FT] Method of Excavation--[POWER EQUIP]
Equip Type--[MINI EXCAVATOR]
Street--[] Sidewalk--[] Pub Prop--[] Pvt Prop--[X] Other--[]
Private Front--[X] Rear--[] Left--[] Right--[]

Lawful Start Dates--[] thru [] Response Due Date--[12-Dec-22]
Scheduled Excavation Date--[13-Dec-22] Dig Time--[0800] Duration--[1 DAY]

Caller--[LEIGHANN ANDERSON]
Caller Phone--[717-737-8100]
Excavator--[PRONTO PLUMBING AND DRAINS]
Address--[1111 PRIMROSE AVE]
City--[CAMP HILL] State--[PA] Zip--[17011]
FAX--[] Caller Type--[B]
Email--[leighann.anderson@prontoplumbing.com]
Work For--[CHAD BARBER]
Onsite Contact--[LEIGHANN ANDERSON]
Onsite Contact Phone--[717-259-3354]
Best Time to Call--[ANYTIME]
Onsite Contact Email--[leighann.anderson@prontoplumbing.com]
Job Number--[485540]

Prepared--[12-Dec-22] at [1315] by [LORYNDA POLJAK]
Remarks--
[SEWAGE IS BACKING UP INTO THE BASEMENT.]

BW 0 BW =CAPITAL REG WTR HC 0 HC =VERIZON PA HRBG PR 0 PR =PPL ELEC HRBG
SB 0 ,SB =COMCAST CABLE SXHO SXH=SUSQHNN TA/HWY UI 0 UI =UGI HARRISBURG
XD10 XD1=SUSQHNN TA/SWR

Serial Number--[20223461851]-[000]
===== Copyright (c) 2022 by Pennsylvania One Call System, Inc. =====

=====PENNSYLVANIA UNDERGROUND UTILITY LINE PROTECTION REQUEST=====

Serial Number--[20223461851]-[001] Channel#--[0905A999][0118][2019-08]
Message Type--[RENOTIFY][EXCAVATION][EMERGENCY]

County--[DAUPHIN] Municipality--[SUSQUEHANNA TWP]
Work Site--[3204 CREST RD]
Nearest Intersection--[NORTHWAY RD]
Second Intersection--[RITTER RD]
At Intersection--[N] Between Intersections--[Y] Site Marked in White--[Y]
Subdivision--[]

Location Information--[]
Caller Lat/Lon--[]
Mapped Type--[P] Mapped Lat/Lon--
[40.292212/-76.848087,40.292564/-76.848271,40.292611/-76.847932,
40.292271/-76.847873]
Attachments--[http://www.pa811.org/attachments/20223461851]

Type of Work--[SWR LINE REPAIR] Depth--[7FT]
Extent of Excavation--[20-25FT] Method of Excavation--[POWER EQUIP]
Equip Type--[MINI EXCAVATOR]
Street--[] Sidewalk--[] Pub Prop--[] Pvt Prop--[X] Other--[]
Private Front--[X] Rear--[] Left--[] Right--[]

Lawful Start Dates--[] thru [] Response Due Date--[13-Dec-22]
Scheduled Excavation Date--[13-Dec-22] Dig Time--[0800] Duration--[1 DAY]

Caller--[LEIGHANN ANDERSON]
Caller Phone--[717-737-8100]
Excavator--[PRONTO PLUMBING AND DRAINS]
Address--[1111 PRIMROSE AVE]
City--[CAMP HILL] State--[PA] Zip--[17011]
FAX--[] Caller Type--[B]
Email--[leighann.anderson@prontoplumbing.com]
Work For--[CHAD BARBER]
Onsite Contact--[LEIGHANN ANDERSON]
Onsite Contact Phone--[717-259-3354]
Best Time to Call--[ANYTIME]
Onsite Contact Email--[leighann.anderson@prontoplumbing.com]
Job Number--[485540]

Prepared--[13-Dec-22] at [0907] by [KATELYNN HORVATH]
Remarks--[SEWAGE IS BACKING UP INTO THE BASEMENT.]

Renotify (RNO) Information
RNO Caller--[MORGAN HARMAN]
RNO Caller Phone--[717-737-8100]
RNO Onsite Contact--[MORGAN HARMAN]
RNO Onsite Phone--[717-208-4587]
RNO Onsite Contact Email--[leighann.anderson@prontoplumbing.com]
Crew Onsite--[Y] Unmarked--[Y] Incorrectly Marked--[N]

DIRECT CONTACT WITH EXCAVATOR REQUIRED WITHIN TWO HOURS--[N]

RNO Remarks--
[ATTN UGI UTILITIES YOU RESPONDED AS CONFLICT DCTF BUT NO FOLLOW UP WAS
MADE. PLEASE REPORT TO THE SITE AND MARK YOUR LINES ASAP AS THE CREW IS ON
SITE STARTING AND THEY NEED THE GAS LINES MARKED. IF THERE ARE ANY
CONCERNS PLEASE CALL DIRECTLY. THANK YOU.]

UI 0 UI =UGI HARRISBURG

Serial Number--[20223461851]-[001]
===== Copyright (c) 2022 by Pennsylvania One Call System, Inc. =====

RESPONSES for S/N: 20223461851:


Ver	CDC	Name	Response	Time	Respondent
0	PR	PPL ELECTRIC UTILITIES CORPORATION	PR-CLEAR. NO FACILITIES OR FACIL NOT INVOLVED	12/12/2022 1:24:52 PM	CLS-WEBSVC
0	SXH	SUSQUEHANNA TWP AUTH/SUSQUEHANNA TWP	SXH-CLEAR. NO FACILITIES OR FACIL NOT INVOLVED	12/12/2022 1:42:32 PM	JH-WEB
0	UI	UGI UTL HARRISBURG	UI-CONFLICT. DCTF BY FO	12/12/2022 1:18:27 PM	ATS-WEBSVC
0	XD1	SUSQUEHANNA TWP AUTH/SUSQUEHANNA TWP	XD1-CLEAR. NO FACILITIES OR FACIL NOT INVOLVED	12/12/2022 1:42:44 PM	JH-WEB
0	SB	COMCAST CABLE COMMUNICATIONS INC	SB-CLEAR. NO FACILITIES OR FACIL NOT INVOLVED	12/12/2022 1:24:52 PM	CLS-WEBSVC
0	BW	CAPITAL REGION WATER	BW-NO RESPONSE	12/13/2022 12:03:06 AM	Auto-KARL
0	BW	CAPITAL REGION WATER	BW-FIELD MARKED	12/13/2022 7:25:59 AM	ch-WEBSVC
0	HC	VERIZON PENNSYLVANIA LLC	HC-NO RESPONSE	12/13/2022 12:03:06 AM	Auto-KARL
0	HC	VERIZON PENNSYLVANIA LLC	HC-CLEAR. NO FACILITIES OR FACIL NOT INVOLVED	12/13/2022 8:07:14 AM	AAA-WEBSVC
1	UI	UGI UTL HARRISBURG	UI-CLEAR. NO FACILITIES OR FACIL NOT INVOLVED	12/14/2022 2:40:30 PM	ATS-WEBSVC
1	UI	UGI UTL HARRISBURG	UI-INSUFF INFO. DO NOT DIG	12/13/2022 4:10:48 PM	ATS-WEBSVC
1	UI	UGI UTL HARRISBURG	UI-CONFLICT. DCTF BY FO	12/13/2022 9:09:37 AM	ATS-WEBSVC

Ver	CDC	Name	Response	Time	Respondent
0	BW	CAPITAL REGION WATER	003-FIELD MARKED	12/13/2022 07:25:59	ch-WEBSVC
0	BW	CAPITAL REGION WATER	999-NO RESPONSE*	12/13/2022 00:03:06	Auto-KARL
0	HC	VERIZON PENNSYLVANIA LLC	001-CLEAR. NO FA	12/13/2022 08:07:14	AAA-WEBSVC
0	HC	VERIZON PENNSYLVANIA LLC	999-NO RESPONSE*	12/13/2022 00:03:06	Auto-KARL
0	PR	PPL ELECTRIC UTILITIES CO	001-CLEAR. NO FA	12/12/2022 13:24:52	CLS-WEBSVC
0	SB	COMCAST CABLE COMMUNICATI	001-CLEAR. NO FA	12/12/2022 13:24:52	CLS-WEBSVC
0	SXH	SUSQUEHANNA TWP AUTH/SUSQ	001-CLEAR. NO FA	12/12/2022 13:42:32	JH-WEB
1	UI	UGI UTL HARRISBURG	002-CONFLICT. DC	12/13/2022 09:09:37	ATS-WEBSVC
0	UI	UGI UTL HARRISBURG	002-CONFLICT. DC	12/12/2022 13:18:27	ATS-WEBSVC
0	XD1	SUSQUEHANNA TWP AUTH/SUSQ	001-CLEAR. NO FA	12/12/2022 13:42:44	JH-WEB

FACILITY OWNER RESPONSE NOTES:

DELIVERIES for S/N 20223461851:

Ver	CDC	Name	To	Time	Seq	Type
0	BW	CAPITAL REGION WATER	BW	12/12/2022 13:16:11	12	MAIL
0	HC	VERIZON PENNSYLVANIA LLC	HC	12/12/2022 13:16:12	149	MAIL
0	PR	PPL ELECTRIC UTILITIES CORPOR	PR	12/12/2022 13:16:13	106	MAIL
0	SB	COMCAST CABLE COMMUNICATIONS	SB	12/12/2022 13:16:14	69	MAIL
0	SXH	SUSQUEHANNA TWP AUTH/SUSQUEHA	SXH	12/12/2022 13:16:16	14	MAIL
0	XD1	SUSQUEHANNA TWP AUTH/SUSQUEHA	XD1	12/12/2022 13:16:18	14	MAIL
0	UI	UGI UTL HARRISBURG	UI	12/12/2022 13:16:19	132	MAIL
1	UI	UGI UTL HARRISBURG	UI	12/13/2022 09:07:09	23	MAIL

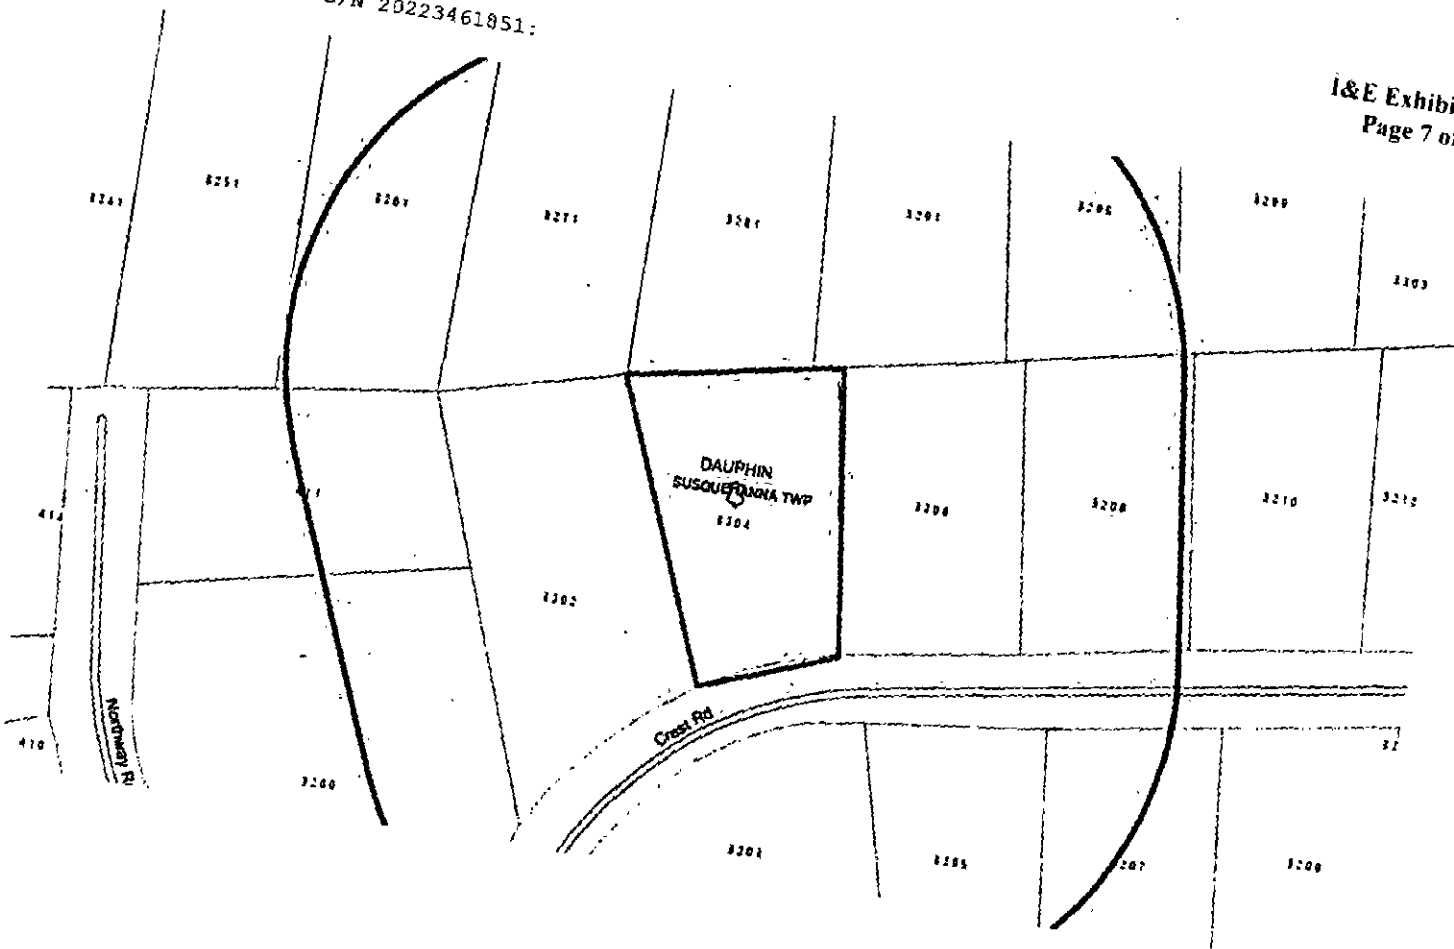

I&E Exhibit 2


RECEIVED

JUN 25 2025

PA PUBLIC UTILITY COMMISSION
SECRETARY'S BUREAU



Jan 13 2023 at 12:18:07 PM
3204 Crest Rd
Harrisburg PA 17109
United States

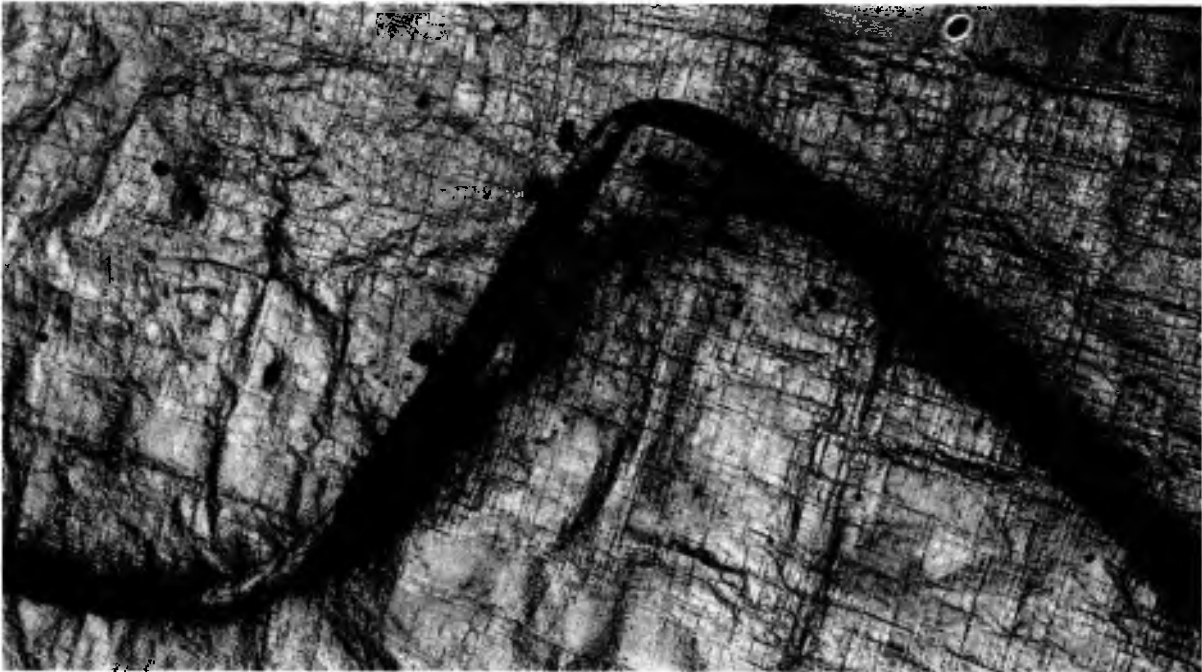







I&E Exhibit 3

RECEIVED

JUN 25 2025

PA PUBLIC UTILITY COMMISSION
SECRETARY'S BUREAU











**BEFORE THE
PENNSYLVANIA PUBLIC UTILITY COMMISSION**

Pennsylvania Public Utility Commission,	:	
Bureau of Investigation and Enforcement,	:	
Complainant	:	
	:	
v.	:	Docket No. C-2025-
	:	
UGI Utilities, Inc. - Gas Division,	:	
Respondent	:	


CERTIFICATE OF SERVICE

I hereby certify that I have this day served a true copy of the foregoing document upon the parties, listed below, in accordance with the requirements of 52 Pa. Code § 1.54 (relating to service by a party).

**Service by Certified Mail, Return Receipt Requested,
and Electronic Mail**

Michael Swerling, Esq.
UGI Utilities, Inc. - Gas Division
500 North Gulph Road
King of Prussia, PA 19406
swerlingm@ugicorp.com

RCVD PUC SEC BUR
JUN 25 2025 AM 10:16



Colby B. Widdowson
Prosecutor
PA Attorney ID No. 326185
Bureau of Investigation and Enforcement
(717) 783-5243
cwiddowson@pa.gov

Dated: June 25, 2025